
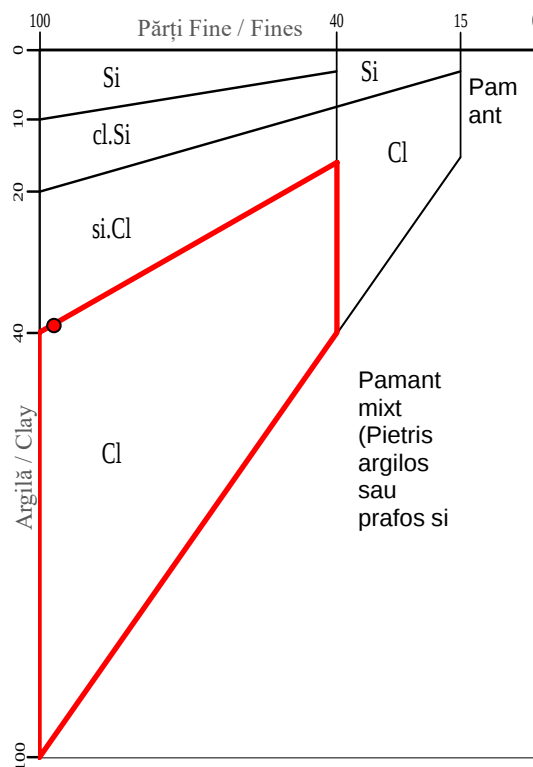


Amplasament / Location	Reabilitarea liniei de cale ferata Roman – Iasi - Frontiera
Forajul/Borehole:	PODET 25
Proba/Sample:	PT 6
Adancimea/Depth(m):	6,00

Raport de incercare nr. / Test report no.75 647

	d (mm)	mp (%)
	100	100,0
	100	100,0
	100	100,0
	100	100,0
	100	100,0
	100	100,0
	90	100,0
	63	100,0
	45	100,0
	31,5	100,0
	22,4	100,0
	16	100,0
	11,2	100,0
	5,6	100,0
	3,15	100,0
	2	100,0
	0,5	100,0
	0,25	100,0
	0,10	98,0
	0,063	97,2
	0,063	97,24
	0,038	95,51
	0,027	92,35
	0,020	86,55
	0,015	80,75
	0,011	74,95
	0,008	67,04
	0,006	59,14
	0,004	52,81
	0,003	47,01
	0,002	41,21
	0,001	35,42

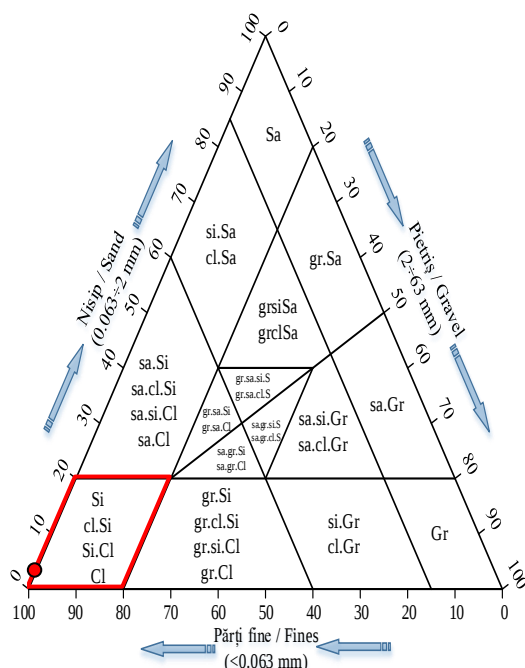


Clasificarea pamantului dupa SR EN ISO 14688-1:2018 / SR EN ISO 14688-2:2018

Tip pamant / Soil group	Tip fractiune	%	C _u (Un)	C _c	Forma curbei granulometrice / Shape of grading curve	C _u (Un)	C _c
Pamant fin / Fine	Argila	Cl	<3	<1	Foarte uniforma / Very uniform	#N/A	#####
	Praf	Si					
Pamant grosier / Coarse	Nisip	Sa	3---6	<1	Uniforma / Uniform	#N/A	#####
	Pietris	Gr	6---15	<1	Uniformitate medie / Medium uniformity		
Pamant foarte grosier / Very coarse	Bolovanis	Co	>15	1---3	Neuniforma / Non-uniform	#N/A	#####
			>15	<0,5	Discontinua / Gap graded		

Executat de / Performed by :
 ing. Nina IOSIF

Nina IOSIF

Sef Laborator / Laboratory head: Constanta ANDREI



COD PROBA75 647

Raport de incercare nr. / Test report no.75 648

DETERMINAREA LIMITELOR DE PLASTICITATE /
DETERMINATION OF ATTEBERG LIMITS
STAS 1913/4-86

Nr. de caderi ale cupei (N)	25	UMIDITATE NATURALA NATURAL MOISTURE STAS 1913/1-82			LIMITA DE CURGERE LIQUID LIMIT W _L %				LIMITA DE FRAMANTARE PLASTIC LIMIT W _P %		
Adancimea de patrundere a conului (S) mm	10				Metoda cu cupa						
					42	31	22	14			
PROBA UMEDA + TARA A (gr)		150,00			27,07	28,98	27,25	29,72	16,17	16,34	16,97
PROBA USCATA + TARA B (gr)		114,56			20,87	22,26	20,95	22,63	15,38	15,50	16,06
TARA C (gr)					10,33	11,35	11,11	11,92	11,78	11,67	11,95
A - B		35,44			6,20	6,72	6,29	7,08	0,79	0,85	0,91
B - C		114,56			10,54	10,91	9,84	10,71	3,60	3,83	4,11
W(%) = (A-B)/(B-C)*100		30,94			58,82	61,57	63,95	66,13	21,96	22,14	22,24
W(%) MEDIU			30,94				63,16			22,12	

DESCRIEREA PROBEI /
DESCRIPTION OF THE SOIL:


Argila cenusie-galbuie cu FeO si calcar degradat plastic vartoasa / stiff consistency

SR EN ISO 14688/1/2-2018


Pamant fin cu plasticitate mare / Fine soil, heigh plasticity

CIH

GRAFICUL LIMITEI SUPERIOARE DE PLASTICITATE
UPPER LIMIT OF PLASTICITY CHART

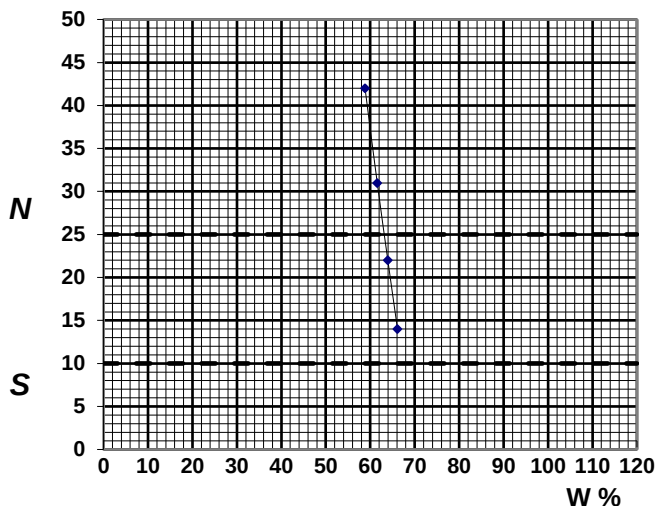

GRAFIC PLASTICITATE /
PLASTICITY CHART

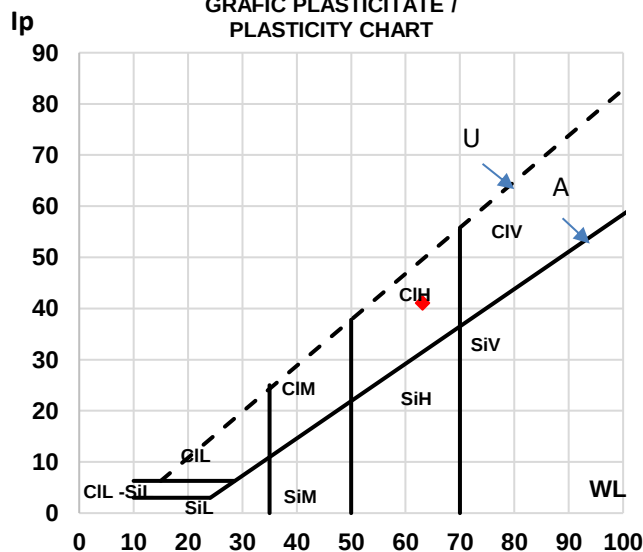

					SR EN ISO 14688/2-2018		
LIMITA DE FRAMANTARE / PLASTIC LIMIT	W _P =	22,12	%		Tip pamant / Type of Soil	Plasticitate / Plasticity	Limita de curgere / Liquid limit
UMIDIT. NATUR. / NATURAL MOISTURE	W =	30,94	%		Cl Clay	Low redusa	<35
LIMITA DE CURGERE / LIQUID LIMIT	W _L =	63,16	%		Si Silt	Medium medie	35----50
INDICE DE PLASTICIT./PLASTICITY INDEX	I _P =W _L -W _P	41,04	%			Heigh mare	50----70
INDICE DE CONSISTENȚĂ / CONSISTENCY INDEX	I _C = (W _L - W) / I _P	0,79				Very foarte heigh mare	>70
INDICE DE LICHIDITATE/ LIQUIDITY INDEX	I _L = (W - W _P) / I _P	0,21				O organig	

Executat de / Performed by: Laborant Emilia Dumitru

Data / Date: 16.12.2020

COD PROBA75

648

Sef Laborator / Laboratory head: Constanta ANDREI

