


CUTIE ETANSA PENTRU COPERTINA C2 - SCHEMA MONOFILARA
C2 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

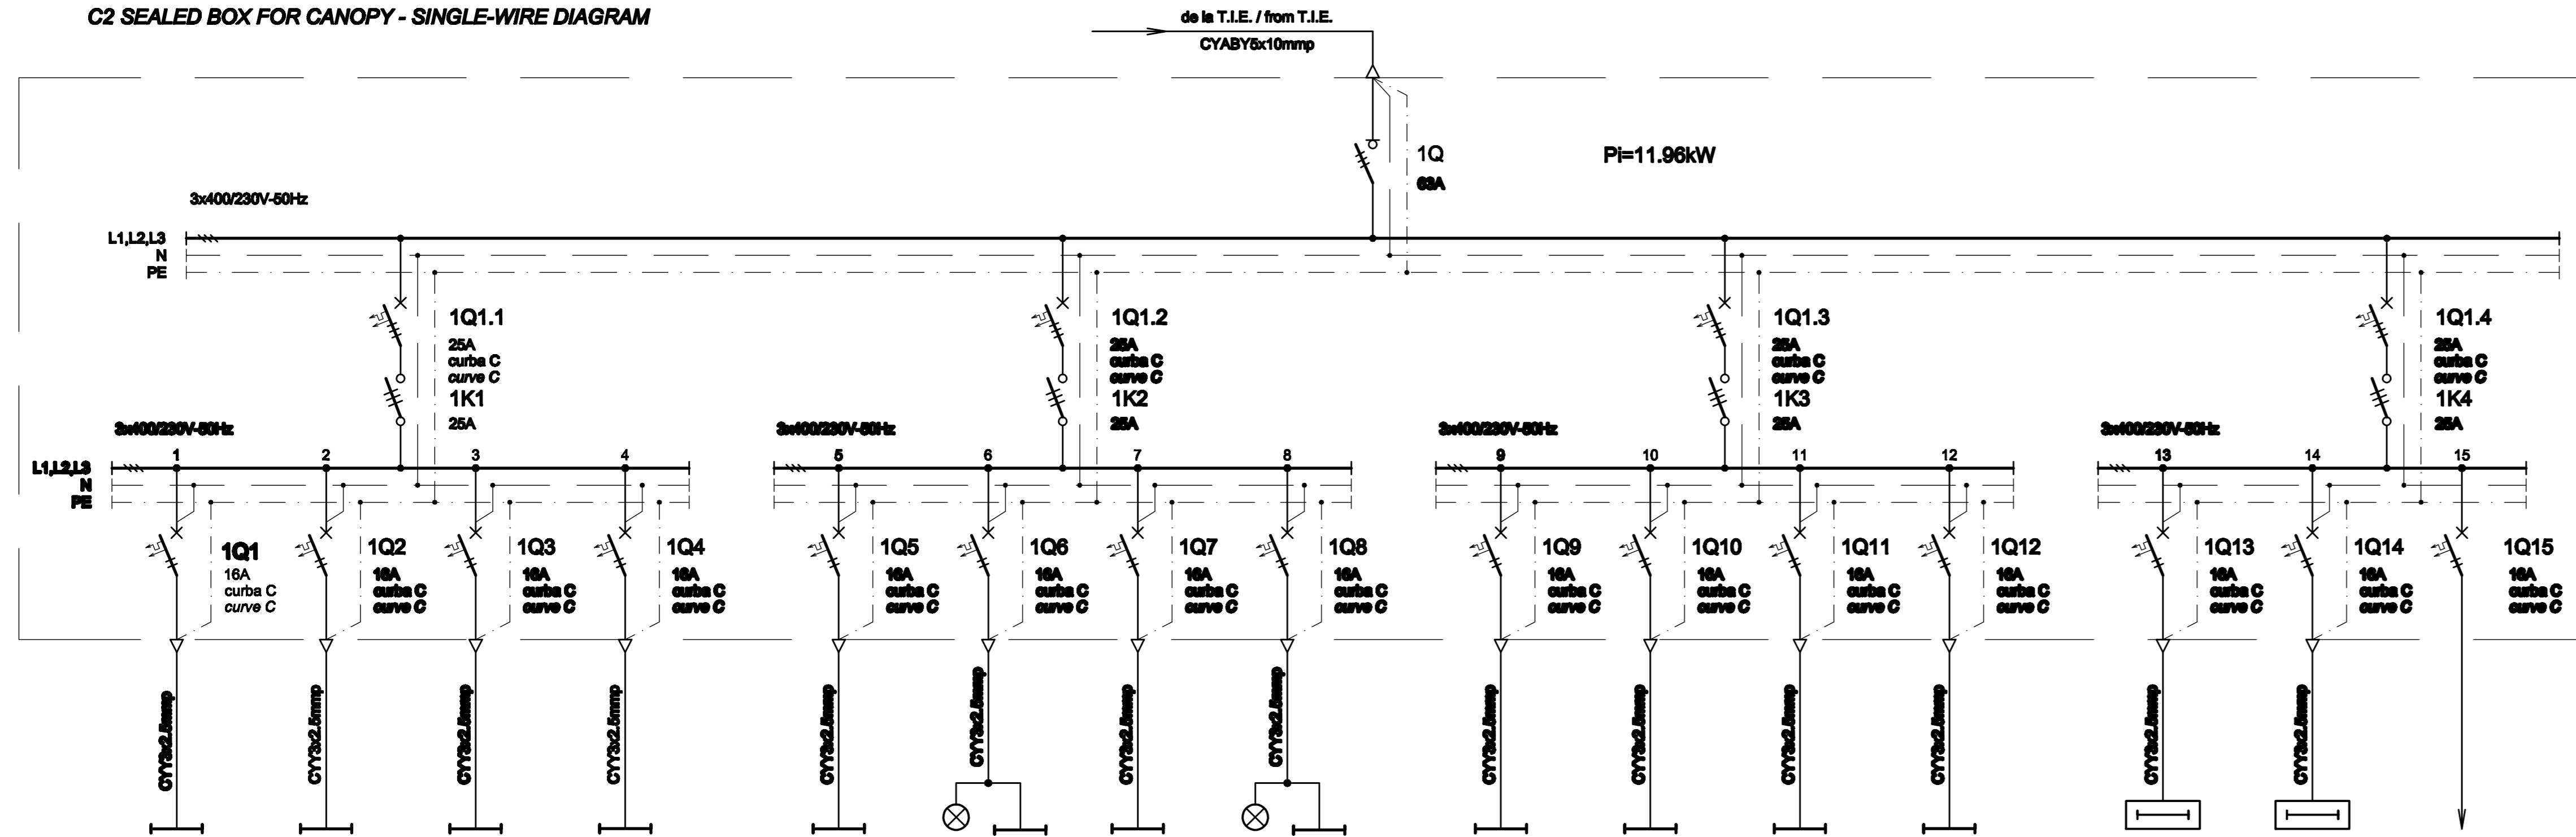

Nr. circuit Circuit number	1	2	3	4
PI [kW]	0.6	0.6	0.7	0.7
Destinația Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps

ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 16LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 18LL / Lamps
---	---	---	---


ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps
---	---	---	---

PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 5Buc. / Pieces	PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 7Buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE
---	---	--

CUTIE ETANSA PENTRU COPERTINA C2 - SPECIFICATIE DE APARATAJ
C2 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparaturii Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos.	Observatii Remarks
0	1				
1	1Q	Separator de sarcina tripolar Three-poles switch-disconnector	In=63A Un=400V Uimp=6kV f=50Hz Iom=2.2kA	1	
2	1Q1.1, ..., 1Q1.4	Intreruptor automat tripolar, curba C Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	1Q1, ..., 1Q15	Intreruptor automat bipolar, curba C Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	15	
4	1K1, ..., 1K4	Contactori electromagnetici tripolari de curent alternativ / Three-poles electromagnetic a.c. contactors	In=25A Un=400A Uc=230V f=50Hz	4	
5	-	Cutie / Box	IP54, Class I / Class I	1	

Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR
D					
C					
B					
A					

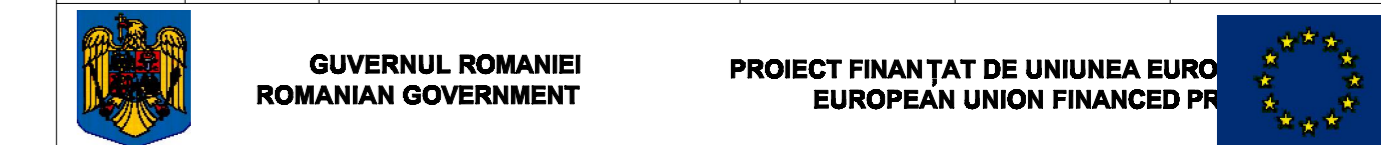

GUVERNUL ROMANIEI
ROMANIAN GOVERNMENT

PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ
EUROPEAN UNION FINANCED PROJECT

C.N.C.F. "C.F.R." - S.A.

CLIENT / CLIENT

ITALFERR GRUPPO FERROVIE DELLO STATO
Scott Wilson
OBERMEYER PLANEN + BERATEN GmbH
TECNIC Consulting Engineers

CONSULTANT / CONSULTANT		Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	12.2011	
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	12.2011	
Verificat Checked	Expert Verificator Checking Expert	12.2011	

SUBCONTRACTANT / SUBCONTRACTOR		Data Date	Semnătură Signature
Aprobat Approved	Responsabil Subcontractant Subcontractant Responsible	12.2011	
Elaborat Elaborated	Proiectant Designer	12.2011	

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Brașov - Sighișoara
Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Brașov - Sighișoara

Proiect/Project
2004/RO/16/PPA/003
Faza / Phase:
D.E. / E.D.

Denumire desen / Drawing Title :
Cutie etanșă pentru copertină C2 - Stația Racoș;
Racos station - C2 sealed box for canopy

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1 0 1 E 1 1 B X I E 0 0 3 1 0 5 2 1			