


EXECUTAREA LUCRARILOR DE MONTAJ A INSTALATIEI
SANITARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR
DIN CAIETUL DE SARCINI SPECIFIC ACESTUI TIP DE
LUCRARI

THE EXECUTION OF THE FIXING WORKS FOR SANITARY
INSTALLATION WILL BE CARRIED OUT ACCORDING TO
THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS
THAT ARE INTENDED FOR THIS TYPE OF WORKS.

Sectione "C - C"
Section "C - C"

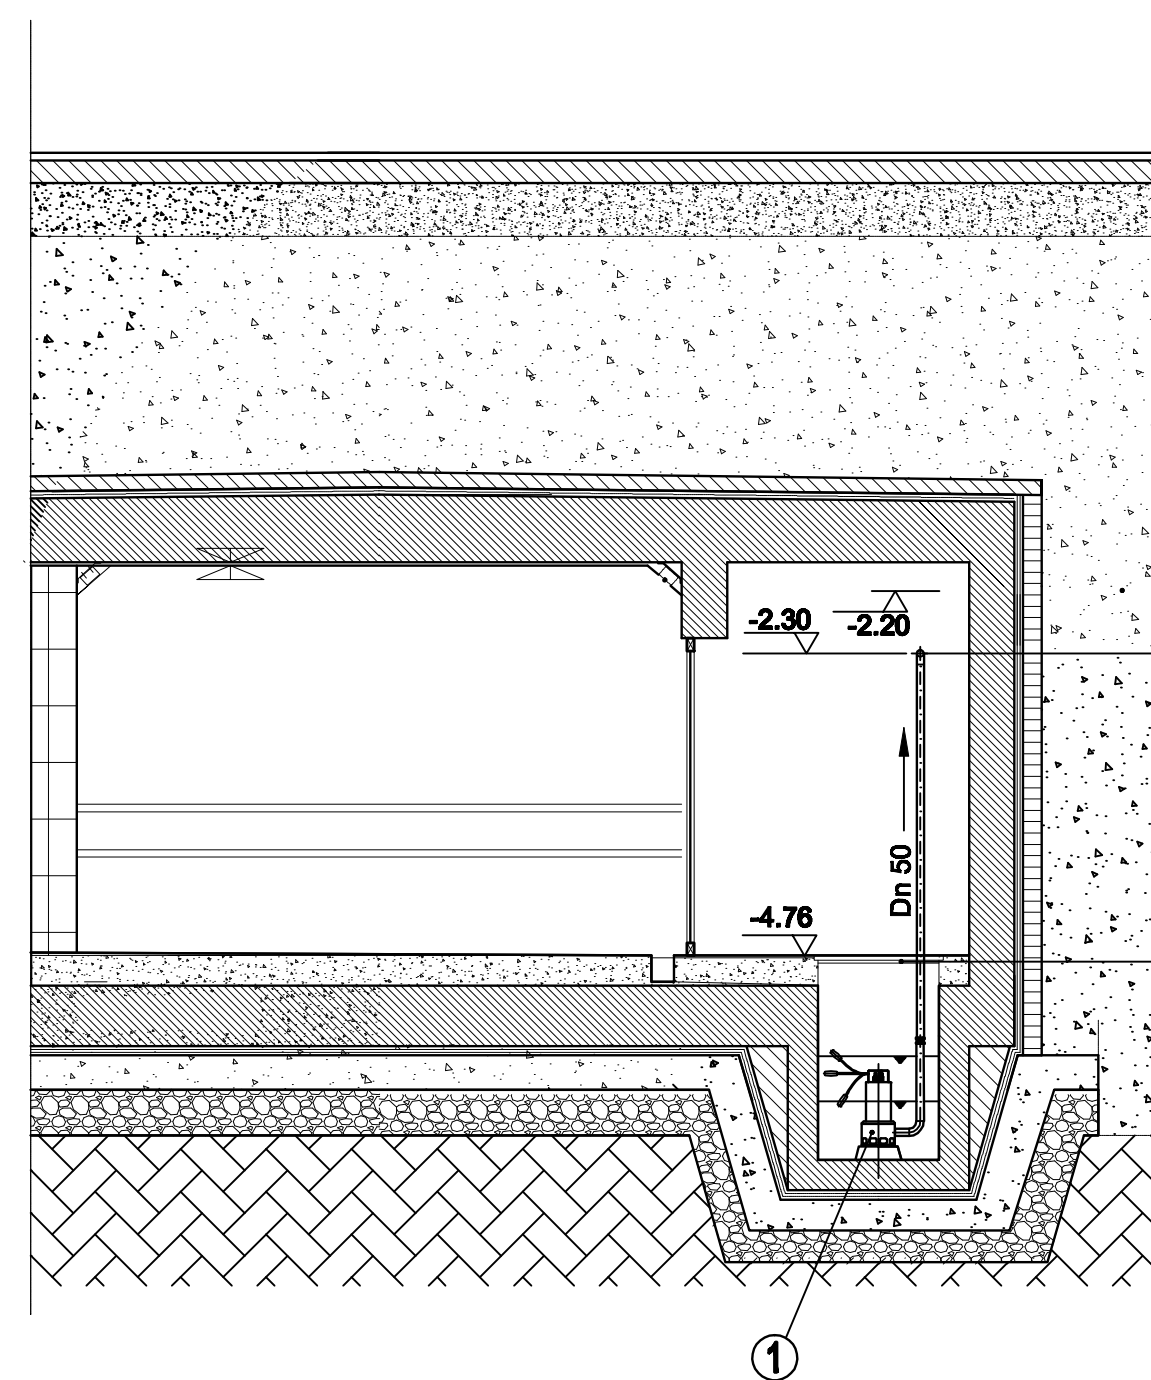

LEGENDA :

- TRASEU APA DE SPALARE SUB PRESIUNE, DIN TEAVA DE OTEL, Dn 60
- PTE 60 PIESA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 60 mm
- ① ELECTROPOMPA SUBMERSIBILA DE EPUISMENT, CU PLUTTOR, Q = 3 m³/h, h = 13 mCA, N = 1,38 kW.

LEGEND :

- PATH OF THE WATER PRESSURE WASHING, FROM STEEL PIPE, DN 60
- PTE 60 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 60 mm
- ① OVERDRIVING IMMERSION ELECTRIC FLOATING PUMP, Q = 3 m³/h, H = 13 mWC, N = 1.38 kW.

* CATEGORIA DE IMPORTANTA "C" NORMALA, CALITATEA LUCRARILOR ASIGURANDU-SE DUPA MODELUL 3.

* CERINTA DE CALITATE A EXIGENTELOR ESENTIALE - DIN H.G. 925/95 - ESTE IS.

* IMPORTANCE CATEGORY: "C" - NORMAL, THE WORKS QUALITY BEING ENSURED BASED ON MODEL 3.

* THE QUALITY REQUIREMENT OF ESSENTIAL DEMANDS IN H.G. 925/95 IS IS.

D					
C					
B					
A					
Indice	Data	Modificari	Proiectant	Aprobat Consultant	Aprobat CFR
		Modification/Revizii	Designer	Approved Consultant	Approved CFR
GUVERNUL ROMANIEI ROMANIAN GOVERNMENT		PROIECT FINANȚAT DE UNIUNEA EUROPEANA ȚA EUROPEAN UNION FINANCED PROJECT			
C.N.C.F. "C.F.R." - S.A.					
CLIENT / CLIENT					
GRUPPO FERROVIE DELLO STATO Joint Venture leader		PLANEN + BERATEN GmbH	Consulting Engineers		
CONSULTANT / CONSULTANT					
Aprobat	Responsabil			Data	Semnatura
Approved	Project manager	R. Lizza		DEC. 2011	
Aprobat	Coordonator				
Approved	Section 1 Coordinator	C. Gambelli		DEC. 2011	
Verificat	Expert Verifier				
Checked	Verifier Expert	Giuseppe Fioravanti		DEC. 2011	
SUBCONTRACTANT / SUBCONTRACTOR					
Aprobat	Responsabil			Data	Semnatura
Approved	Subcontractant Responsible	A. Stanclu - Dinulescu		DEC. 2011	
Intocmit	Proiectant				
Elaborated	Designer	Florian Duta		DEC. 2011	
Reabilitarea liniei de cale ferata Brasov - Simeria, parte componentă a a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h, Tronsoanel : Brasov - Sighisoara Rehabilitation of the railway line Brasov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section : Brasov - Sighisoara					
					Project/Project 2004/RO18/PFA003 Faza / Phase: P.Th. / T.D.
Denumire desen / Drawing Title : Halta C.F. Mateias km 225+100. Tunel pietonal nou. Instalatiei hidraulice. Plan si sectiune "C - C" / Mateias railway halt km 225+100. Pedestrian tunnel. Hydraulic installation. Basement plan and "C - C" section.					
Codificare / Codification System		Scara / Scale	LOT/LOT	Nr. / No	
		1 : 50		01 / 01	
E	A	5	1	C	1
1	2	P	B	1	S
0	1	2	4	0	0
0	2	4	0	0	2
0	0	2	4	0	0