
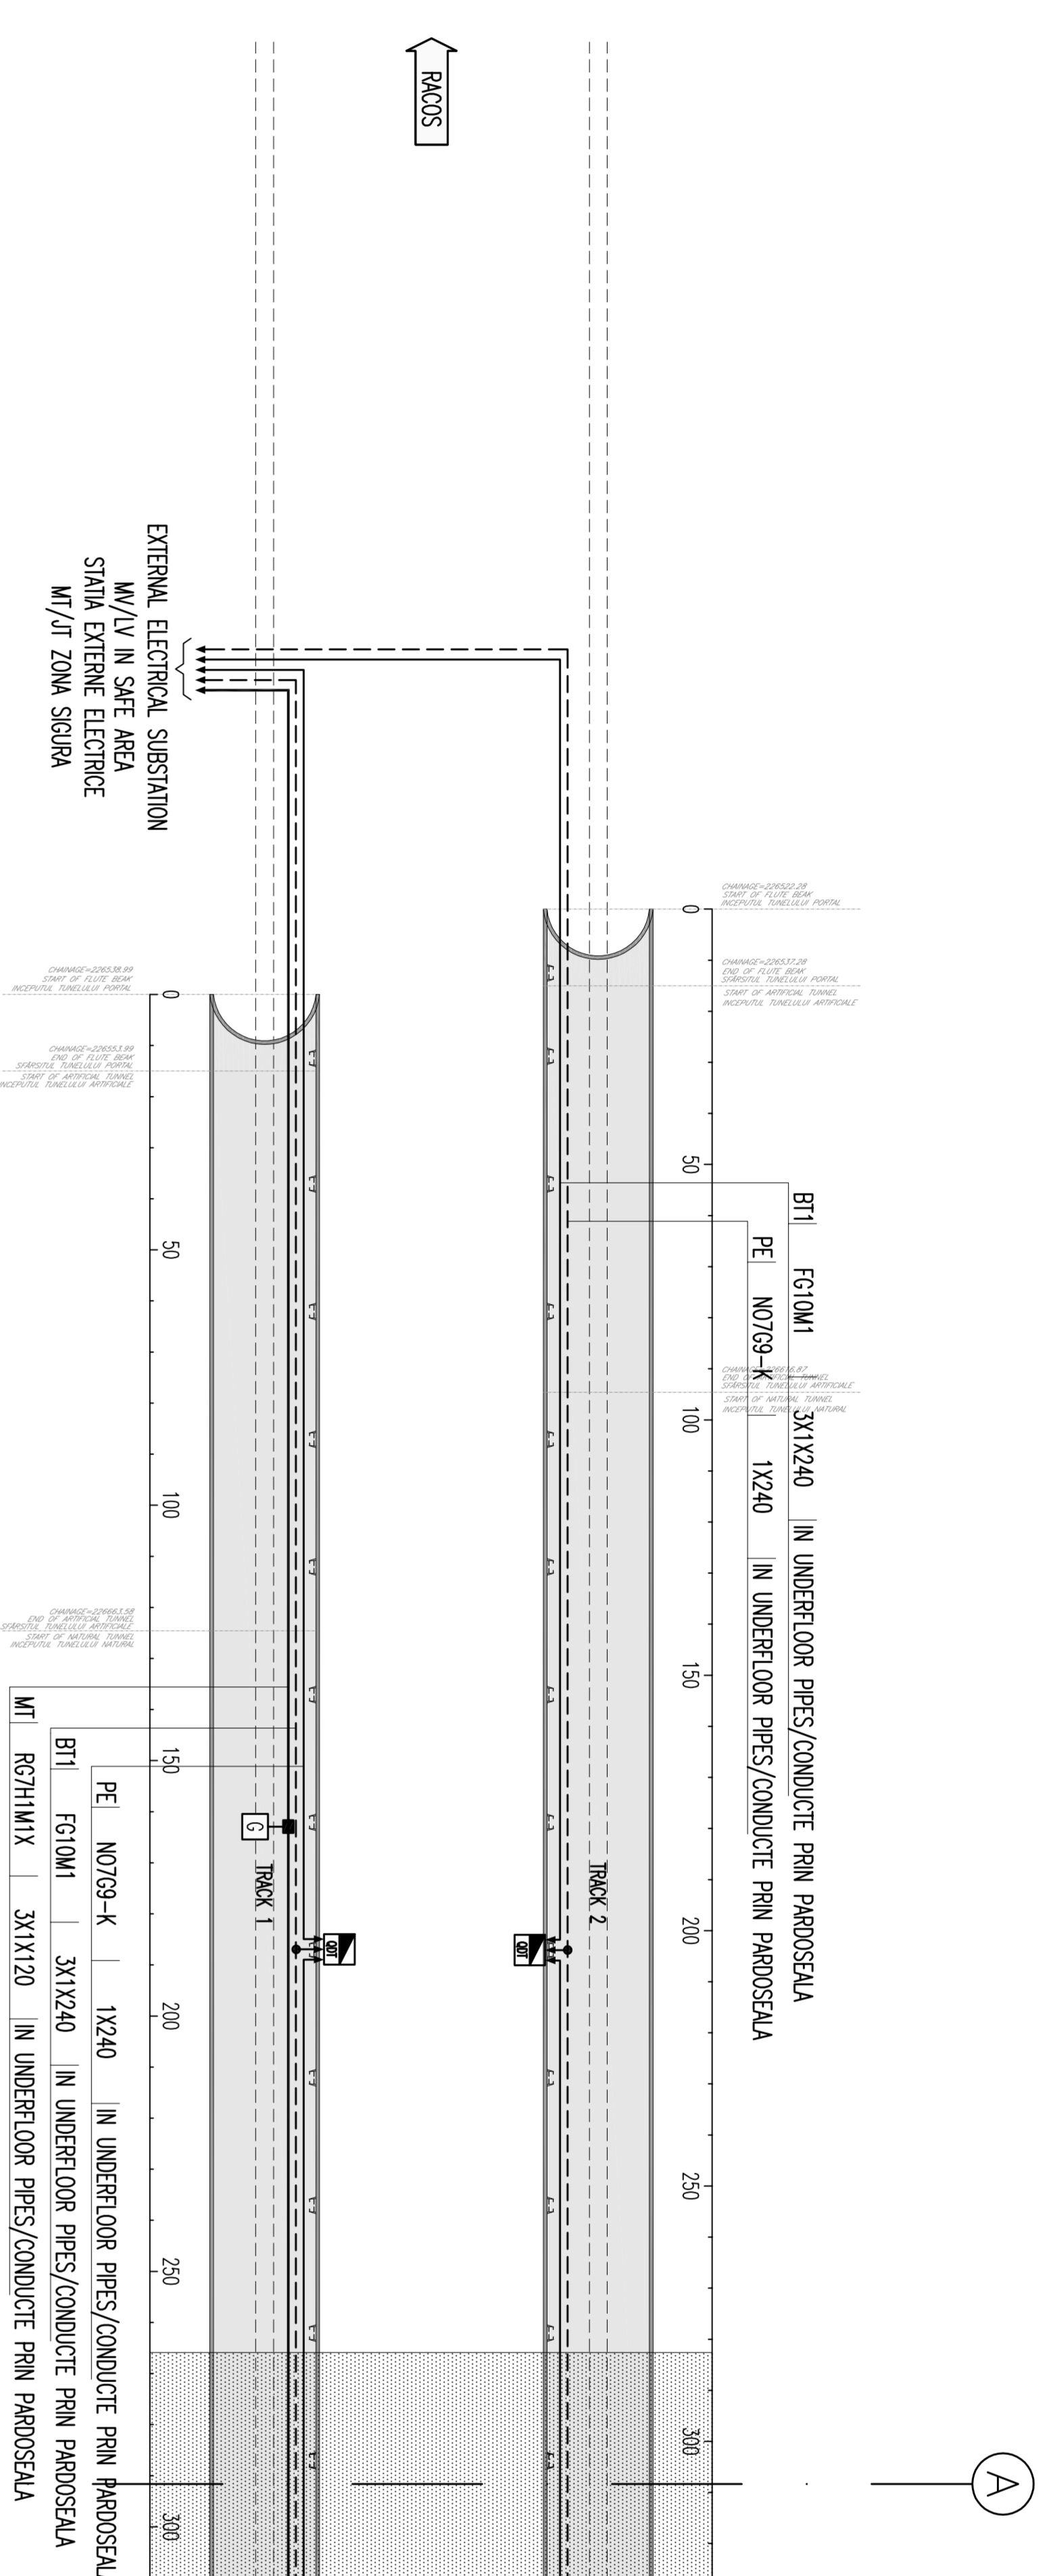


GENERAL PLAN / PLANUL GENERAL

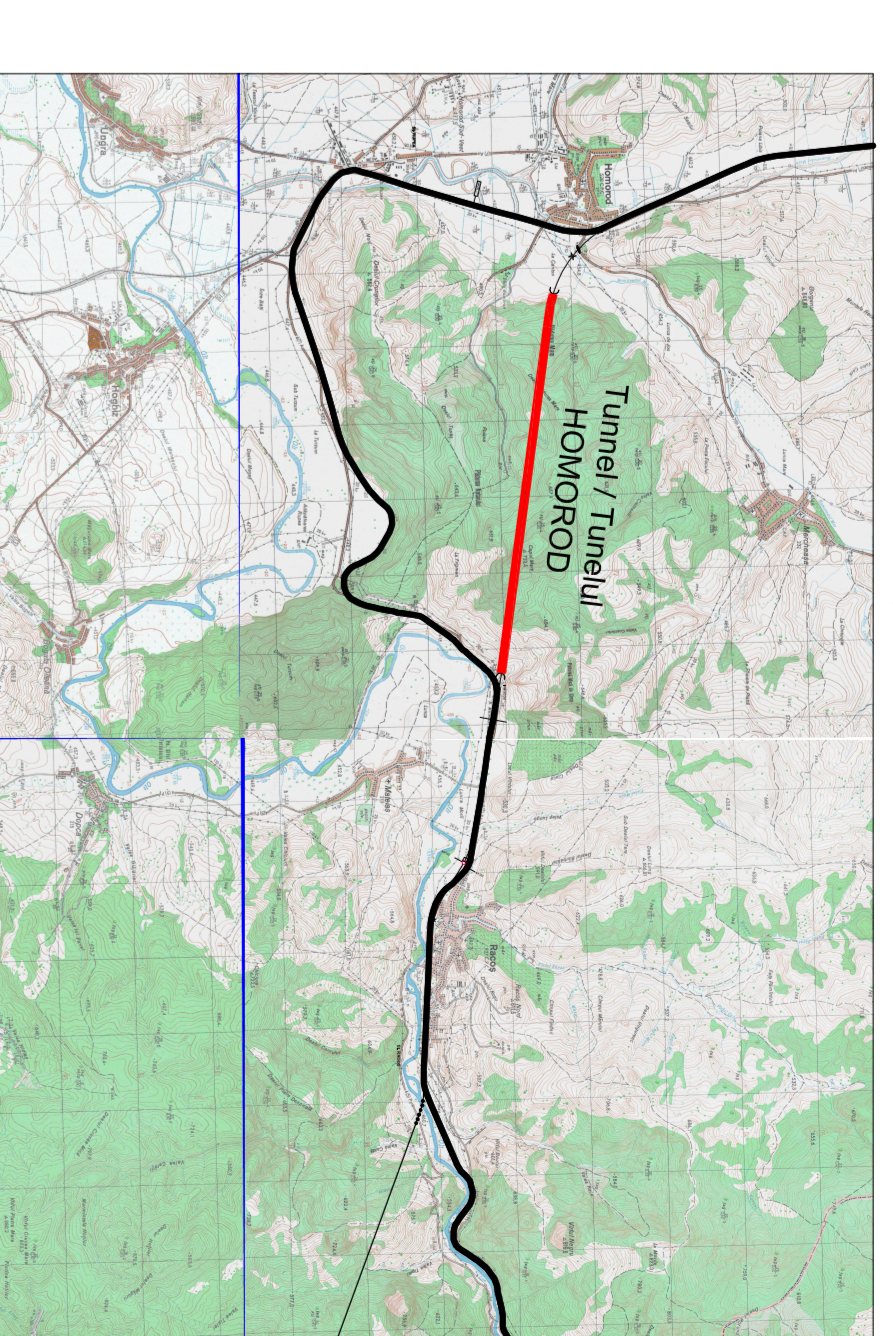




NETWORK LEGEND/LEGENDA RETEA

—	LOW VOLTAGE NETWORK/RETEA DE JOASA TENSIUNE (BT1) 1000 V
---	SECURITY LEAD NETWORK/RETEA DE JOASA TENSIUNE (BT2) 400/230 V
---	MEDIUM VOLTAGE NETWORK/RETEA DE MARE TENSIUNE (MT) 20 kV

SYMBOLS LEGEND/LEGENDA SIMBOLURI

▬	ELECTRICAL PANEL/CABLU ELECTRICE
▬	ELECTRICAL PANEL SECTION/CABLU ELECTRICE SECTIONE
▬	ELECTRICAL PANEL BY-PASS/CABLU ELECTRICE BY-PASS
▬	MARKER FOR JUNCTION CABLE/MARKER PENTRU JUNCTION CABLU

INDICATOR CABLE/INDICATOR CABLE

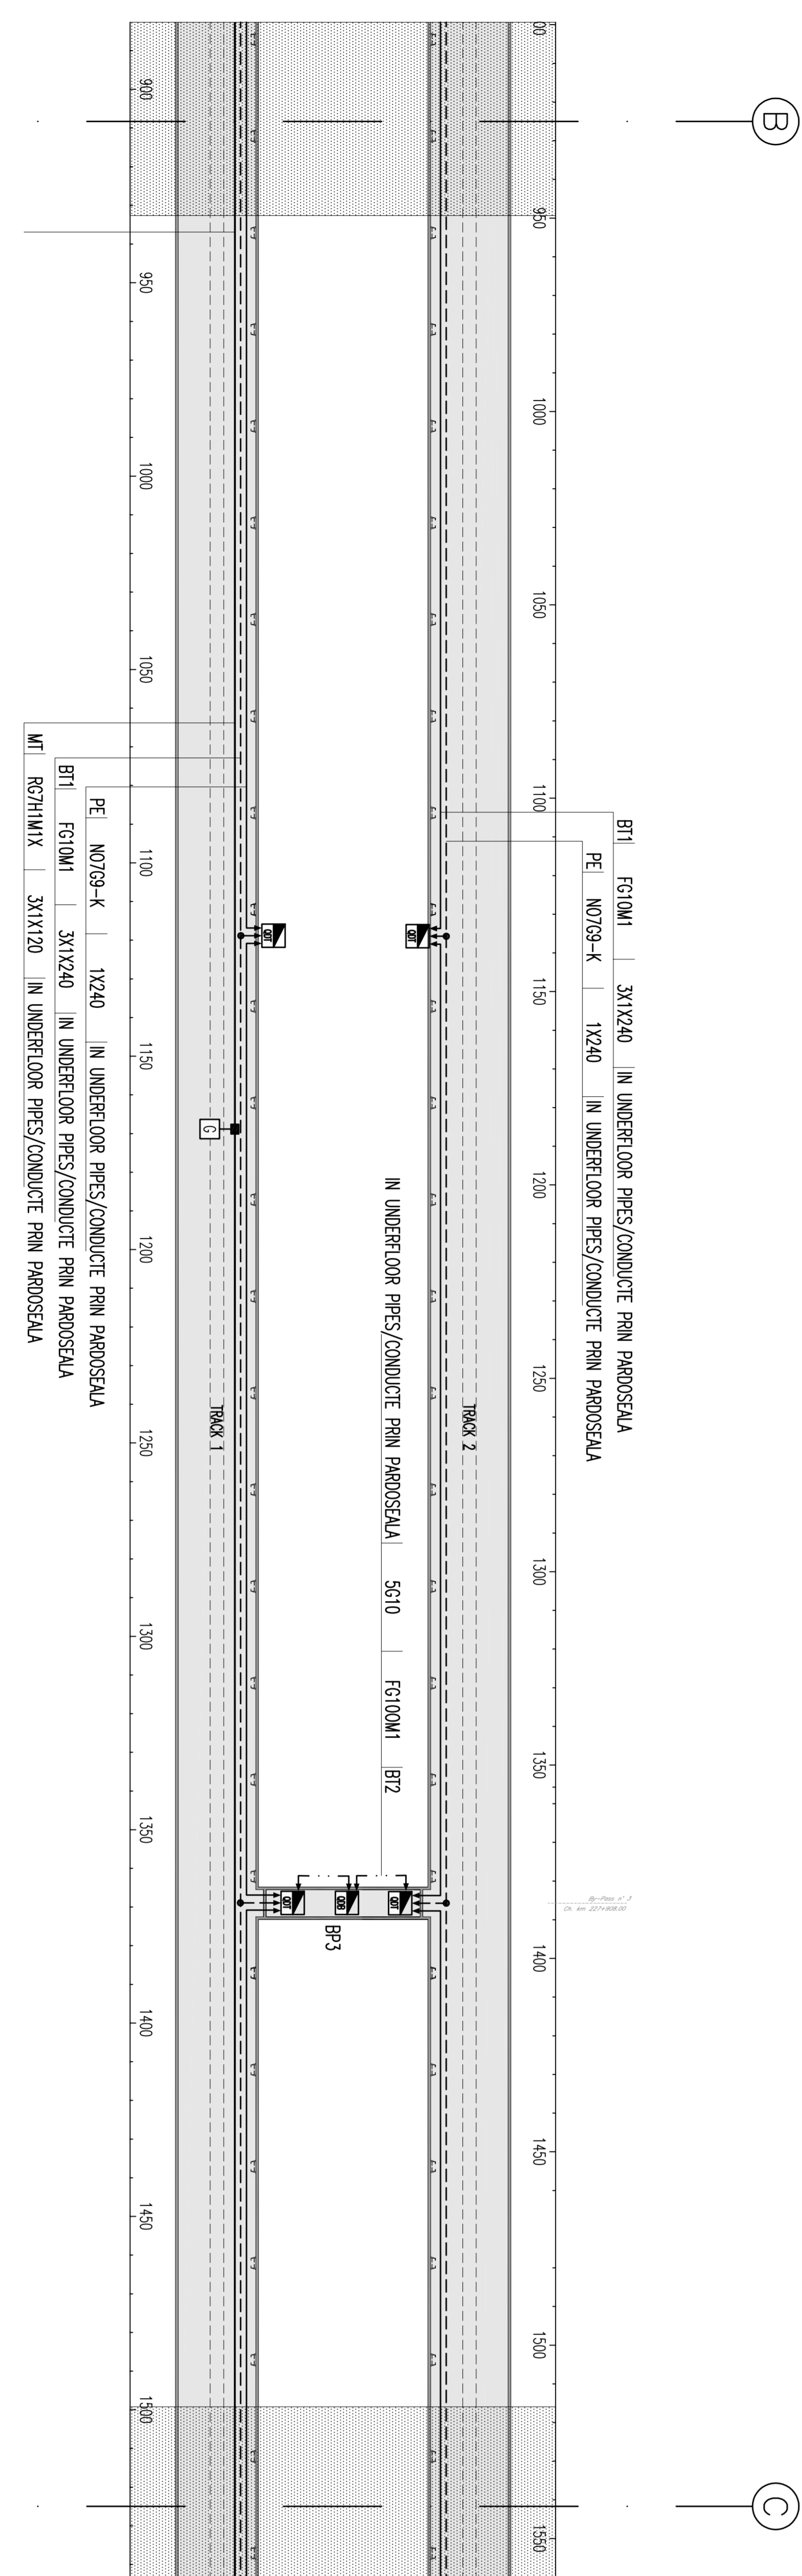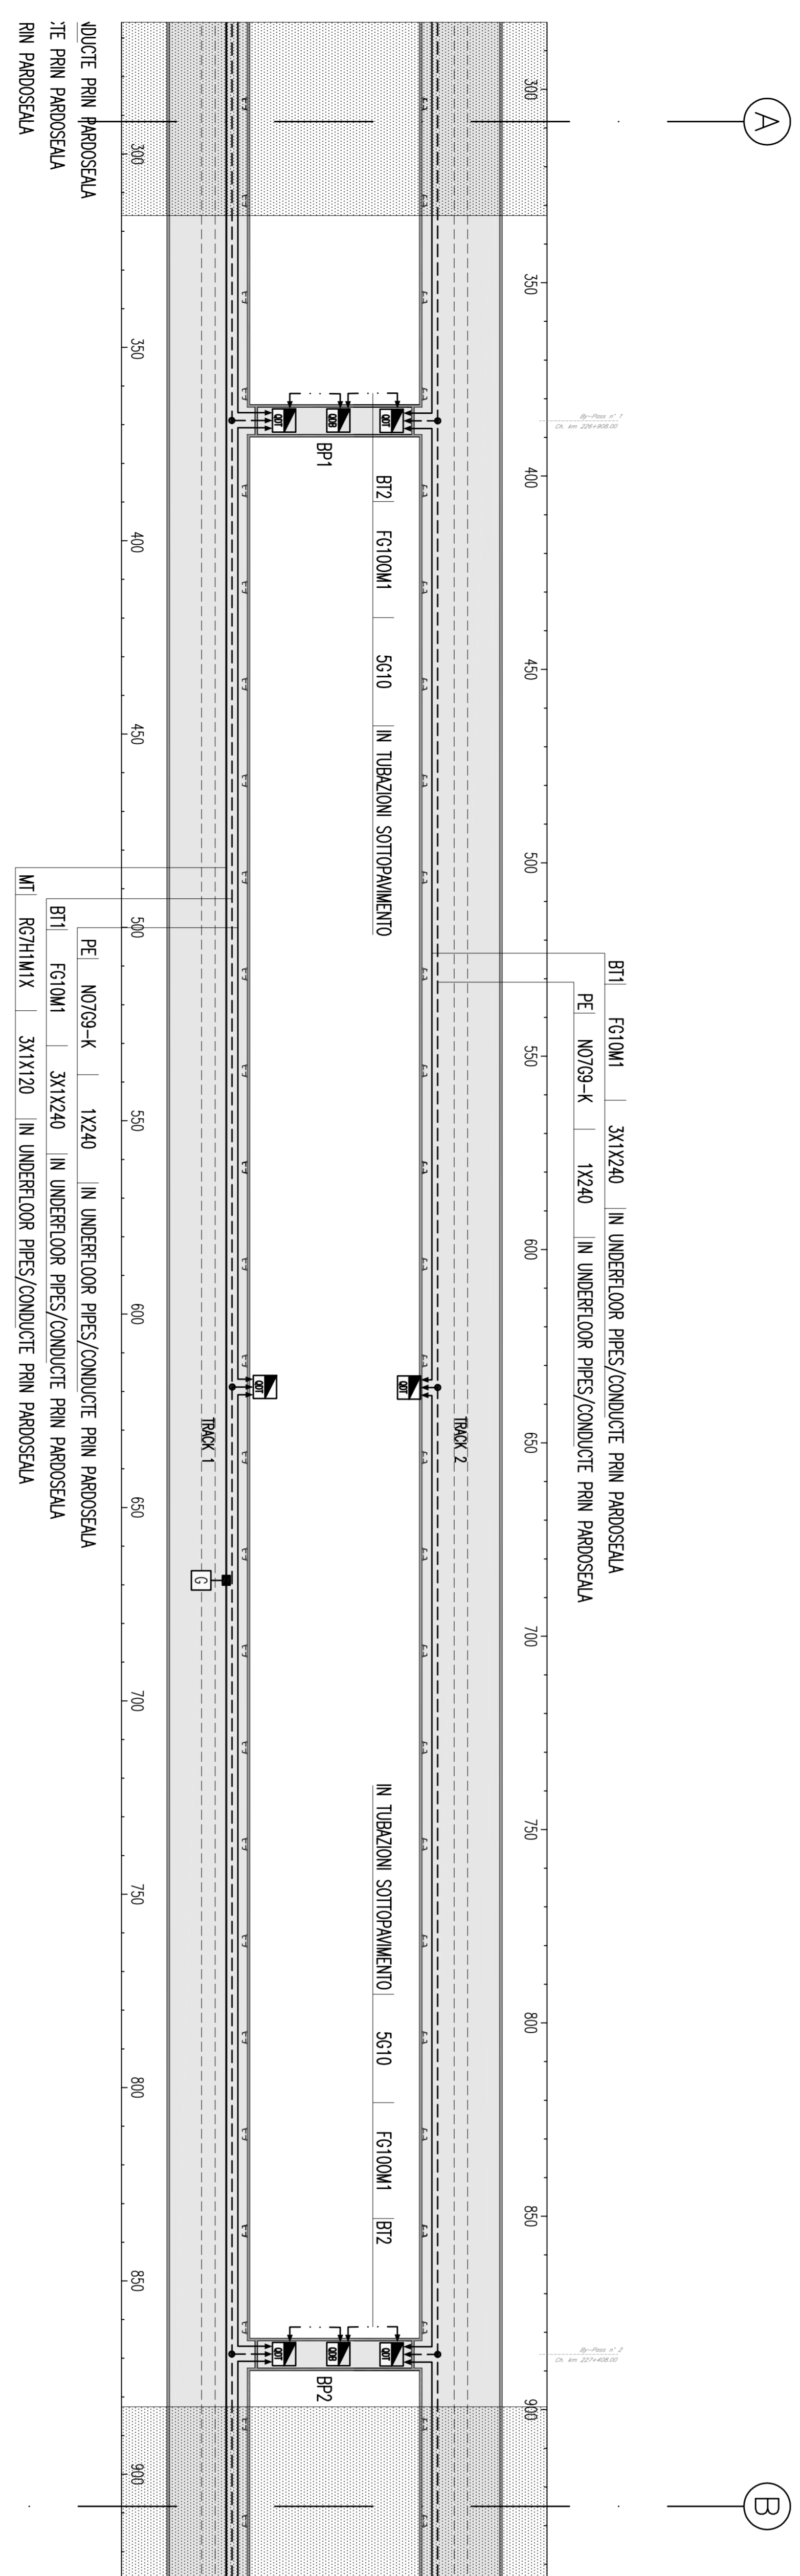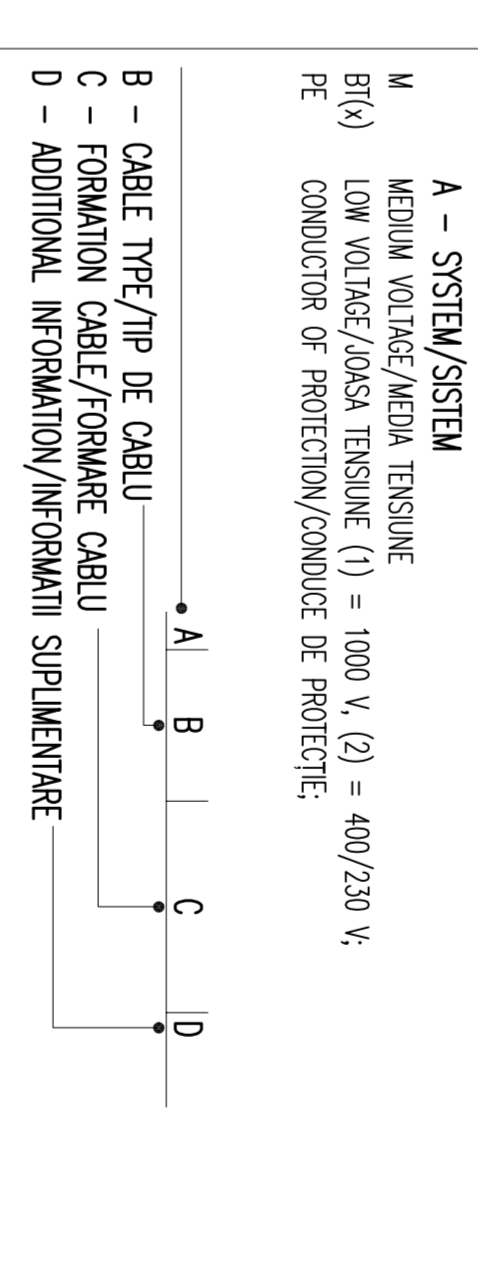

NOTE:
 - AREA SHOWN IN THE NEXT / PREVIOUS SHEET
 - ZONA PREZENTATA IN PACHEȚUL URMATOR / ANTERIORA

D									
C									
B									
A									

CLIENT / CLIENT
 C.N.C.F. "C.F.R." - S.A.

CONSULTANT / CONSULTANT
 R. LUZZO
 C. GAMBELLI
 P. ANTONIO

PROIECTANT / PROJECTANT
 C.N.C.F. "C.F.R." - S.A.

PROIECT/PROIECT
 2022/05 / 27/05/2022
 P.11.1 / T.1.

Scale / Scara
 1:07

Condition / Condiția Sistem
 Safety Tunnel Power Supply system (Sistem de alimentare cu siguranță a tunelului)
 Cable installation part (Partea sistemului de cablu de instalație)