
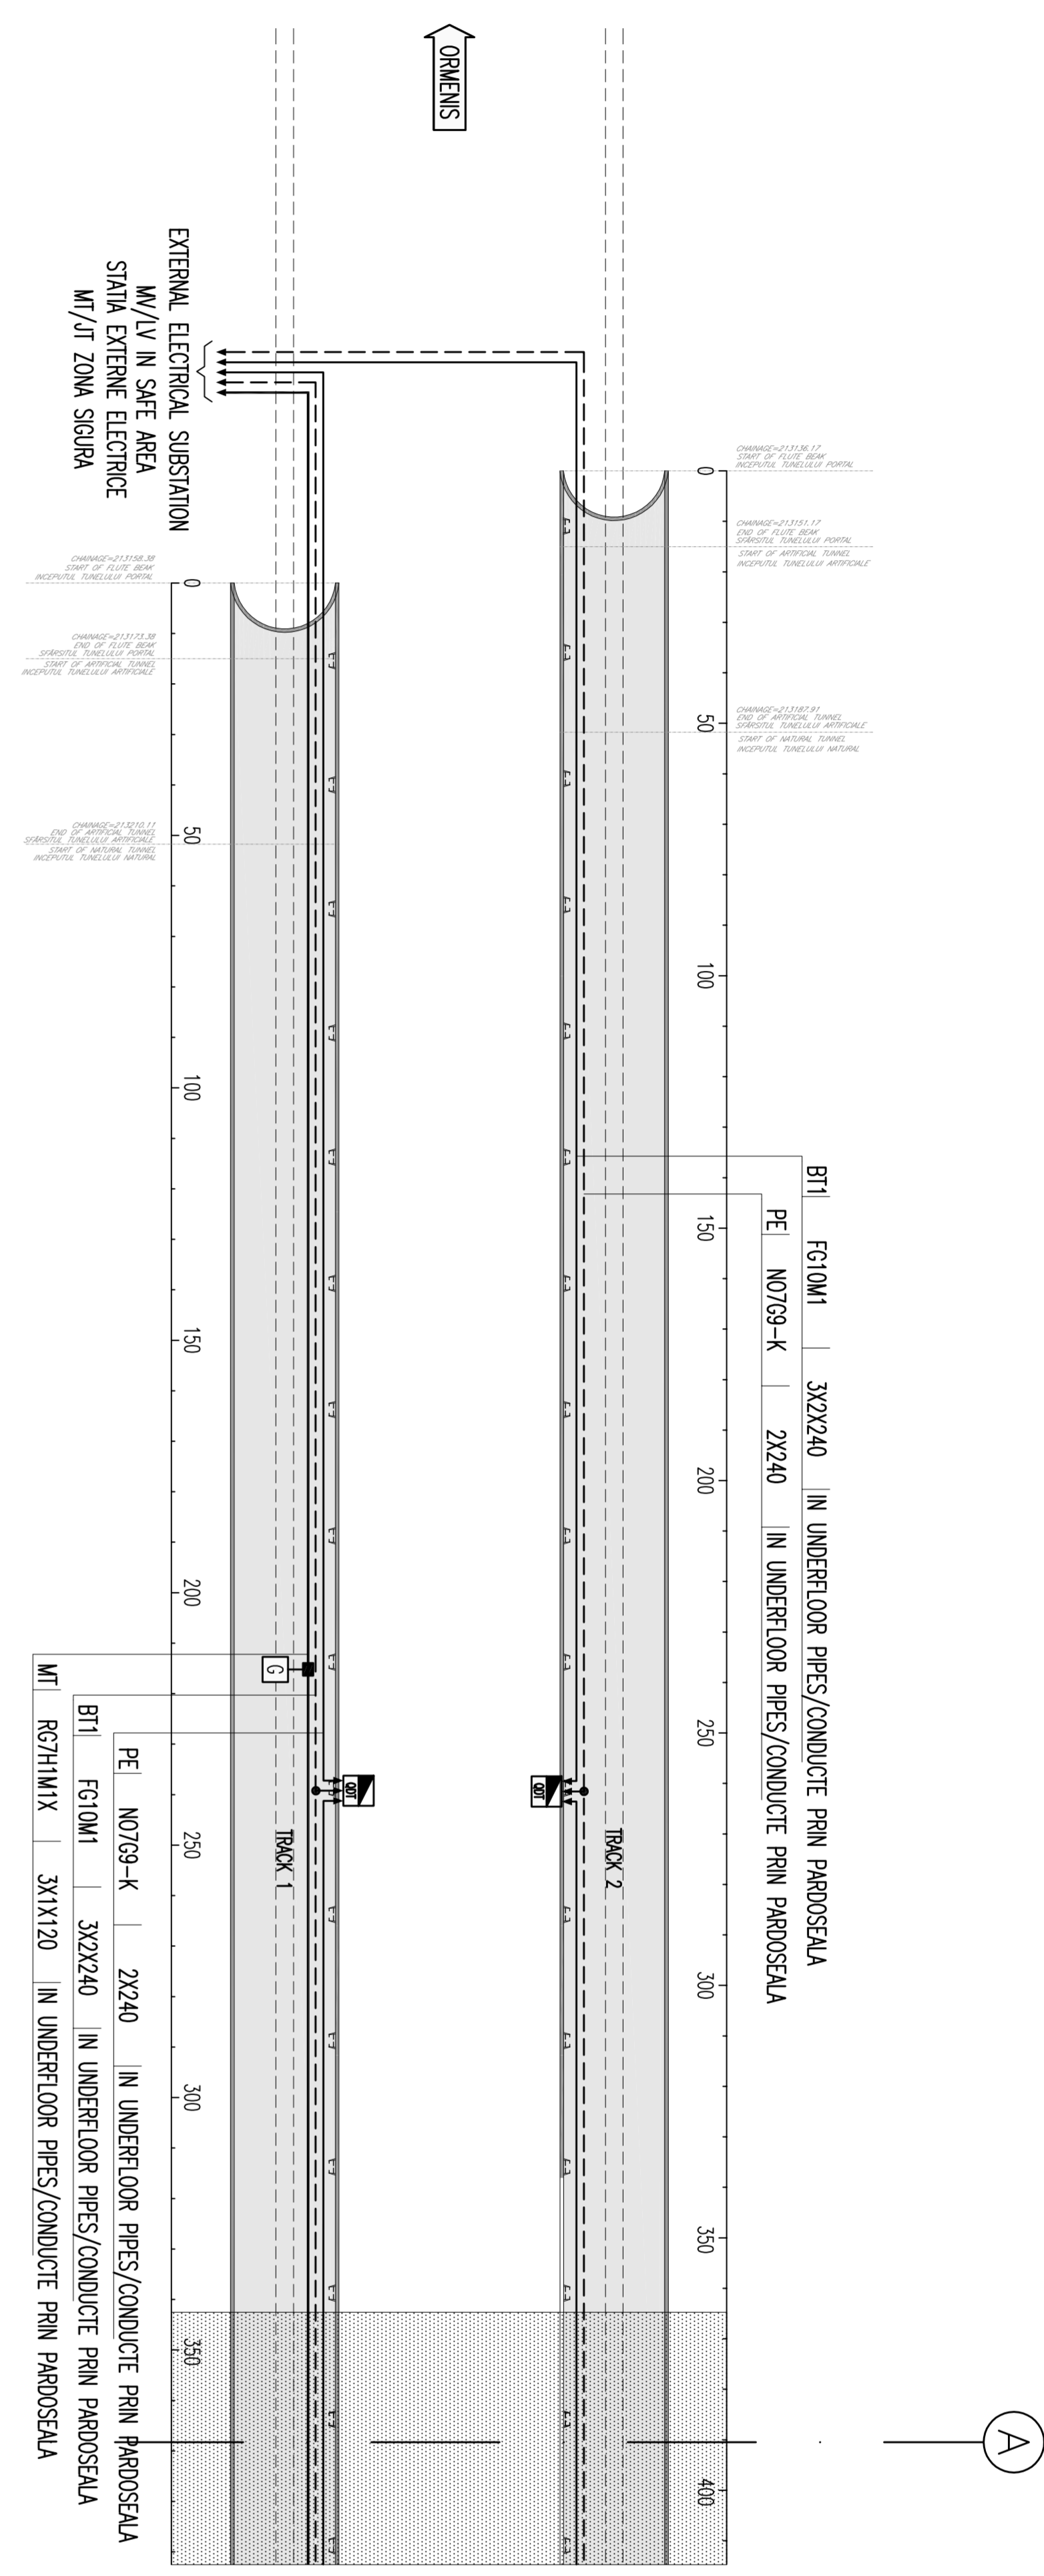


GENERAL PLAN / PLANUL GENERAL

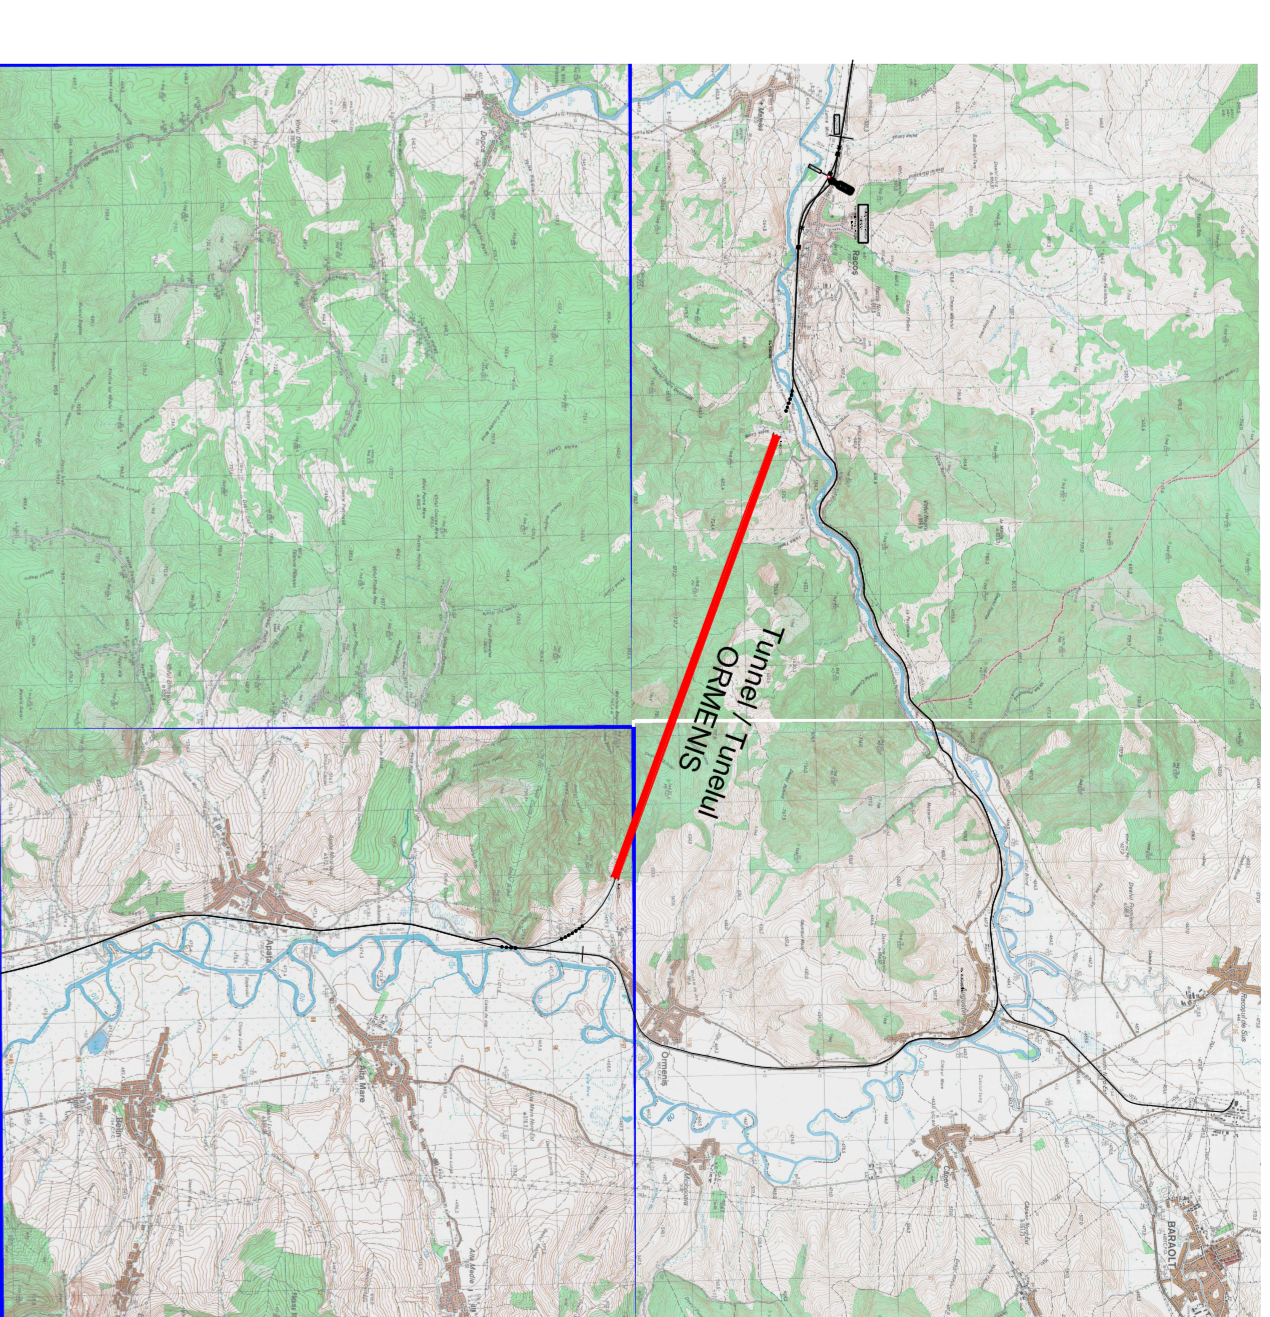



NETWORK LEGEND/LEGENDA RETEA

	LOW VOLTAGE NETWORK/RETEA DE JOASA TENSIUNE (BT1) 1000 V
	SECURITY LEAD NETWORK/RETEA DE JOASA TENSIUNE (BT2) 400/230 V
	MEDIUM VOLTAGE NETWORK/RETEA DE MARE TENSIUNE (MT) 20 kV

SYMBOLS LEGEND/LEGENDA SIMBOLURI

	ELECTRICAL PANEL/CAZANU ELECTRICE
	ELECTRICAL PANEL SECTION/CAZANU ELECTRICE SECTIONE
	ELECTRICAL PANEL BY-PASS/CAZANU ELECTRICE BY-PASS
	MARKER FOR JUNCTION CABLE/MARKER PENTRU JUNCTION CABLU

INDICATOR CABLE/INDICATOR CABLE

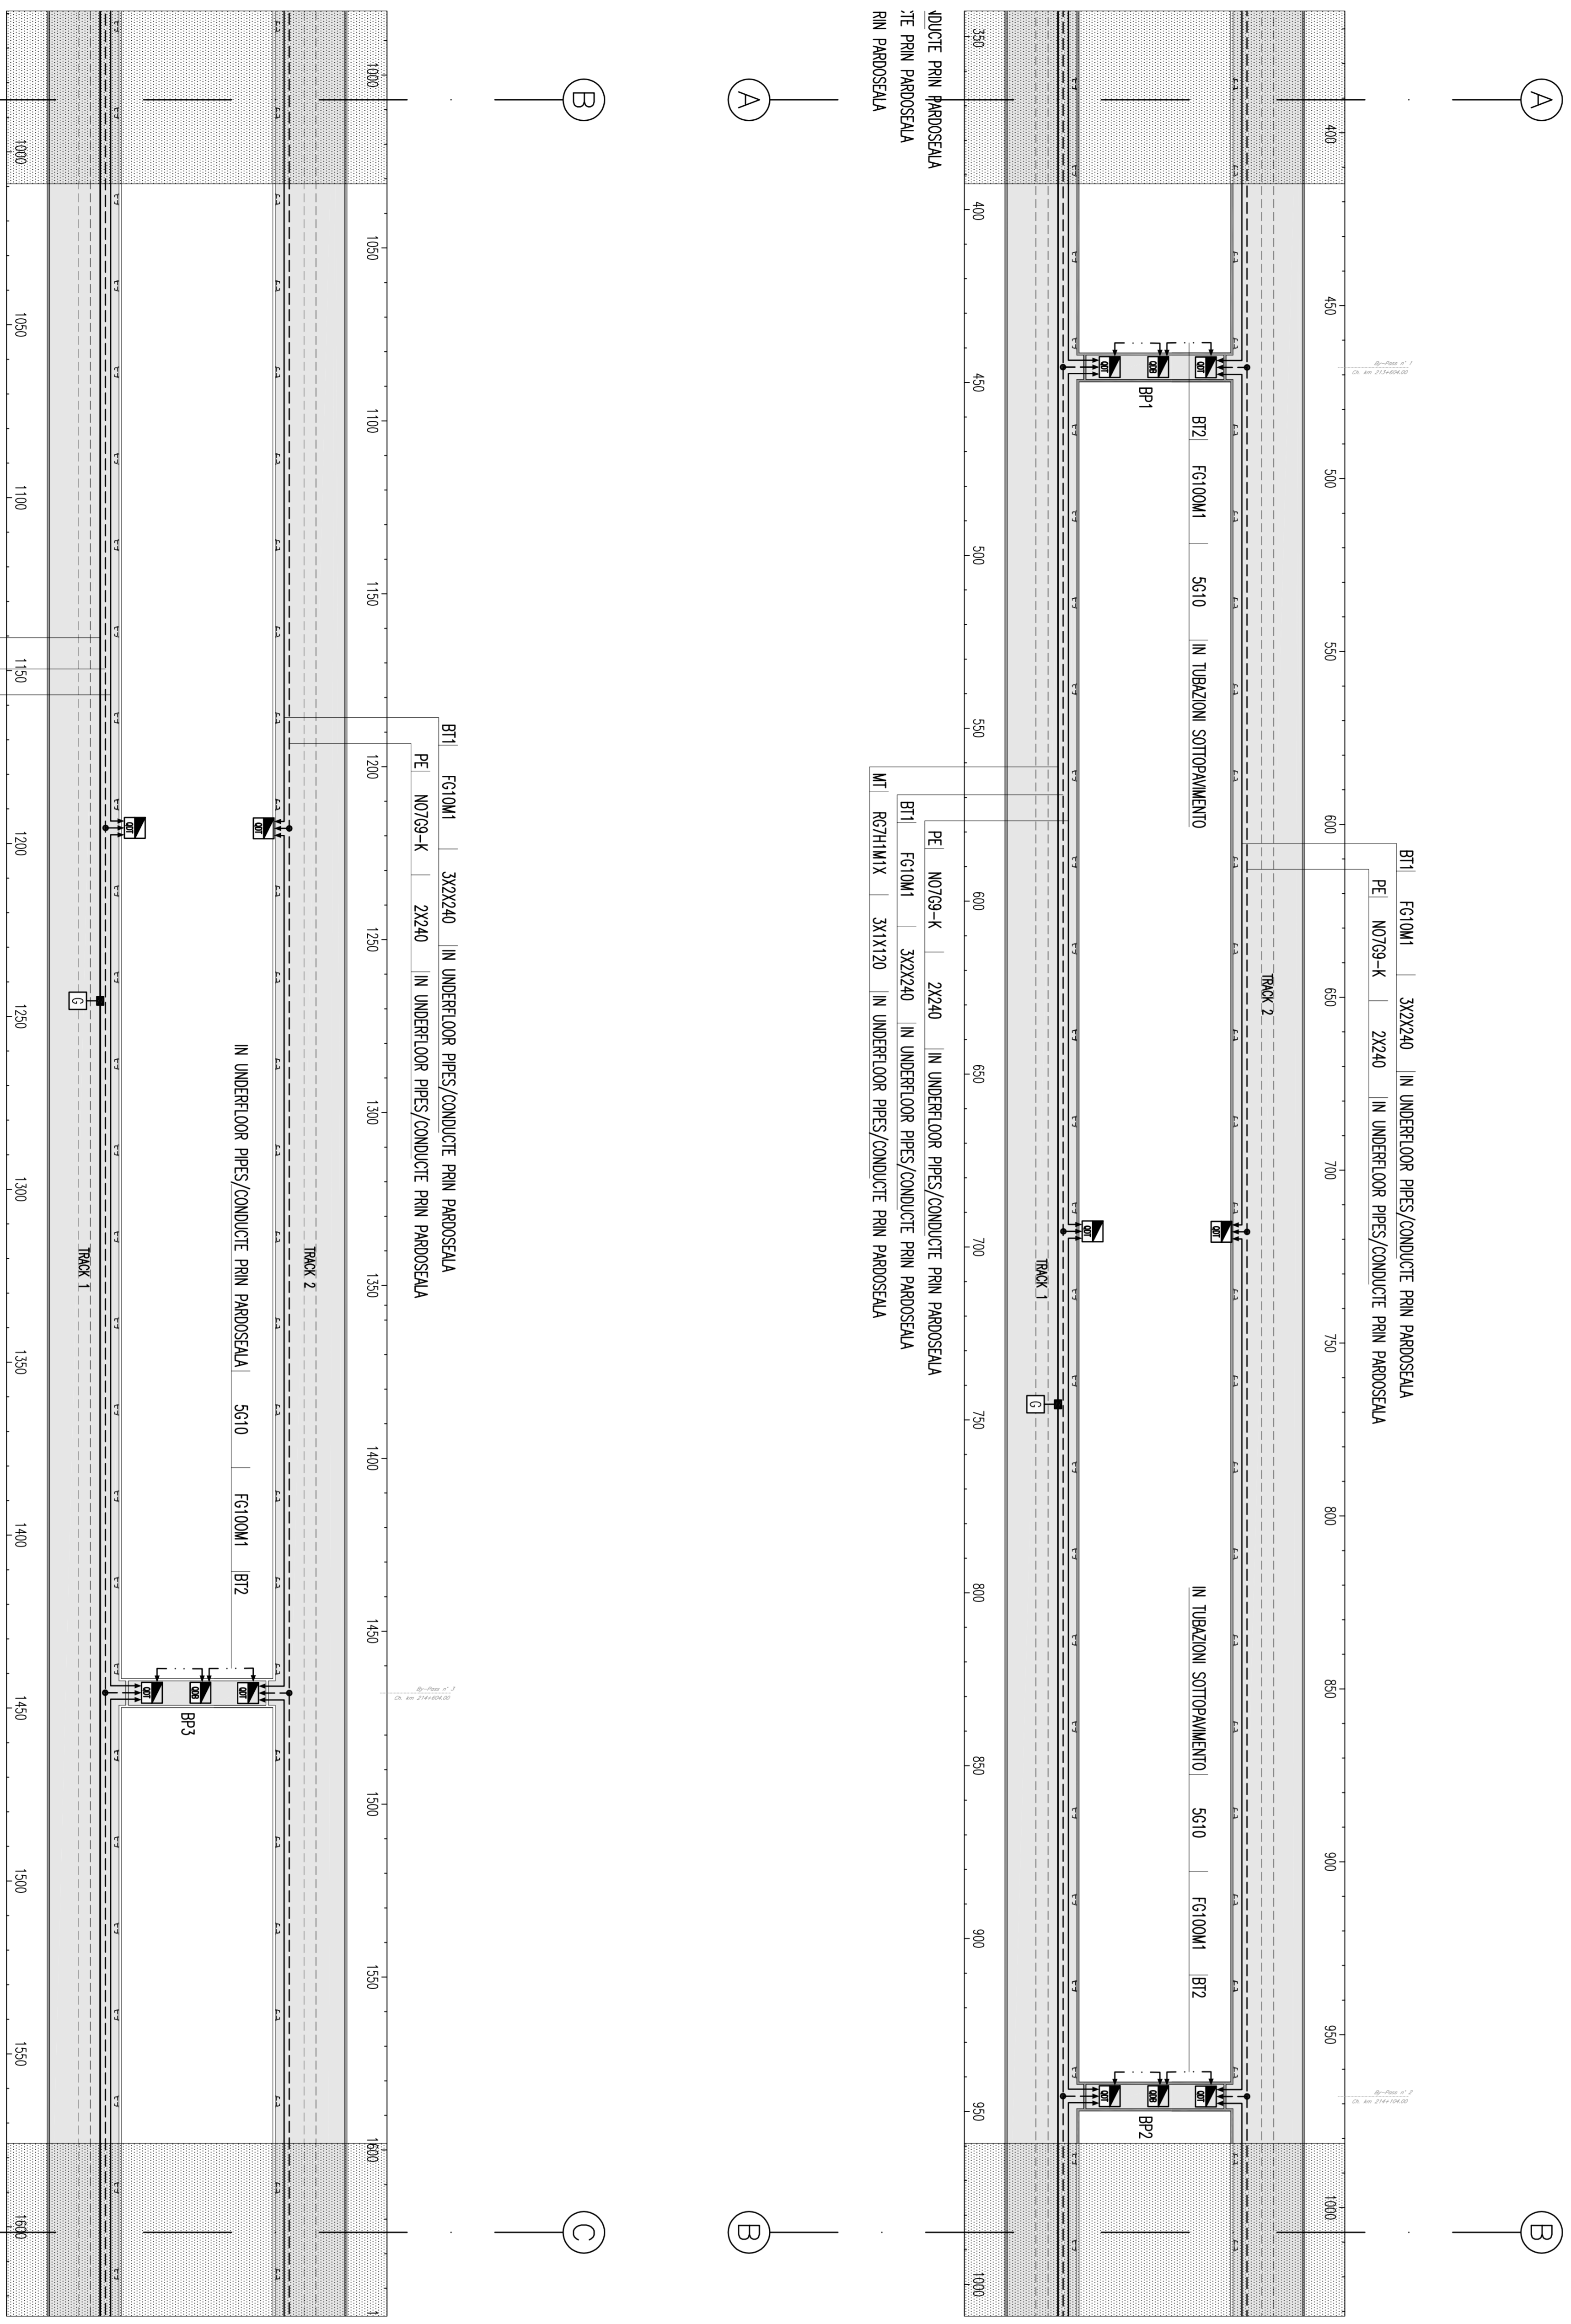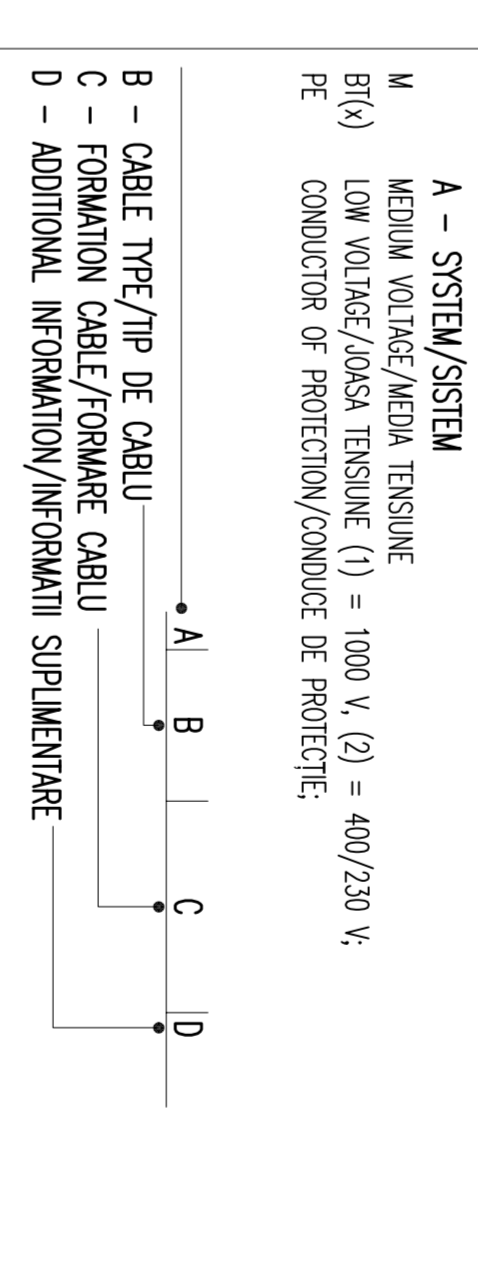

BT1 BT10M 3X2X240 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA
PE N0709-K 2X240 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA
BT1 BT10M 3X2X240 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA
MT R02HMIX 3X1X120 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA

BT1 BT10M 3X2X240 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA
PE N0709-K 2X240 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA
BT1 BT10M 3X2X240 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA
MT R02HMIX 3X1X120 IN UNDERLOOR PRES/CONDUCTE PRIN PAROISEALA

NOTE
 - AREA SHOWN IN THE NEXT / PREVIOUS SHEET
 - ZONA PREZENTATA IN PACHEITUL URMATOR / ANTERIORA

D									
C									
B									
A									

CLIENT / CLIENT
 CFR
 C.N.C.F. "C.F.R." - S.A.

CONSULTANT / CONSULTANT
 S&S
 OBERMEYER
 TECHN

GOVERNUL ROMANIEI
 ROMANIA GOVERNMENT
 PROIECT FINANAT DE UNIUNEA EUROPEANA
 SPANDE SI MANA IN CALDURA SI ENERGIE

PROIECT/PROIECT
 2022/2023/2024
 P.11.1, T.5.

Scale: 1:107

Condition / Condițiile Sistem