


LEGEND:

PC1	-Solder 230V/AC
Q1	-Separable Circuit Breaker with Sensitivity RCD 500 mA
Q1-PC1	-Circuit Breaker with sensitivity RCD 30mA
Q1-H1, Q1-R1	-CIRCUIT BREAKER
Q1	-Circuit Breaker with sensitivity RCD 300mA
Q1 TO Q11	
KXO	-Power Contactor 230V/AC, Type AC1
KC, KQ & KX1	-Relays 230V/AC
XBP-XA1 TO XA11	-Terminals block AC

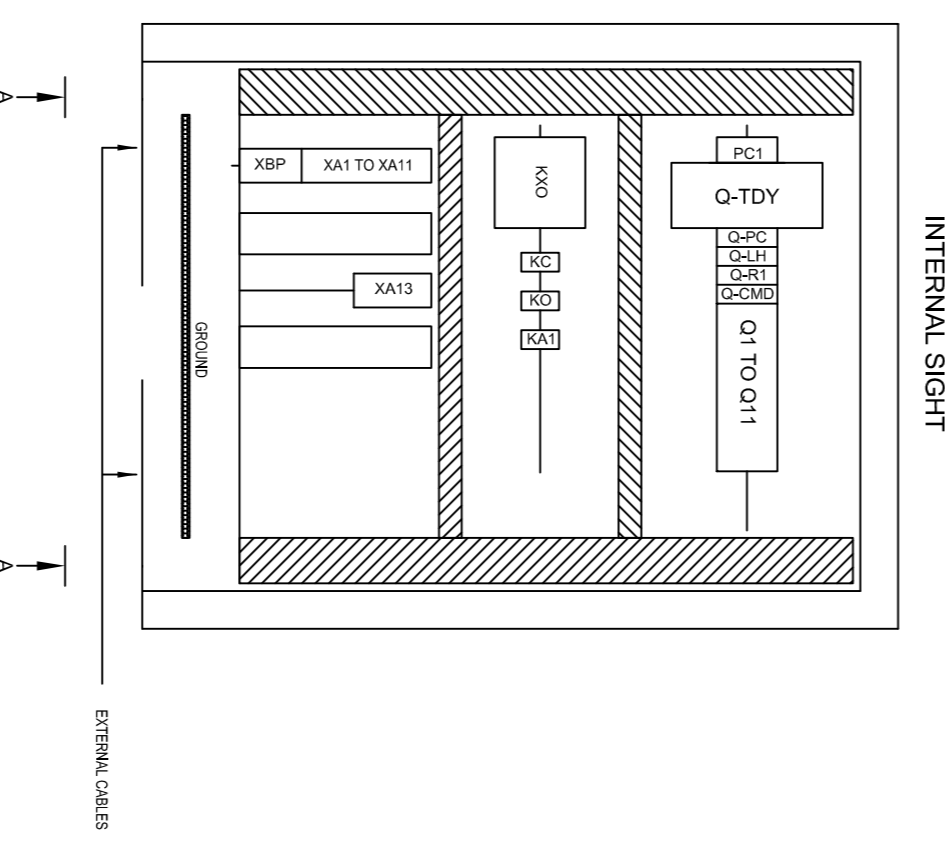

D					
C					
B					
A					
Index	Data	Modificare / Revision	Proiectant / Designer	Approbat Consultant / Approved Consultant	Approbat CFR / Approved CFR

GUVERNUL ROMANIEI / ROMANIAN GOVERNMENT
PROIECT FINANAT DE UNIUNEA EUROPEANA / EUROPEAN UNION FINANCED PROJECT

CLIENT / CLIENT

C.N.C.F. "C.F.R." - S.A.

CONSULTANT / CONSULTANT

Approbat / Approved	Șef proiect / Project manager	R. Luizza	Data / Date	11.2011	Semnatura / Signature
Verificat / Checked	Coordonator Secțiune 1 / Section 1 Coordinator	C. Gambailli	11.2011		
	Expert Verificator / Checking Expert	G. Bulfirni	11.2011		

SUBCONTRACTANT / SUBCONTRACTOR

Approbat / Approved	Responsabil Subcontractant / Subcontractor responsible	A. Stancu - Dinulescu	11.2011		
Verificat / Checked	Proiectant / Designer	M. Priporeanu	11.2011		

AmX CONSULTING ENGINEERS
 Redistribuirea liniei de cablu ferata Brasov - Sibieria, parte componentă a condorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h.
 Rehabilitation of the railway corridor for the train circulation with maximum speed of 160 km/h.
 Section : Brasov - Sibiușoara

Denumire desen / Drawing Title :

STATIA c1 VANATORI/VANATORI RAILWAY STATION
SCHEMA ELECTRICA A DULAPULUI TDY-cab Y
ELECTRICAL DIAGRAM FROM TDY PANEL-cab Y

Codificare / Codification System

E	A	S	1	0	1	E	1	7	D	X	E	G	0	0	2	5	0	0	8	1
---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---

Scara / Scale: _____
 LOT / LOT: _____
 Nr. / No: 02 / 02

(297X630)