
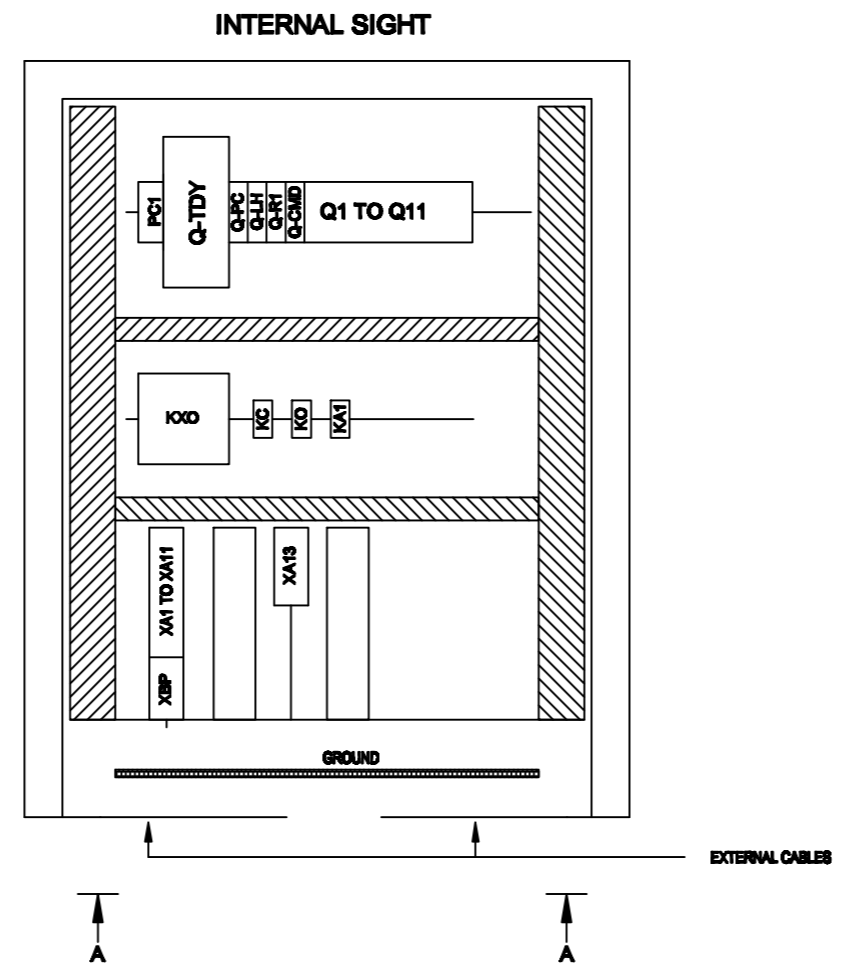


LEGEND:

PC1	-Socket 230VAC
Q1 TDX	-Withdrawable Circuit Breaker with Sensivity RCD 500 mA
Q-PC1	-Circuit Breaker with sensivity RCD 30mA
Q-LH, Q-R1	
Q-CMD	-Circuit Breaker with sensivity RCD 300mA
Q1 to Q11	
KXO	-Power Contractor 250A - Type AC1
KC, KO & KA1	-Relays 230VAC
XBP, XA1 TO XA11	-Terminals block AC

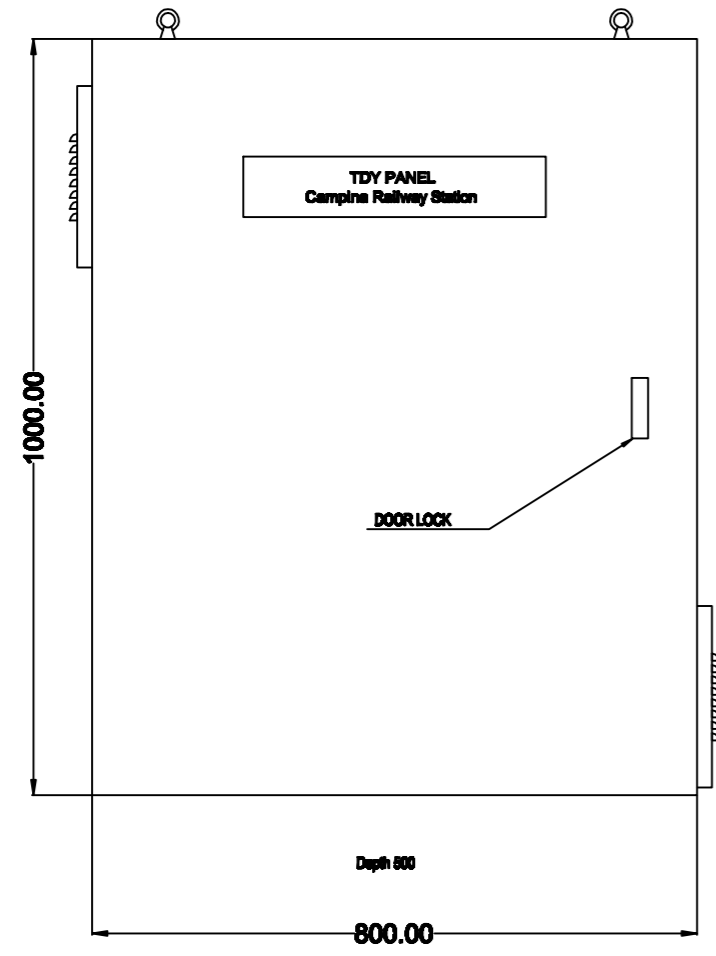

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR


ERNUL ROMANIEI
NIAN GOVERNMENT

PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ
EUROPEAN UNION FINANCED PROJECT




C.N.C.F. "C.F.R." - S.A.

CLIENT / CLIENT






CONSULTANT / CONSULTANT

			Data Date	Semnătură Signature
Aprobat Approved	Şef proiect Project manager	R. Liuzza	11.2011	<i>[Signature]</i>
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	C. Gambelli	11.2011	<i>[Signature]</i>
Verificat Checked	Expert Verificator Checking Expert	G. Buffarini	11.2011	<i>[Signature]</i>

SUBCONTRACTANT / SUBCONTRACTOR

			Data Date	Semnătură Signature
Aprobat Approved	Responsabil Subcontractant Subcontractor Responsible	A.Stanciu - Dinulescu	11.2011	<i>[Signature]</i>
Înlocuit Elaborated	Proiectant Designer	M. Priporeanu	11.2011	<i>[Signature]</i>

Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Braşov - Sighişoara
 Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Braşov - Sighişoara

Proiect/Project
 2004/RO/16/P/PA/003
Faza / Phase:
 P.Th. / T.D.

Denumire desen / Drawing Title :
STAȚIA c.f ALBEȘTI/ ALBEȘTI RAILWAY STATION
SCHEMA ELECTRICĂ A DULAPULUI TDY-cap Y
ELECTRICAL DIAGRAM FROM TDY PANEL-end Y

Codificare / Codification System	Scara / Scale +/-	LOT / LOT	Nr. / No 02 / 02
E A 5 1 0 1 E 1 9 D X E G 0 0 2 5 0 0 8 1			