


CUTIE ETANSA PENTRU COPERTINA C1 - SCHEMA MONOFILARA
C1 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

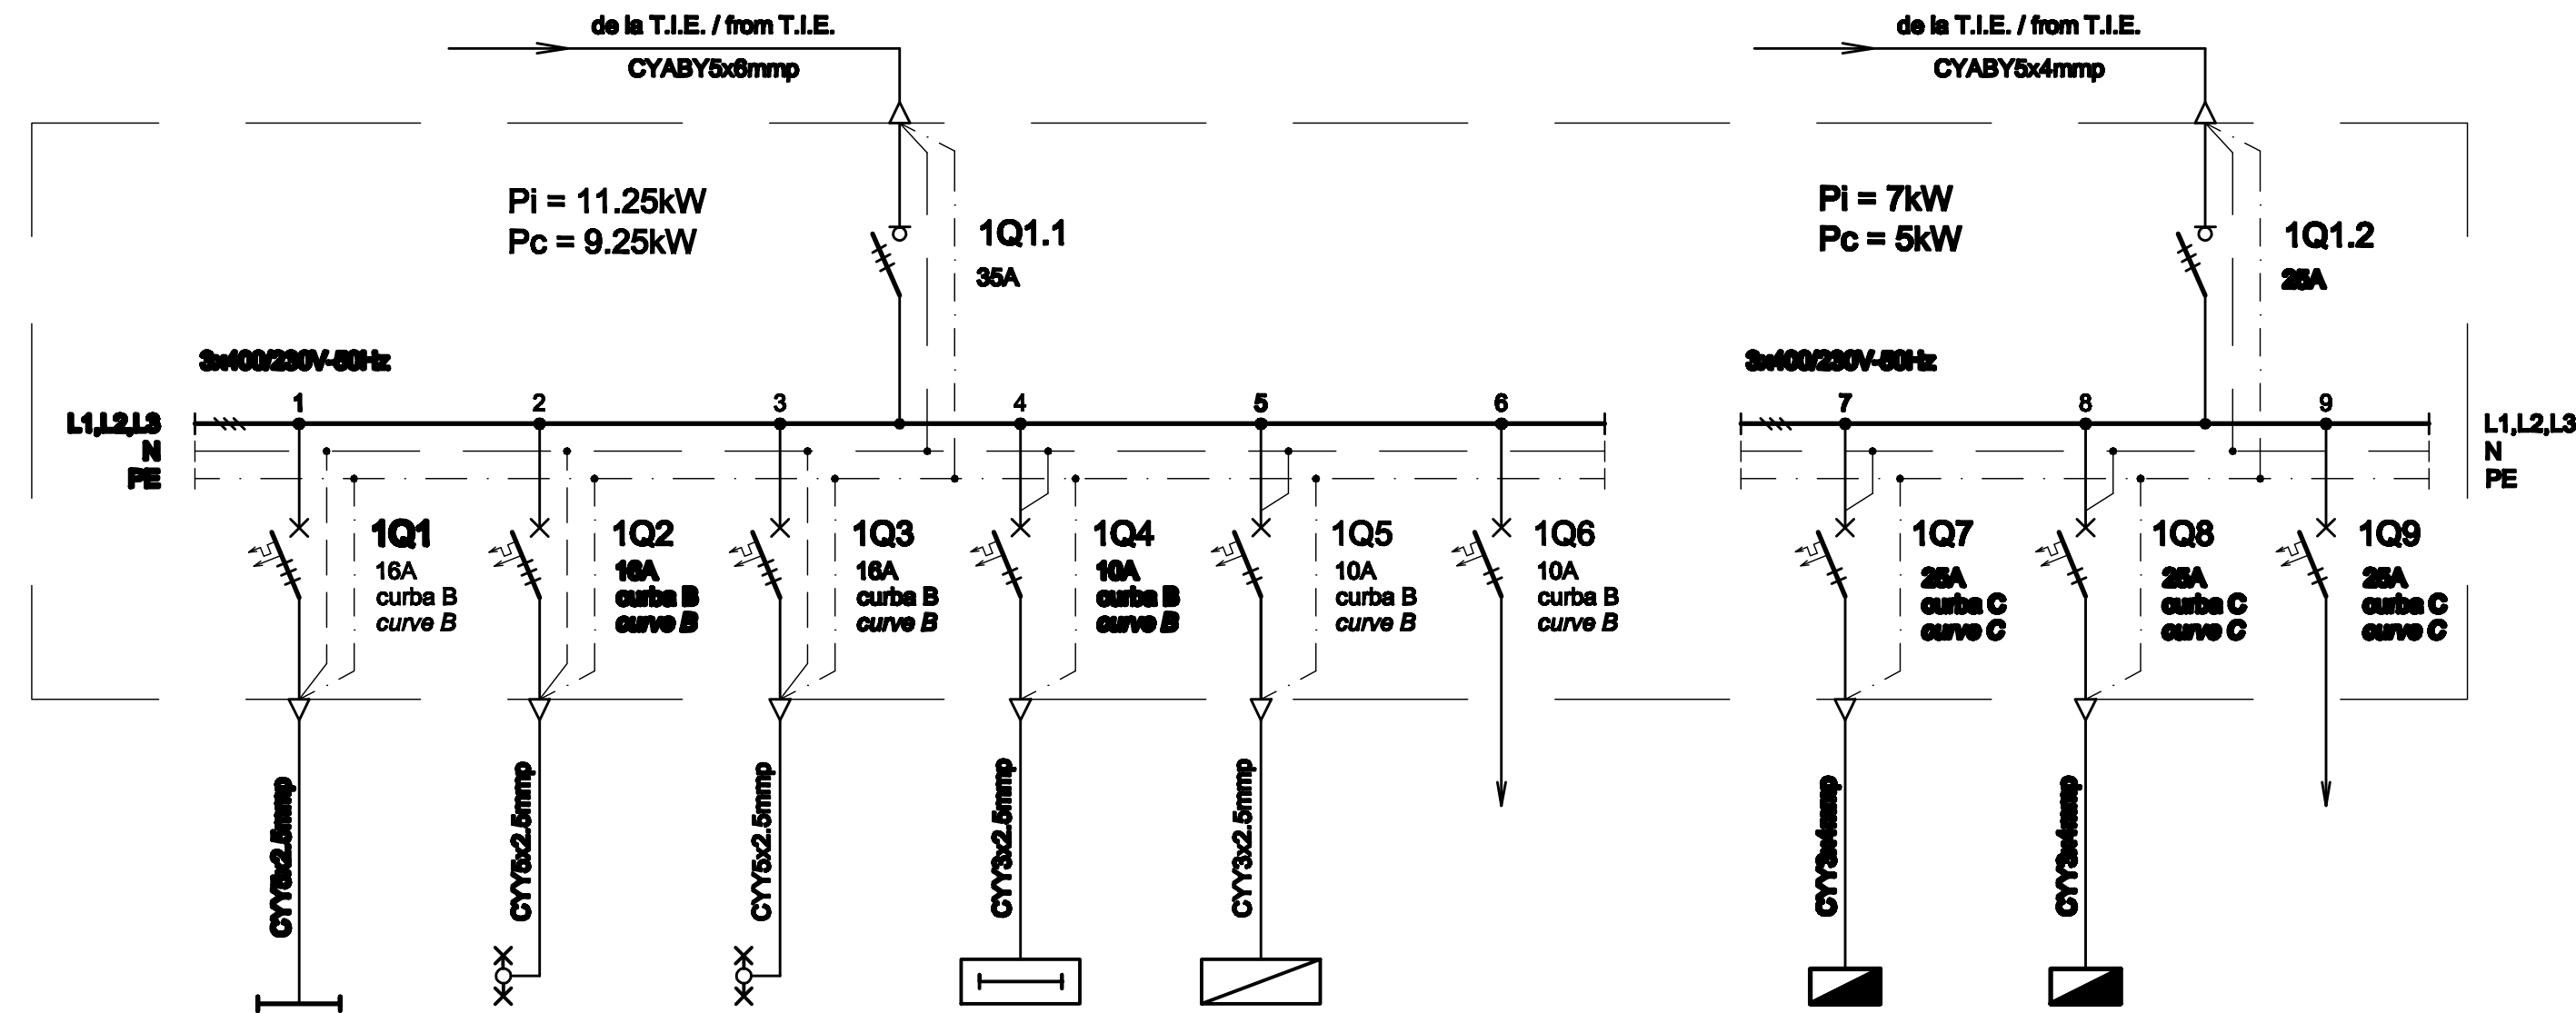

Nr. circuit Circuit number	1	2	3	4	5	6
Pi [kW]	4.55	2	1.5	1.2	1	1
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 8ILL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 8ILL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 6ILL / Lamps	PICTOGRAME - PERON PICTOGRAMS - PLATFORM 8Buc. / Pieces	PANOU PUBLICITAR LUMINOS ILLUMINATED BILLBOARD 2Buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

7	8	9
2.5	2.5	2
TABLOU CHIOSC EXISTENT EXISTING KIOSK BOARD	TABLOU CHIOSC EXISTENT EXISTING KIOSK BOARD	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

CUTIE ETANSA PENTRU COPERTINA C1 - SPECIFICATIE DE APARATAJ
C1 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Simbol Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos.	Observatii Remarks
1	1Q1.1	Separator de sarcina tripolar Three-poles switch-disconnector	In=35A Un=400V Uimp=8kV f=50Hz Icm=2.2kA	1	
2	1Q1.2	Separator de sarcina tripolar Three-poles switch-disconnector	In=25A Un=400V Uimp=8kV f=50Hz Icm=2.2kA	1	
3	1Q1,1Q2,1Q3	Intreupator automat tripolar, curba B Three-poles circuit breaker, curve B	In=16A Un=400V Icu=6kA f=50Hz	3	
4	1Q4,1Q5,1Q6	Intreupator automat bipolar, curba B Two-poles circuit breaker, curve B	In=10A Un=230V Icu=6kA f=50Hz	3	
5	1Q7,1Q8,1Q9	Intreupator automat bipolar, curba C Two-poles circuit breaker, curve C	In=25A Un=230V Icu=6kA f=50Hz	3	
6	-	Cutie / Box	IP54, Clasa I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR



CONSULTANT / CONSULTANT			Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	R. Liuzza	12.2011	<i>[Signature]</i>
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	C. Gambelli	12.2011	<i>[Signature]</i>
Verificat Checked	Expert Verificator Checking Expert	G. Fioravanti	12.2011	<i>[Signature]</i>

SUBCONTRACTANT / SUBCONTRACTOR				
Aprobat Approved	Responsabil Subconsultant Subconsultant Responsible	A.Stanciu - Dinulescu	12.2011	<i>[Signature]</i>
Intocmit Elaborated	Proiectant Designer	D. Matei	12.2011	<i>[Signature]</i>

Reabilitarea liniei de cale ferata Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h, Tronsonul : Brașov - Sighișoara
Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section : Brașov - Sighișoara

Proiect/Project
2004/RO/16/P/PA/003
Faza / Phase:
D.E. / E.D.

Denumire desen / Drawing Title :
**Cutie etanșă pentru copertină C1 - Stația Brașov;
Brașov station - C1 sealed box for canopy**

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1 0 1 E 0 1 B X I E 0 0 1 1 0 2 3 1			