


CUTIE ETANSA PENTRU COPERTINA C2 - SCHEMA MONOFILARA
C2 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

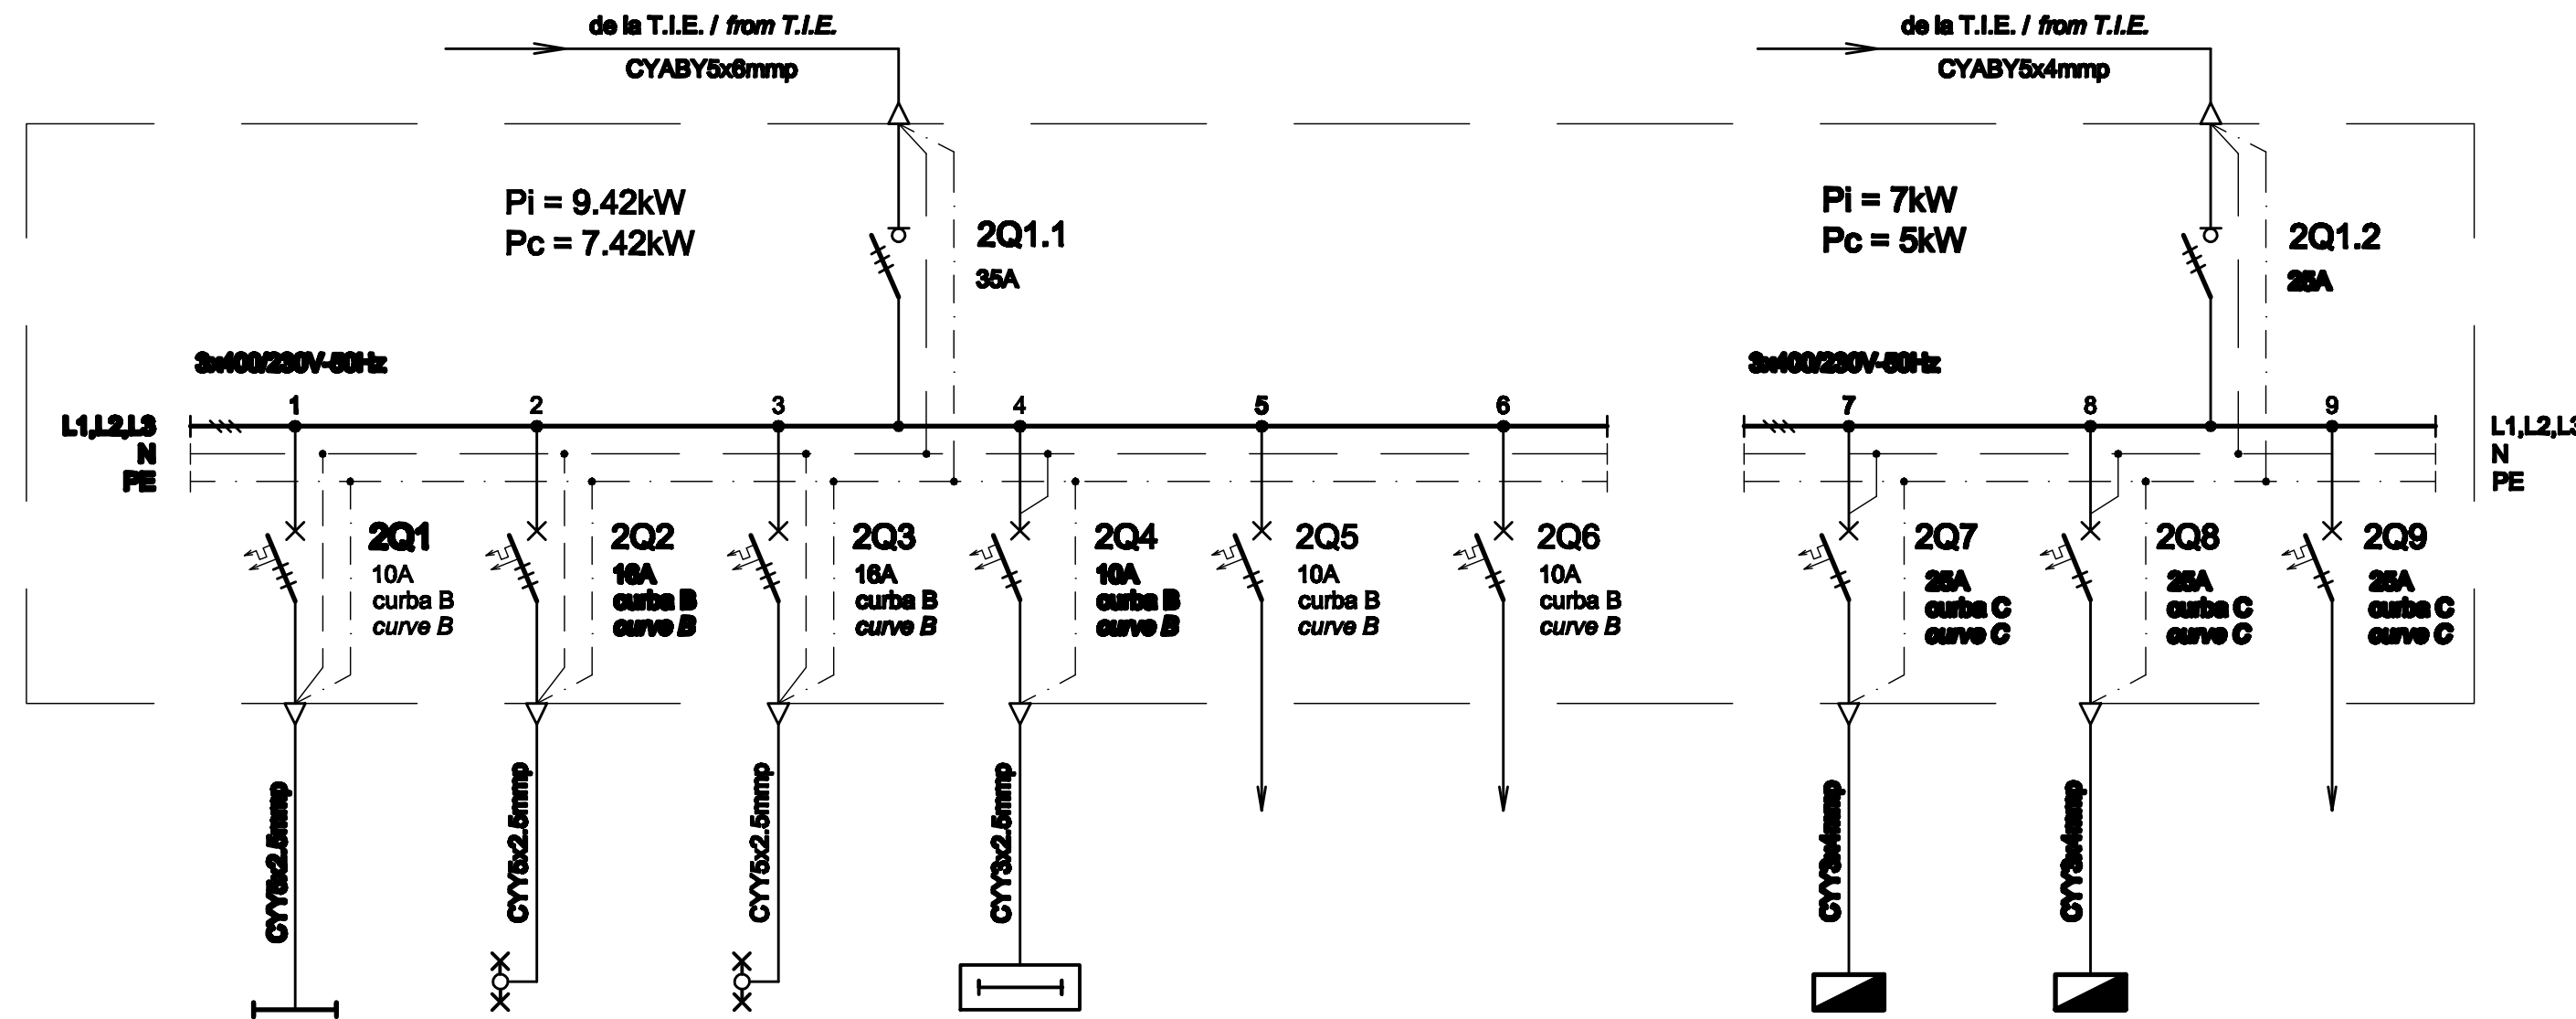



Nr. circuit Circuit number	1	2	3	4	5	6
Pi [kW]	2.22	2	2	1.2	1	1
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 44LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 8LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 8LL / Lamps	PICTOGRAME - PERON PICTOGRAMS - PLATFORM 8Buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

7	8	9
2.5	2.5	2
TABLOU CHIOSC EXISTENT EXISTING KIOSK BOARD	TABLOU CHIOSC EXISTENT EXISTING KIOSK BOARD	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

CUTIE ETANSA PENTRU COPERTINA C2 - SPECIFICATIE DE APARATAJ
C2 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Simbol Symbol	Denumirea aparaturii Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos.	Observatii Remarks
1	2Q1.1	Separator de sarcina tripolar Three-poles switch-disconnector	In=35A Un=400V Uimp=8kV f=50Hz Icm=2.2kA	1	
2	2Q1.2	Separator de sarcina tripolar Three-poles switch-disconnector	In=25A Un=400V Uimp=8kV f=50Hz Icm=2.2kA	1	
3	2Q1	Intreruptor automat tripolar, curba B Three-poles circuit breaker, curve B	In=10A Un=400V Icu=6kA f=50Hz	1	
4	2Q2,2Q3	Intreruptor automat tripolar, curba B Three-poles circuit breaker, curve B	In=16A Un=400V Icu=6kA f=50Hz	2	
5	2Q4,2Q5,2Q6	Intreruptor automat bipolar, curba B Two-poles circuit breaker, curve B	In=10A Un=250V Icu=6kA f=50Hz	3	
6	2Q7,2Q8,2Q9	Intreruptor automat bipolar, curba C Two-poles circuit breaker, curve C	In=25A Un=250V Icu=6kA f=50Hz	3	
7	-	Cutie / Box	IP54, Clasa I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR

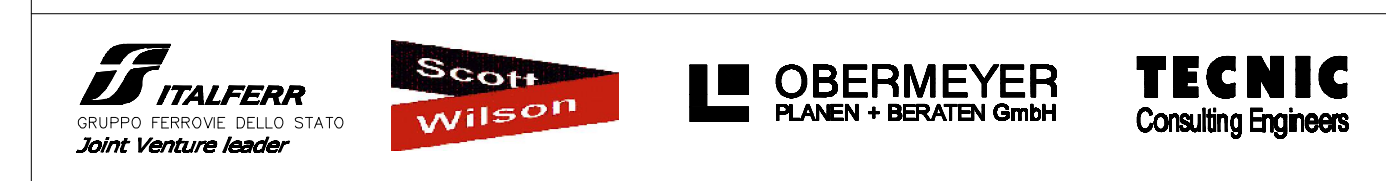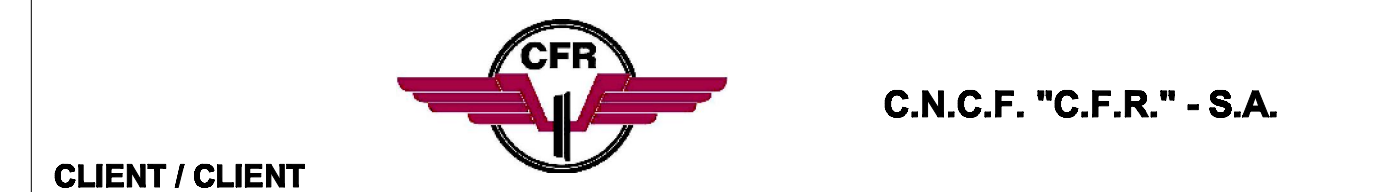

CONSULTANT / CONSULTANT			Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	R. Liuzza	12.2011	<i>[Signature]</i>
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	C. Gambelli	12.2011	<i>[Signature]</i>
Verificat Checked	Expert Verificator Checking Expert	G. Fioravanti	12.2011	<i>[Signature]</i>

SUBCONTRACTANT / SUBCONTRACTOR				
Aprobat Approved	Responsabil Subcontractant Subcontractant Responsible	A.Stanciu - Dinulescu	12.2011	<i>[Signature]</i>
Întocmit Elaborated	Proiectant Designer	D. Matei	12.2011	<i>[Signature]</i>

Reabilitarea liniei de cale ferata Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Brașov - Sighișoara
Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Brașov - Sighișoara

Denumire desen / Drawing Title :
**Cutie etanșă pentru copertină C2 - Stația Brașov;
Brașov station - C2 sealed box for canopy**

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1 0 1 E 0 1 B X I E 0 0 1 1 0 2 4 1			