


CUTIE ETANSA PENTRU COPERTINA C2 - SCHEMA MONOFILARA  
C2 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

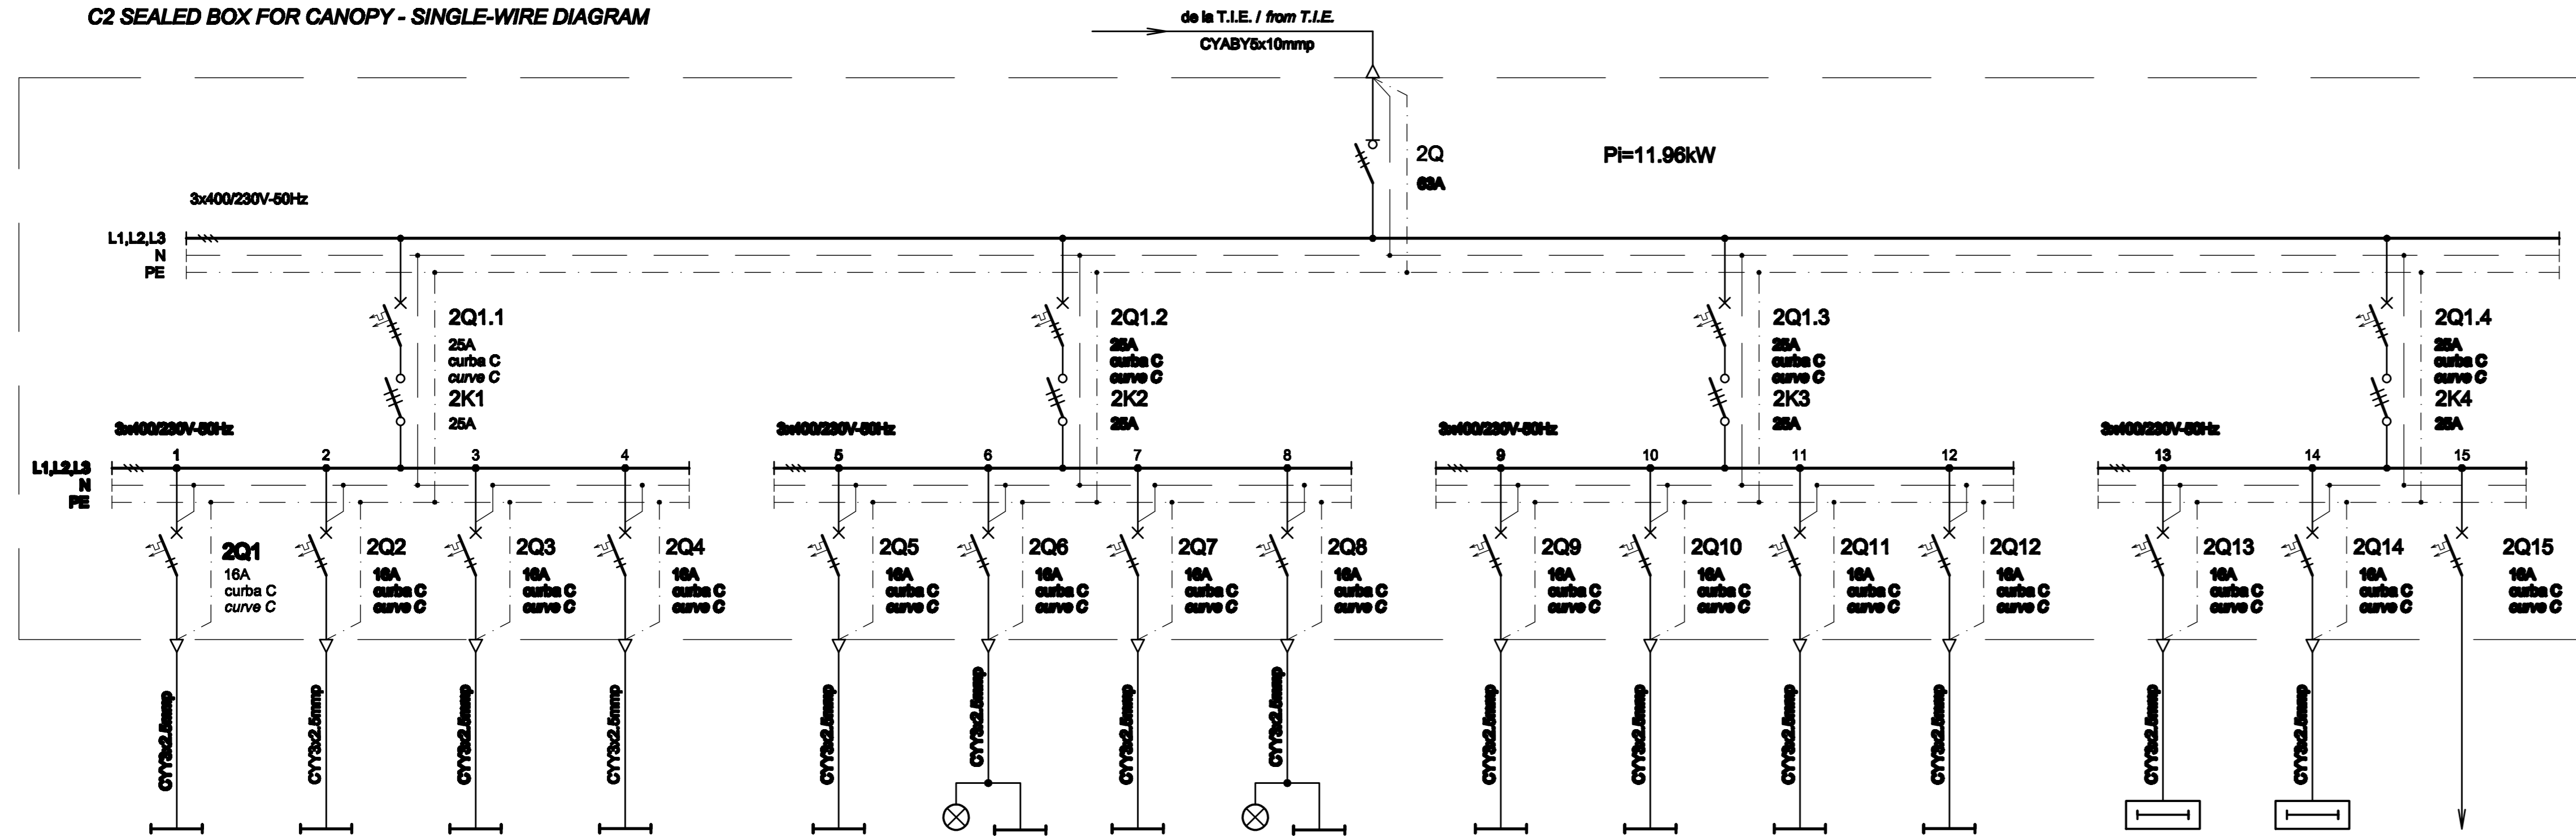

Nr. circuit Circuit number	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
PI [kW]	0.6	0.6	0.7	0.7	0.6	0.88	0.7	0.88	0.6	0.6	0.7	0.7	0.7	0.9	2
Destinația Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 16LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 18LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	PICTOGRAME - PERON PICTOGRAMS - PLATFORM 5buc. / Pieces	PICTOGRAME - PERON PICTOGRAMS - PLATFORM 7buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

CUTIE ETANSA PENTRU COPERTINA C2 - SPECIFICATIE DE APARATAJ  
C2 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos.	Observatii Remarks
0	1	2	3	4	5
1	2Q	Separator de sarcina tripolar Three-poles switch-disconnector	In=63A Un=400V Uimp=6kV f=50Hz Iom=2.2kA	1	
2	2Q1.1.....2Q1.4	Intreupator automat tripolar, curba C Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	2Q1.....2Q15	Intreupator automat bipolar, curba C Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	15	
4	2K1.....2K4	Contactator electromagnetic tripolar de curent alternativ / Three-poles electromagnetic a.c. contactor	In=25A Un=400A Uc=230V f=50Hz	4	
5	-	Cutie / Box	IP54, Class I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved CFR	Aprobat CFR Approved CFR



GUVERNUL ROMANIEI  
ROMANIAN GOVERNMENT

PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ  
EUROPEAN UNION FINANCED PROJECT

C.N.C.F. "C.F.R." - S.A.



Aprobat / Approved		Șef proiect / Project manager		R. Liuzza		Data / Date		Semnătură / Signature	
Aprobat / Approved		Coordonator Secțiune 1 / Section 1 Coordinator		C. Gambelli		12.2011			
Verificat / Checked		Expert Verificator / Checking Expert		G. Fioravanti		12.2011			

Aprobat / Approved		Responsabil Subcontractant / Subcontractant Responsible		A. Stanciu - Dinulescu		12.2011			
Elaborat / Elaborated		Proiectant / Designer		D. Matei		12.2011			

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,  
Tronsonul : Brașov - Sighișoara

Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,  
Section : Brașov - Sighișoara

Project/Project  
2004/RO/16/PPA/003

Faza / Phase:  
D.E. / E.D.

Denumire desen / Drawing Title :

**Cutie etanșă pentru copertină C2 - Stația Bod;  
Bod station - C2 sealed box for canopy**

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1	0 1	E 0 5 B X	I E 0 0 2 1
			0 5 2 1