


TABLOU ELECTRIC APARTAMENT T Ap. - SCHEMA MONOFILARA
APARTMENT ELECTRIC BOARD T Ap. - SINGLE-WIRE DIAGRAM

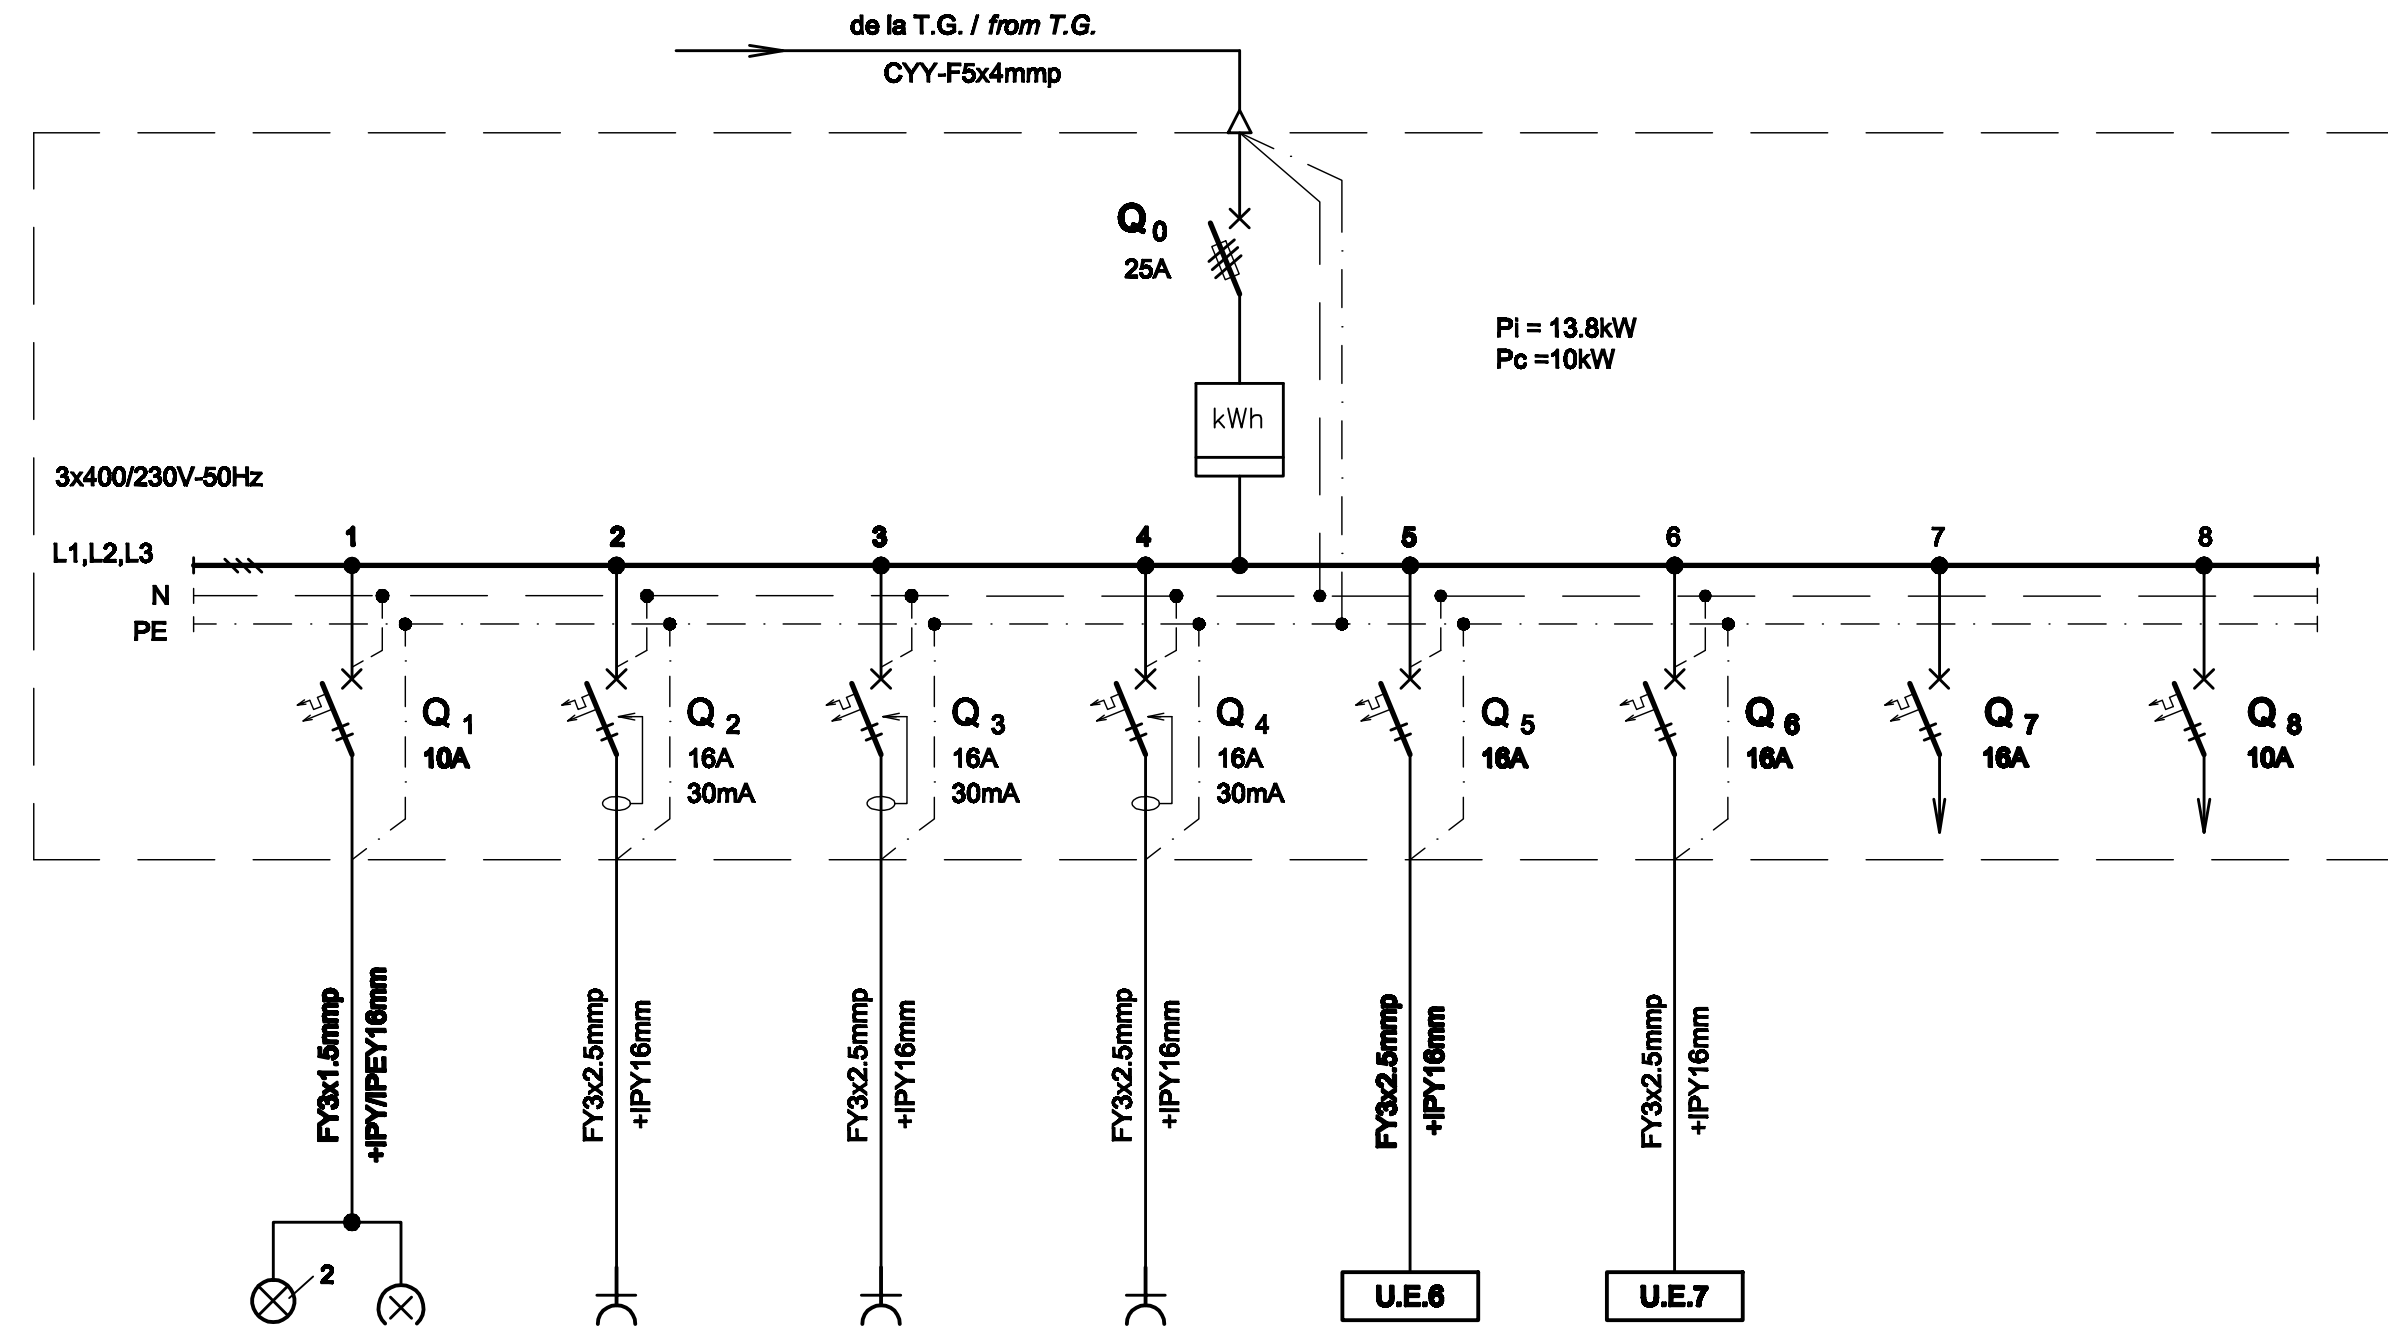

Nr. circuit Circuit number	1	2	3	4	5	6	7	8
Pi [kW]	0.8	2	2	2	2	2	2	1
Destinația Destination	BUCATARIE, CAMERA DE ZI, HOL, GRUP SANITAR, DORMITOR KITCHEN, LIVING ROOM, HALL, SANITARY GROUP, BEDROOM 8LL / Lamps	BUCATARIE KITCHEN 3LP / Sockets outlet	HOL HALL 1LP / Sockets outlet	CAMERA DE ZI, DORMITOR LIVING ROOM, BEDROOM 6LP / Sockets outlet	UNITATE EXTERIOARA DE CLIMATIZARE SISTEM MONOSPLIT OUTDOOR UNIT AIR CONDITIONING SYSTEM MONOSPLIT 1Bus. / Place	UNITATE EXTERIOARA DE CLIMATIZARE SISTEM MONOSPLIT OUTDOOR UNIT AIR CONDITIONING SYSTEM MONOSPLIT 1Bus. / Place	REZERVA MONOFAZATA SINGLE-PHASE RESERVE	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

TABLOU ELECTRIC APARTAMENT T Ap. - SPECIFICATIE DE APARATAJ
T Ap. APARTMENT ELECTRIC BOARD - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pcs.	Observatii Remarks
0	1	2	3	4	5
1	Q0	Separator de sarcina tripolar cu fuzibil / Three-poles switch-disconnectors with fusible	In=25A Un=400V Uimp=8kV f=50Hz Icm=2,2kA	1	
2	Q1,Q8	Intrerupator automat bipolar, curba B Two-poles circuit breaker, curve B	In=10A Un=230V Icu=6kA f=50Hz	2	
3	Q2,Q3,Q4	Intrerupator automat bipolar cu protectie la curent diferential rezidual, curba C / Two-poles circuit breaker with protection at residual differential current device, curve C	In=16A Un=230V Icu=6kA f=50Hz IΔn=0,03A Tip A Nivel de imunitate 250A la forma de unda 8/20 μS Level of immunity 250A to wave form 8/20 μS	3	
4	Q5,Q6,Q7	Intrerupator automat bipolar, curba C Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	3	
5	-	Contor trifazat de energie active Three-phase active energy counter	In=25A Un=400V Clasa I / Class I f=50Hz	1	
6	-	Cutie / Box	IP30, Clasa I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR



CONSULTANT / CONSULTANT			Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	R. Liuzza	12.2011	<i>[Signature]</i>
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	C. Gambelli	12.2011	<i>[Signature]</i>
Verificat Checked	Expert Verificator Checking Expert	G. Fioravanti	12.2011	<i>[Signature]</i>

SUBCONTRACTANT / SUBCONTRACTOR			Data Date	Semnătură Signature
Aprobat Approved	Responsabil Subconsultant Subconsultant Responsible	A.Stanciu - Dinulescu	12.2011	<i>[Signature]</i>
Întocmit Elaborated	Proiectant Designer	D. Matei	12.2011	<i>[Signature]</i>

Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteza maximă de 160 km/h,
Tronsonul : Braşov - Sighişoara
 Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Braşov - Sighişoara

Project/Project
 2004/RO/16/P/PA/003
Faza / Phase:
 D.E. / E.D.

Denumire desen / Drawing Title :
**Tablou electric apartament T Ap. - Stația Feldioara;
 Feldioara station - T Ap. apartment electric board**

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1	0 1	E 0 7 B X I E 0 0 3 1	0 4 8 1