


CUTIE ETANSA PENTRU COPERTINA C2 - SCHEMA MONOFILARA  
C2 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

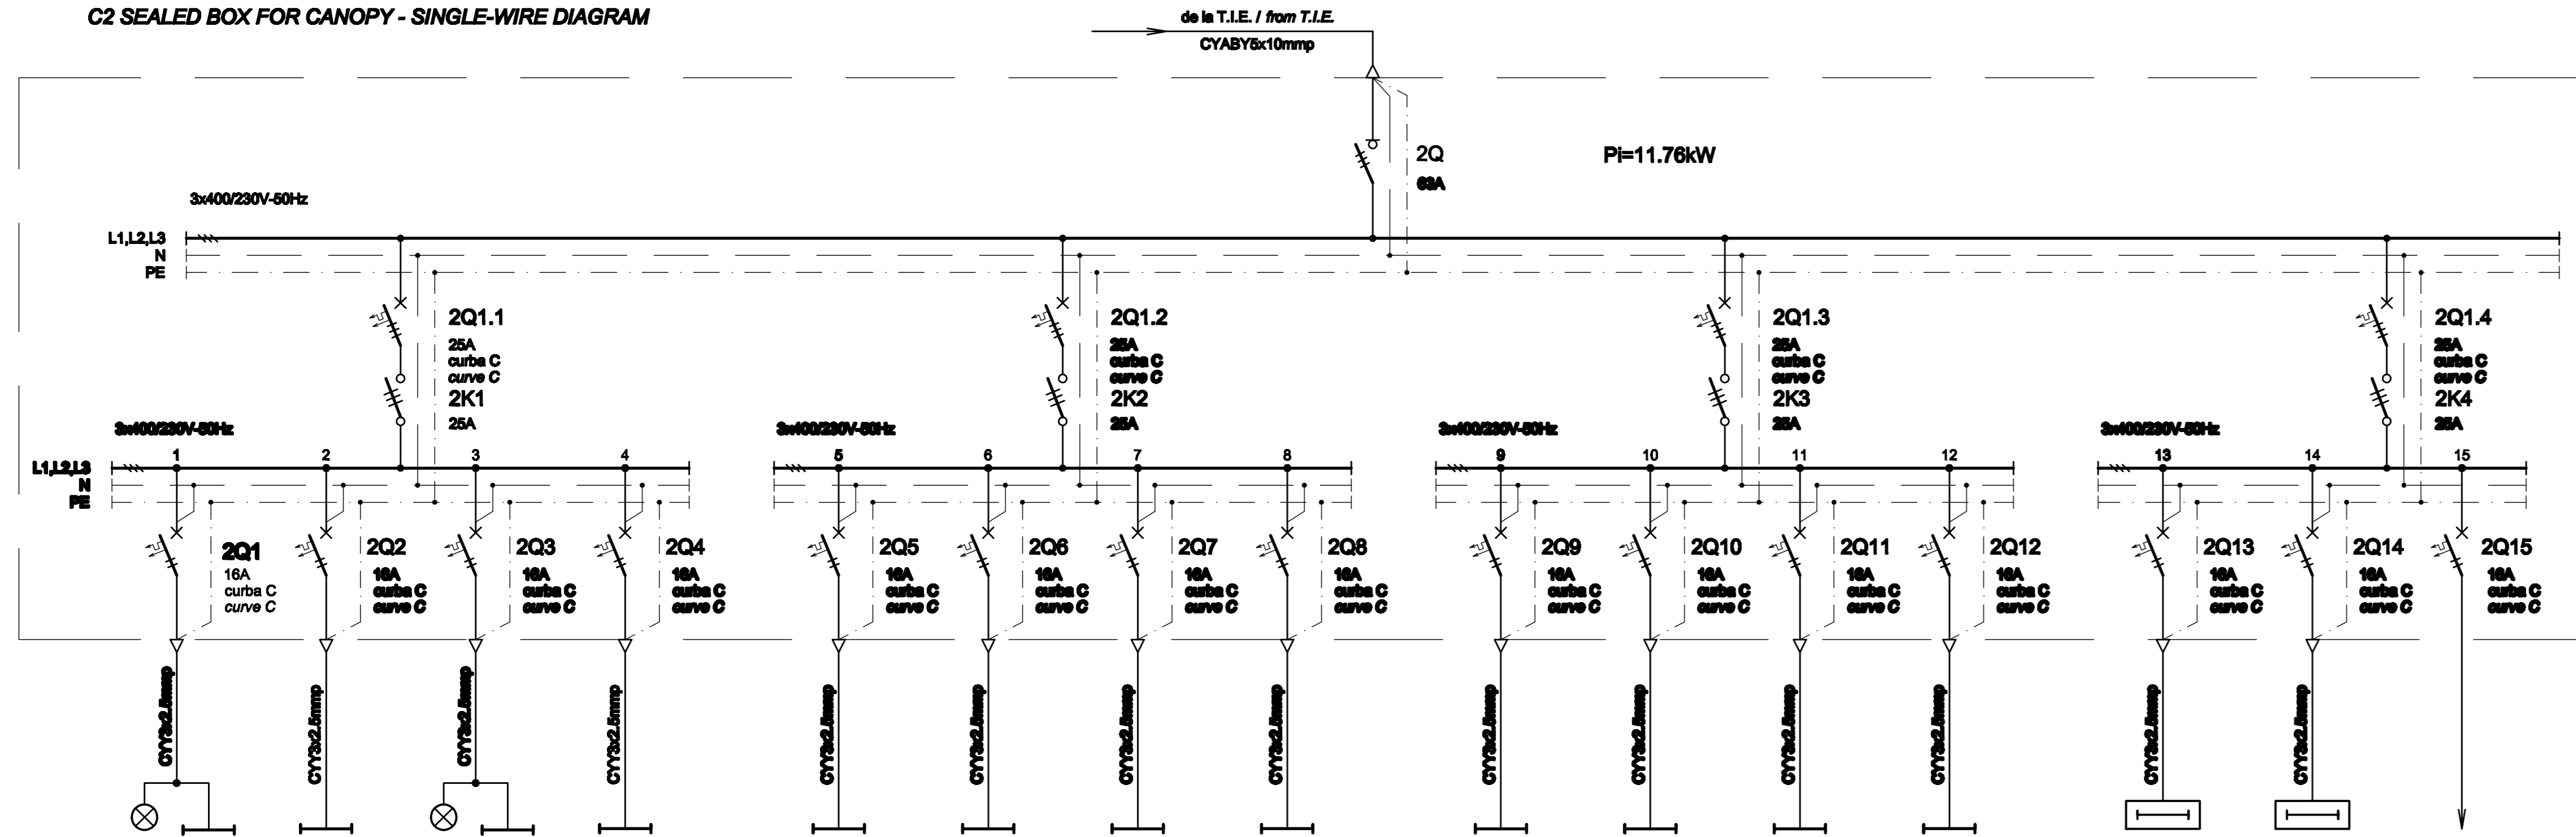

Nr. circuit Circuit number	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
P [kW]	0.81	0.6	1.05	0.7	0.6	0.6	0.7	0.7	0.6	0.6	0.7	0.7	0.7	0.7	2
Destinația Destination	ILUMINAT PERON PLATFORM LIGHTING 15LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 19LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 5Buc. / Pieces	PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 5Buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

CUTIE ETANSA PENTRU COPERTINA C2 - SPECIFICATIE DE APARATAJ  
C2 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos.	Observatii Remarks
0	1	2	3	4	5
1	2Q	Separator de sarcina tripolar Three-pole switch-disconnector	In=63A Un=400V Uimp=6kV f=50Hz Iom=2.2kA	1	
2	2Q1.1.....2Q1.4	Intreupator automat tripolar, curba C Three-pole circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	2Q1.....2Q15	Intreupator automat bipolar, curba C Two-pole circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	15	
4	2K1.....2K4	Contactator electromagnetic tripolar de curent alternativ / Three-pole electromagnetic a.c. contactor	In=25A Un=400A Uc=230V f=50Hz	4	
5	-	Cutie / Box	IP54, Class I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved CFR	Aprobat CFR Approved CFR



CLIENT / CLIENT  
C.N.C.F. "C.F.R." - S.A.



CONSULTANT / CONSULTANT		Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	12.2011	
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	12.2011	
Verificat Checked	Expert Verificator Checking Expert	12.2011	

SUBCONTRACTANT / SUBCONTRACTOR		Data Date	Semnătură Signature
Aprobat Approved	Responsabil Subcontractant Subcontractant Responsible	12.2011	
Intocmit Elaborated	Proiectant Designer	12.2011	

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,  
Tronsonul : Brașov - Sighișoara  
Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,  
Section : Brașov - Sighișoara

Faza / Phase:  
D.E. / E.D.

Denumire desen / Drawing Title :  
**Cutie etanșă pentru copertină C2 - Stația Apașă;  
Apasa station - C2 sealed box for canopy**

Codificare / Codification System: Scara / Scale: LOT / LOT: Nr. / No: 01 / 01

E A 5 1 0 1 E 0 9 B X I E 0 0 3 1 0 5 2 1