


CUTIE ETANSA PENTRU COPERTINA CV2 - SCHEMA MONOFILARA
CV2 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

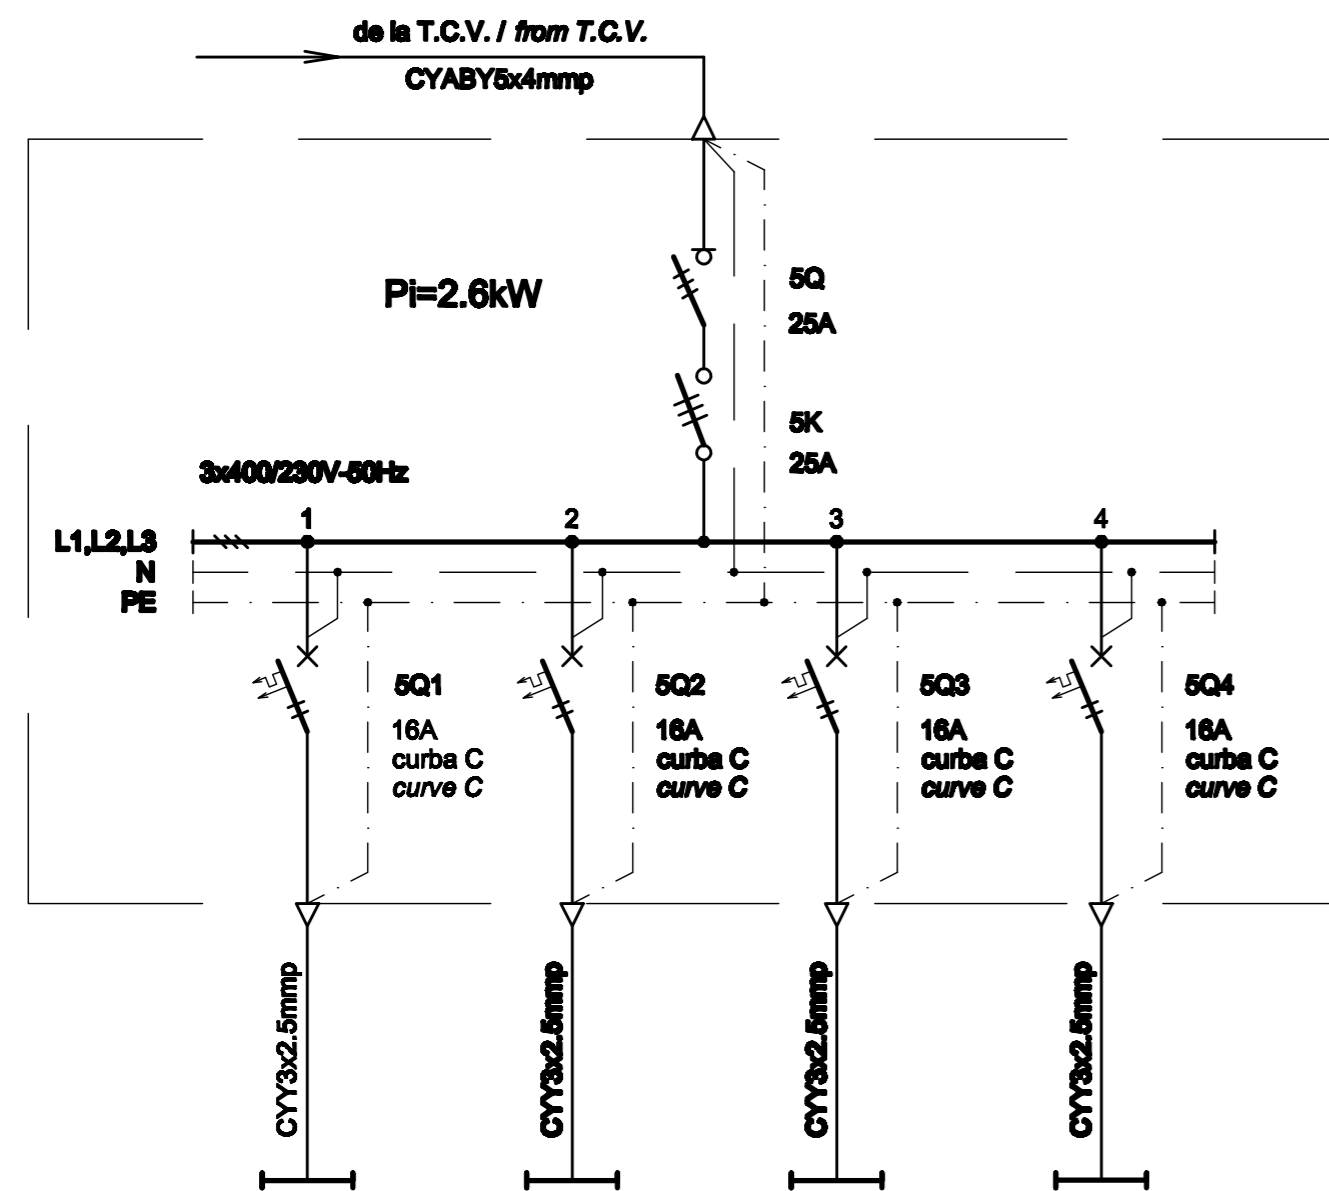

| Nr. circuit Circuit number | 1 | 2 | 3 | 4 |
|-----------------------------------|---|---|---|---|
| Pi [kW] | 0.6 | 0.7 | 0.6 | 0.7 |
| Destinatia Destination | ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps | ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps | ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps | ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps |

CUTIE ETANSA PENTRU COPERTINA CV2 - SPECIFICATIE DE APARATAJ
CV2 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION


| Nr. No. | Simbol Symbol | Denumirea aparatului Equipment denomination | Caracteristici tehnice Technical data | Buc. Pcs. | Observatii Remarks |
|---------|------------------|---|--|--------------|-----------------------|
| 0 | 1 | 2 | 3 | 4 | 5 |
| 1 | 5Q | Separator de sarcina tripolar Three-pole switch-disconnector | In=25A Un=400V Uimp=8kV f=50Hz Icm=2.2kA | 1 | |
| 2 | 5Q1,...,5Q4 | Interruptor automat bipolar, curba C Two-pole circuit breaker, curve C | In=16A Un=250V Icu=6kA f=50Hz | 4 | |
| 3 | 5K | Contactor electromagnetic tripolar de curent alternativ / Three-pole electromagnetic a.c. contactor | In=25A Un=400A Uo=230V f=50Hz | 1 | |
| 4 | - | Cutie / Box | IP64, Class I / Class I | 1 | |

| | | | | | |
|-----------------|--------------|-------------------------------------|------------------------|---|-----------------------------|
| D | | | | | |
| C | | | | | |
| B | | | | | |
| A | | | | | |
| Indice Index | Data Date | Modificare Modification/Revision | Proiectant Designer | Aprobat Consultant Approved Consultant | Aprobat CFR Approved CFR |



C.N.C.F. "C.F.R." - S.A.

CLIENT / CLIENT

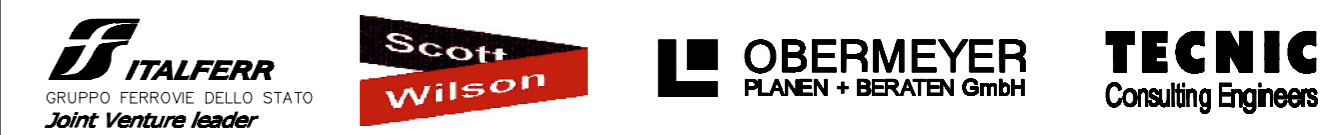

CONSULTANT / CONSULTANT

| Aprobat Approved | Șef proiect Project manager | R. Liuzza | Data Date | Semnătură Signature |
|----------------------|---|---------------|--------------|------------------------|
| Aprobat Approved | Coordonator Secțiune 1 Section 1 Coordinator | C. Gambelli | 12.2011 | <i>[Signature]</i> |
| Verificat Checked | Expert Verificator Checking Expert | G. Fioravanti | 12.2011 | <i>[Signature]</i> |

SUBCONTRACTANT / SUBCONTRACTOR



| Aprobat Approved | Responsabil Subconsultant Subconsultant Responsible | A.Stanciu - Dinulescu | Data Date | Semnătură Signature |
|------------------------|--|-----------------------|--------------|------------------------|
| Întocmit Elaborated | Proiectant Designer | D. Matei | 12.2011 | <i>[Signature]</i> |

Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteza maximă de 160 km/h,
Tronsonul : Braşov - Sighişoara
 Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Braşov - Sighişoara

Proiect/Project
 2004/RO/16/P/PA/003
Faza / Phase:
 D.E. / E.D.

Denumire desen / Drawing Title :
Cutie etanșă pentru copertină CV2 - Stația Apața;
Apata station - CV2 sealed box for canopy

| | | | |
|---|---------------|-----------|---------------------|
| Codificare / Codification System | Scara / Scale | LOT / LOT | Nr. / No 01 / 01 |
| E A 5 1 0 1 E 0 9 B X I E 0 0 3 1 0 5 5 1 | | | |