


CUTIE ETANSA PENTRU COPERTINA C1 - SCHEMA MONOFILARA
C1 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

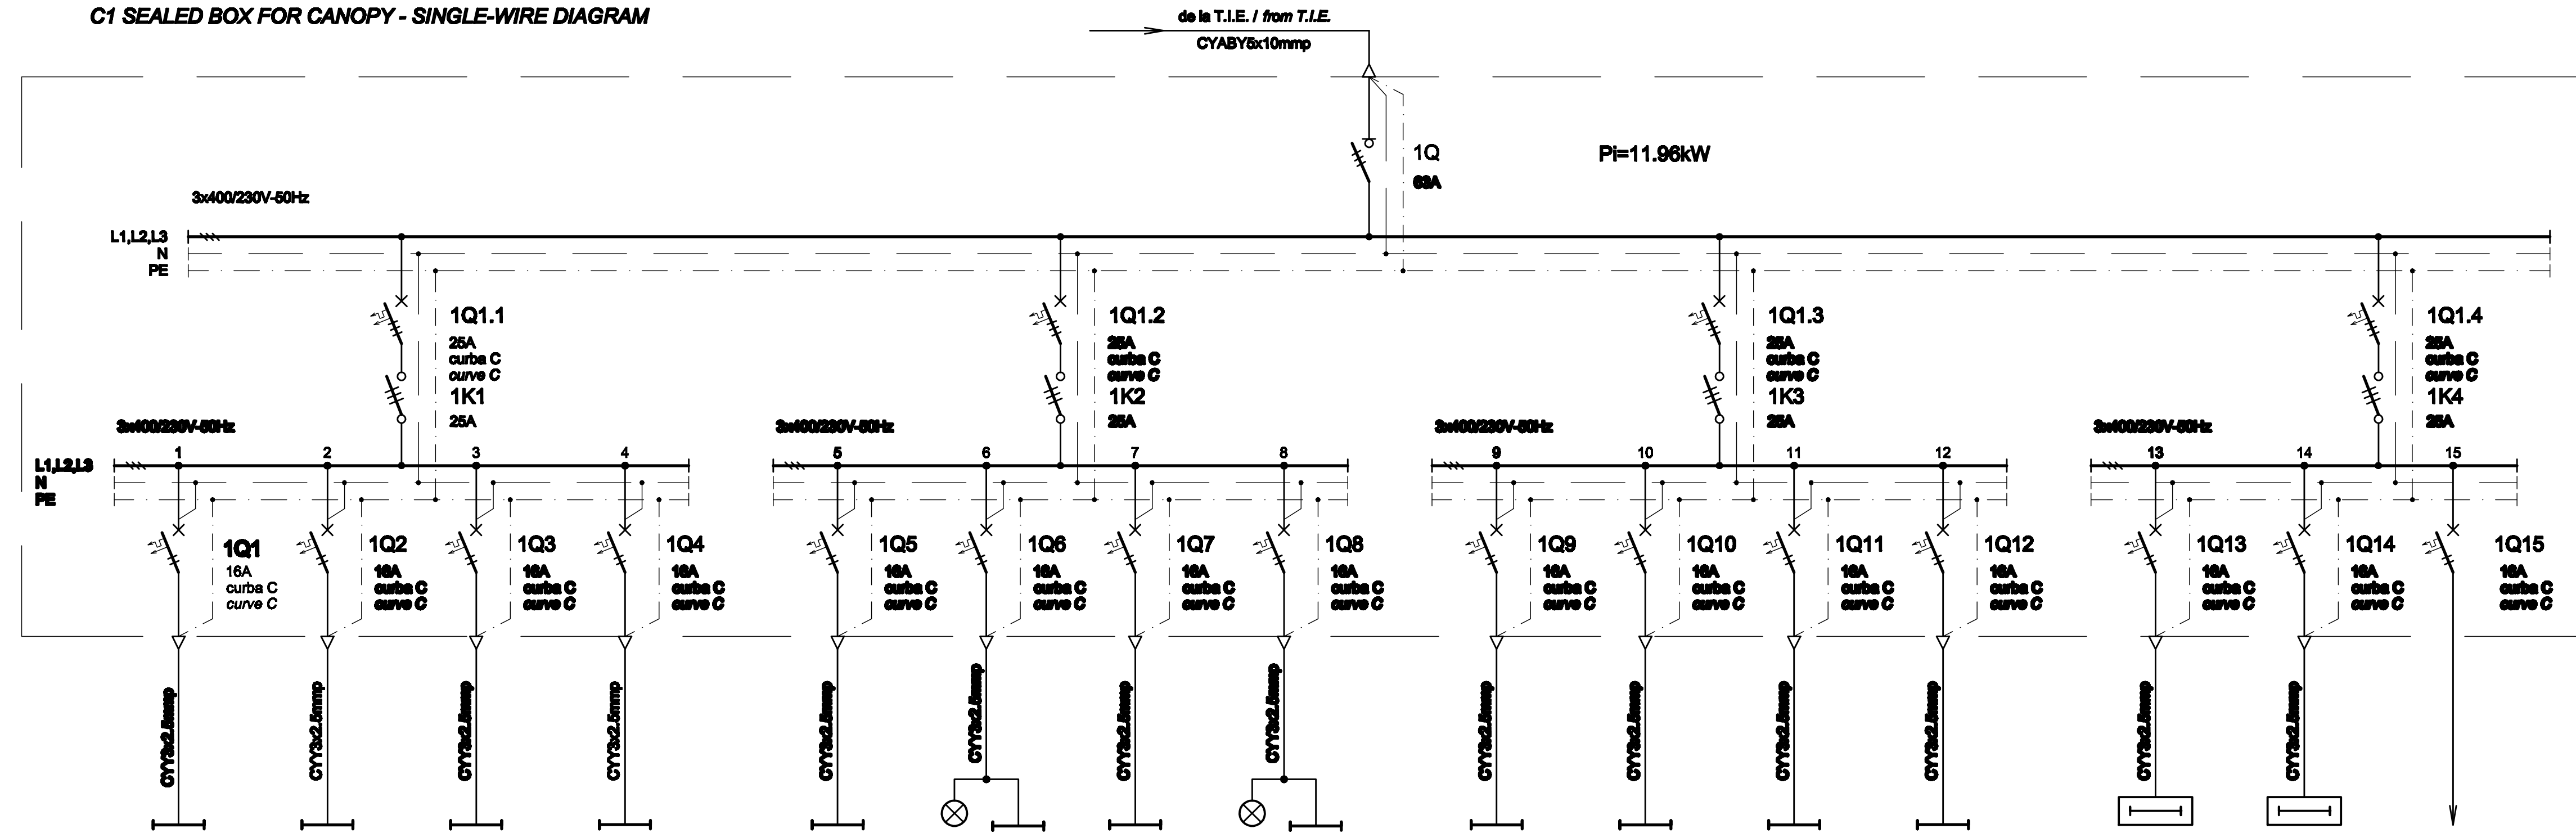

Nr. circuit Circuit number	1	2	3	4
Pi [kW]	0.6	0.6	0.7	0.7
Destinatia Destination	ILLUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 14LL / Lamps

5	6	7	8
0.6	0.88	0.7	0.98
ILLUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 16LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 18LL / Lamps


9	10	11	12
0.6	0.6	0.7	0.7
ILLUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILLUMINAT PERON PLATFORM LIGHTING 14LL / Lamps

13	14	15
0.7	0.9	2
PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 5buc. / Pieces	PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 7buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

CUTIE ETANSA PENTRU COPERTINA C1 - SPECIFICATIE DE APARATAJ
C1 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Simbol Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos. Qty.	Observatii Remarks
0	1				
1	1Q	Separator de sarcina tripolar Three-pole switch-disconnector	In=63A Un=400V Uimp=8kV f=50Hz Icm=2.2kA	1	
2	1Q1.1,...,1Q1.4	Intrerupator automat tripolar, curba C Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	1Q1,...,1Q15	Intrerupator automat bipolar, curba C Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	15	
4	1K1,...,1K4	Contactator electromagnet tripolar de curent alternativ / Three-poles electromagnetic a.c. contactor	In=25A Un=400A Uo=230V f=50Hz	4	
5	-	Cutie / Box	IP64, Class I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR

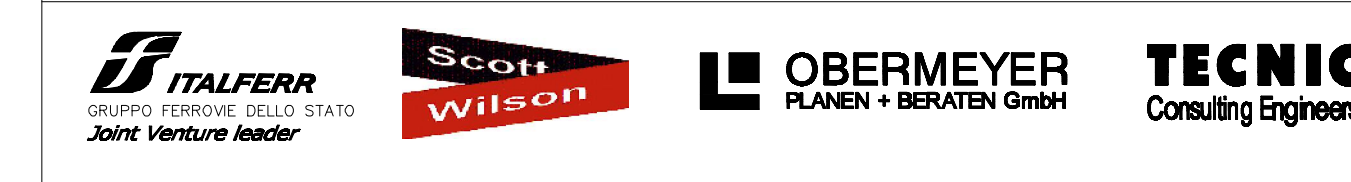

CONSULTANT / CONSULTANT		Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	12.2011	R. Liuzza
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	12.2011	C. Gambelli
Verificat Checked	Expert Verificator Checking Expert	12.2011	G. Fioravanti

SUBCONTRACTANT / SUBCONTRACTOR		Data Date	Semnătură Signature
Aprobat Approved	Responsabil Subconsultant Subconsultant Responsible	12.2011	A. Stanciu - Dinulescu
Intocmit Elaborated	Proiectant Designer	12.2011	D. Matei

Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Braşov - Sighişoara
Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Braşov - Sighişoara

Denumire desen / Drawing Title :
**Cutie etanşă pentru copertină C1 - Stația Cața;
Cata station - C1 sealed box for canopy**

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1 0 1 E 1 3 B X I E 0 0 3 1 0 5 1 1			