


CUTIE ETANSA PENTRU COPERTINA C2 - SCHEMA MONOFILARA
C2 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

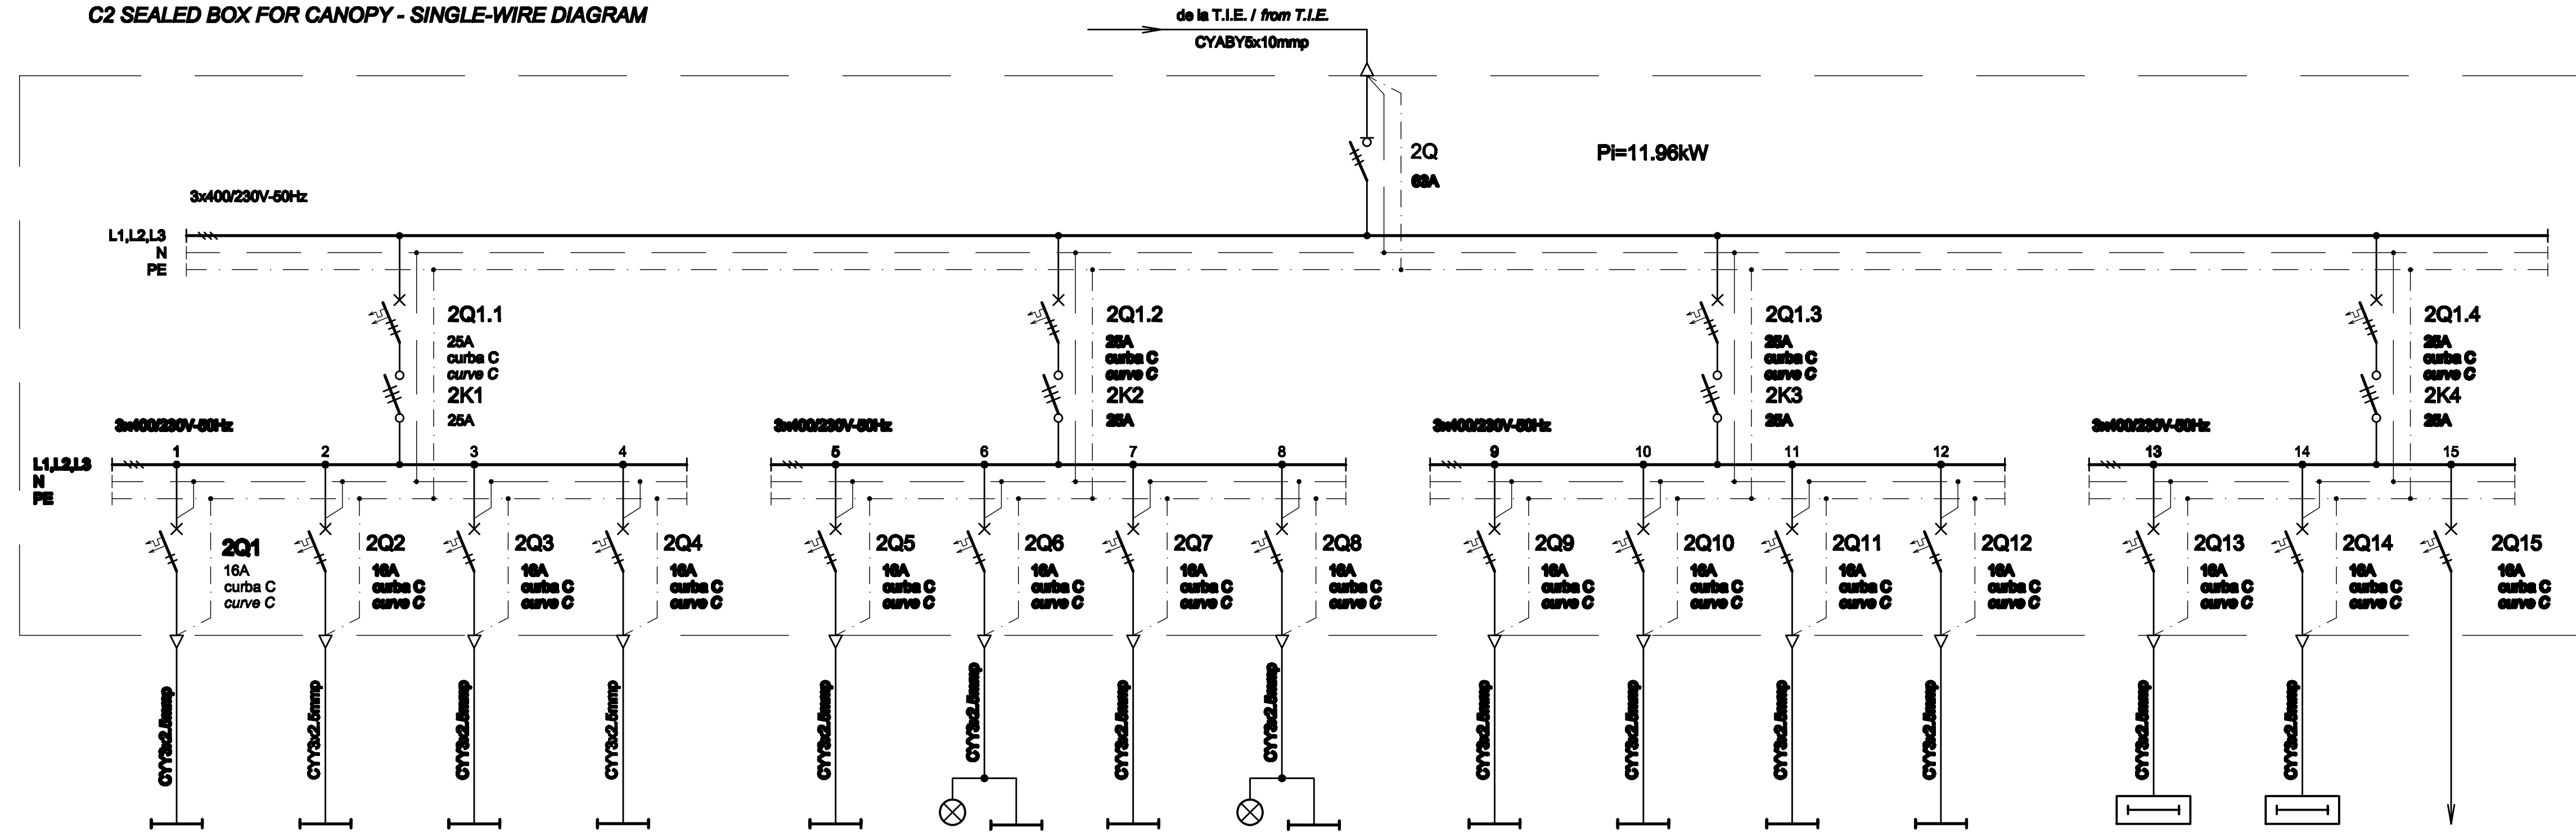

Nr. circuit Circuit number	1	2	3	4
Pi [kW]	0.6	0.6	0.7	0.7
Destinația Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps

ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 16LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 18LL / Lamps
---	---	---	---

ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps
---	---	---	---

PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 5buc. / Pieces	PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 7buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE
---	---	--

CUTIE ETANSA PENTRU COPERTINA C2 - SPECIFICATIE DE APARATAJ
C2 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Simbol Symbol	Denumirea aparaturii Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos.	Observații Remarks
0	1	2	3	4	5
1	2Q	Separator de carca tripol Three-pole switch-disconnector	In=63A Un=400V Uimp=8kV f=50Hz Icm=2.2kA	1	
2	2Q1.1,...,2Q1.4	Întreșutator automat tripol, curba C Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	2Q1,...,2Q15	Întreșutator automat bipol, curba C Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	15	
4	2K1,...,2K4	Contactori electromagnetici tripol de curent alternativ / Three-poles electromagnetico a.c. contactor	In=25A Un=400A Uo=230V f=50Hz	4	
5	-	Cutie / Box	IP64, Class I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR



CONSULTANT / CONSULTANT		Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	12.2011	R. Liuzza
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	12.2011	C. Gambelli
Verificat Checked	Expert Verificator Checking Expert	12.2011	G. Fioravanti

SUBCONTRACTANT / SUBCONTRACTOR		Data Date	Semnătură Signature
Aprobat Approved	Responsabil Subconsultant Subconsultant Responsible	12.2011	A. Stanciu - Dinulescu
Intocmit Elaborated	Proiectant Designer	12.2011	D. Matei

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Brașov - Sighișoara
Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Brașov - Sighișoara

Denumire desen / Drawing Title :
**Cutie etanșă pentru copertină C2 - Stația Cața;
Cata station - C2 sealed box for canopy**

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1 0 1 E 1 3 B X I E 0 0 3 1 0 5 2 1			