


CUTIE ETANSA PENTRU COPERTINA C3- SCHEMA MONOFILARA
C3 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

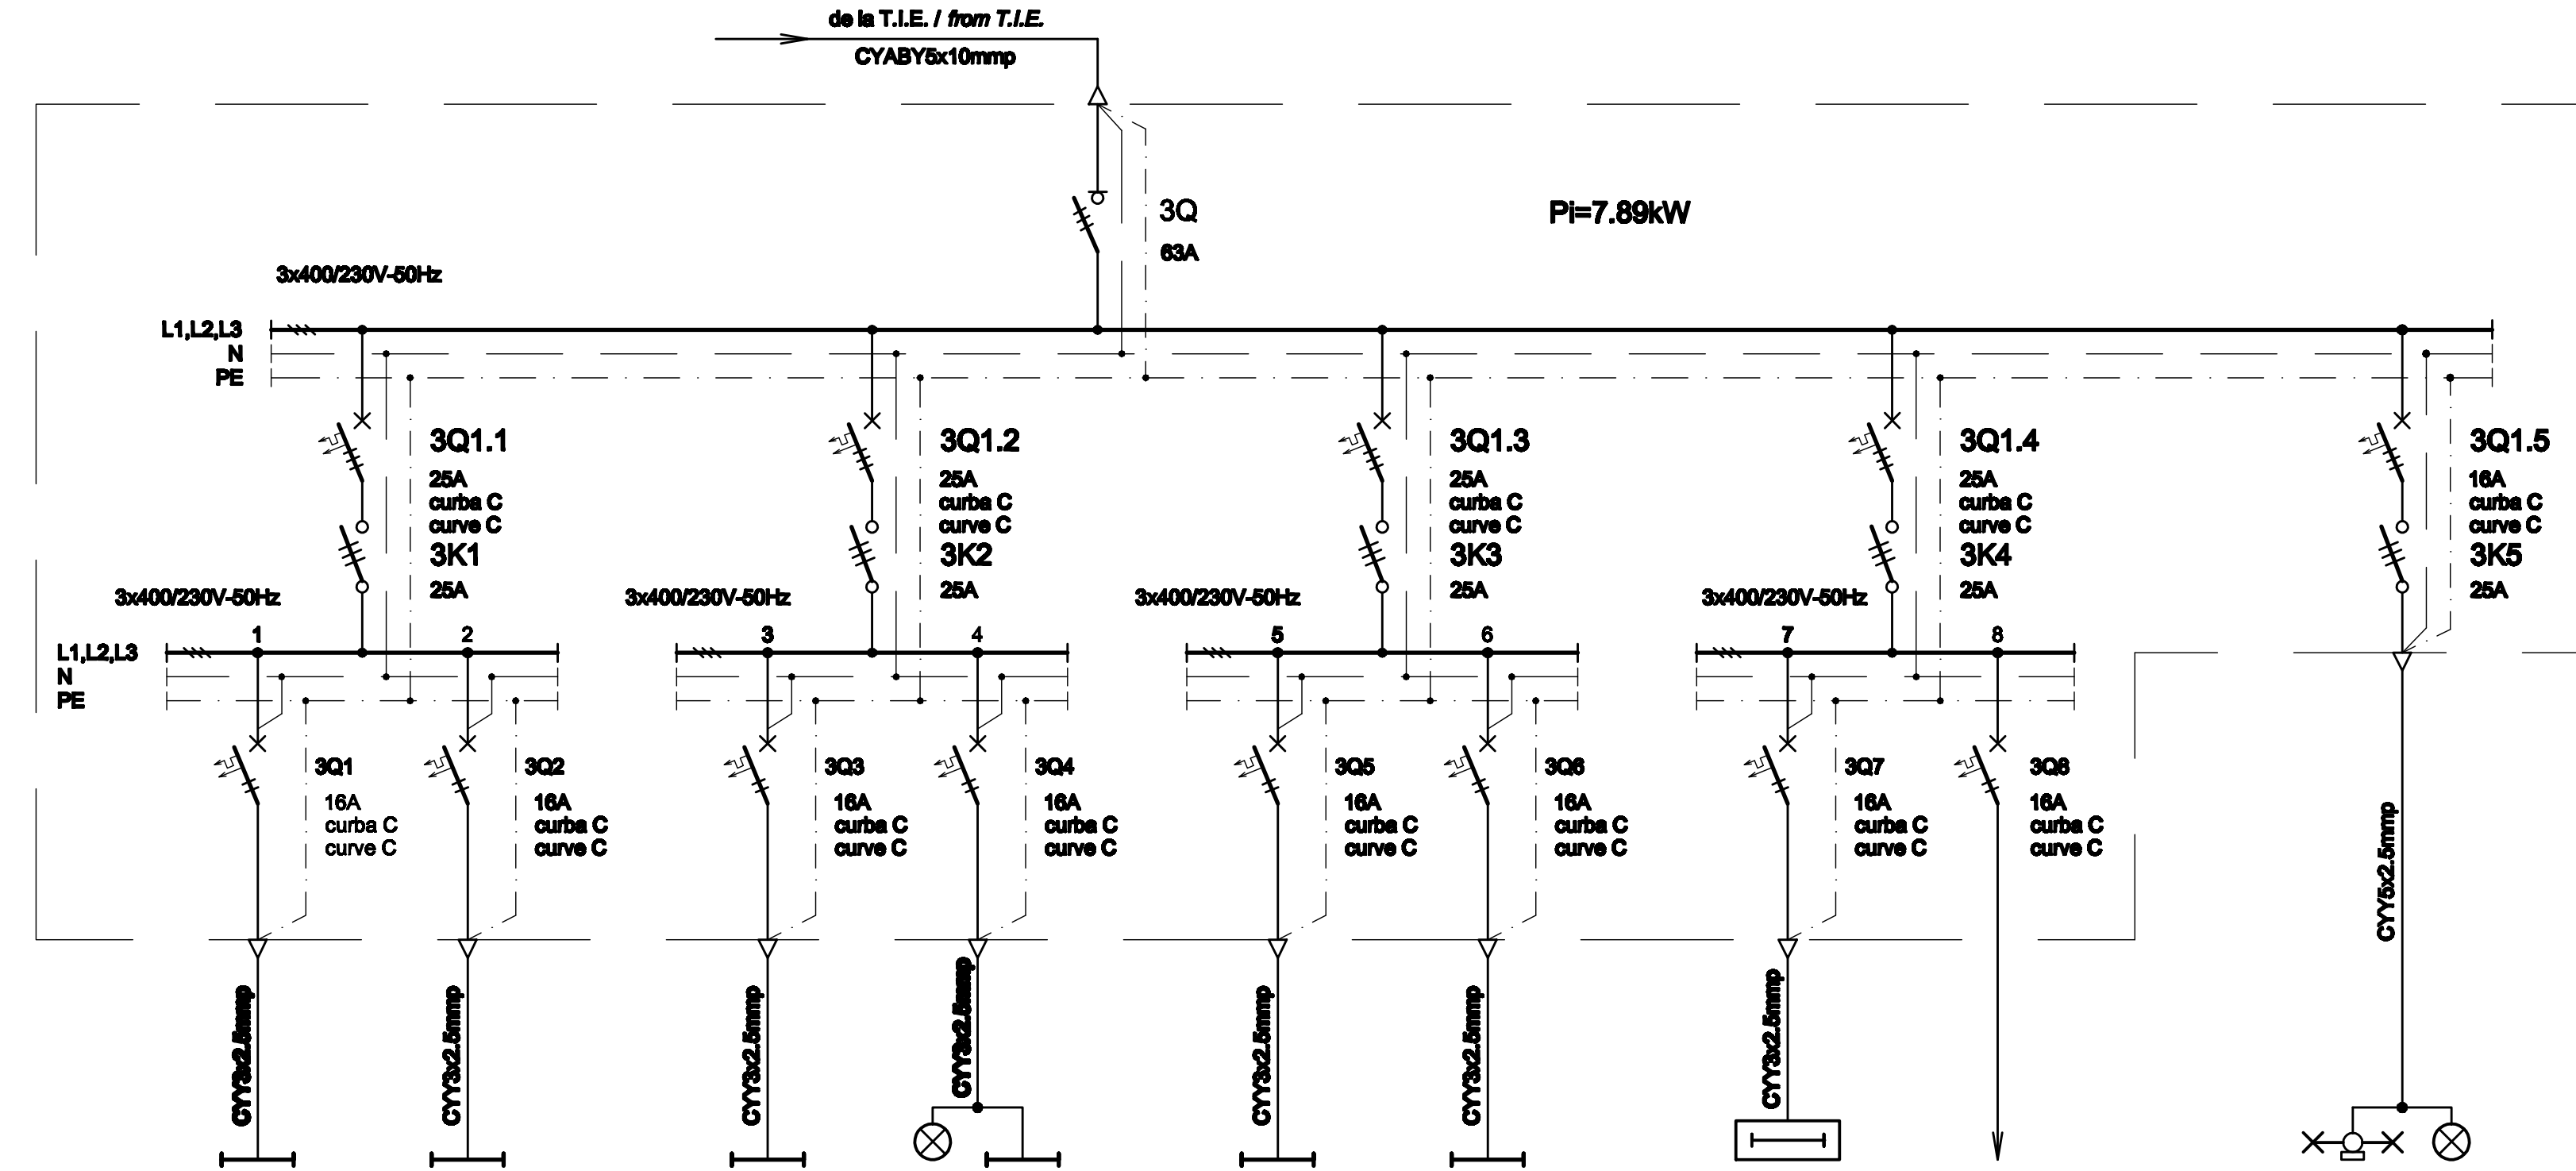

Nr. circuit	1	2
Pi [kW]	0.8	0.6
Destinatia / Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps

Nr. circuit	3	4
Pi [kW]	0.8	0.81
Destinatia / Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 15LL / Lamps

Nr. circuit	5	6
Pi [kW]	0.8	0.6
Destinatia / Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps

Nr. circuit	7	8
Pi [kW]	0.8	2
Destinatia / Destination	PICTOGRAMA - PERON PLATFORM LIGHTING 7Buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

Nr. circuit	9
Pi [kW]	1.28
Destinatia / Destination	ILUMINAT PERON PLATFORM LIGHTING 8LL / Lamps

CUTIE ETANSA PENTRU COPERTINA C3 - SPECIFICATIE DE APARATAJ
C3 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparatului / Equipment denomination	Caracteristici tehnice / Technical data	Buc. Pos.	Observatii / Remarks
0	1				
1	3Q	Separator de sarcina tripolar / Three-poles switch-disconnector	In=63A Un=400V Uimp=6kV f=50Hz Icm=2.2kA	1	
2	3Q1.1....3Q1.4	Intreupator automat tripolar, curba C / Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	3Q1.5	Intreupator automat tripolar, curba C / Three-poles circuit breaker, curve C	In=16A Un=400V Icu=6kA f=50Hz	1	
4	3Q1....3Q8	Intreupator automat bipolar, curba C / Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	8	
5	3K1....3K5	Contactori electromagnetici tripolari de curent alternativ / Three-poles electromagnetic a.c. contactors	In=25A Un=400V Uo=230V f=50Hz	5	
6	-	Cutie / Box	IP64, Class I / Class I	1	

D					
C					
B					
A					
Index	Data	Modificare / Revision	Proiectant / Designer	Aprobat Consultant / Approved Consultant	Aprobat CFR / Approved CFR



C.N.C.F. "C.F.R." - S.A.

CLIENT / CLIENT



CONSULTANT / CONSULTANT

Aprobat / Approved	Verificat / Checked	Responsabil / Responsible	Data / Date	Semnătură / Signature
		Șef proiect / Project manager	12.2011	
		Coordonator Secțiune 1 / Section 1 Coordinator	12.2011	
		Expert Verificator / Checking Expert	12.2011	

SUBCONTRACTANT / SUBCONTRACTOR

Aprobat / Approved	Intocmit / Elaborated	Responsabil Subconsultant / Subconsultant Responsible	Data / Date	Semnătură / Signature
		A.Stanciu - Dinulescu	12.2011	
		Proiectant / Designer	12.2011	

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Brașov - Sighișoara
 Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Brașov - Sighișoara

Proiect/Project
 2004/RO/16/PA/003

Faza / Phase:
 D.E. / E.D.

Denumire desen / Drawing Title :

Cutie etanșă pentru copertină C3 - Stația Capș;
Canopy sealed box for canopy

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
----------------------------------	---------------	-----------	---------------------

E A 5 1 0 1 E 1 3 B X I E 0 0 3 1 0 5 3 1