


CUTIE ETANSA PENTRU COPERTINA C2 - SCHEMA MONOFILARA
C2 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

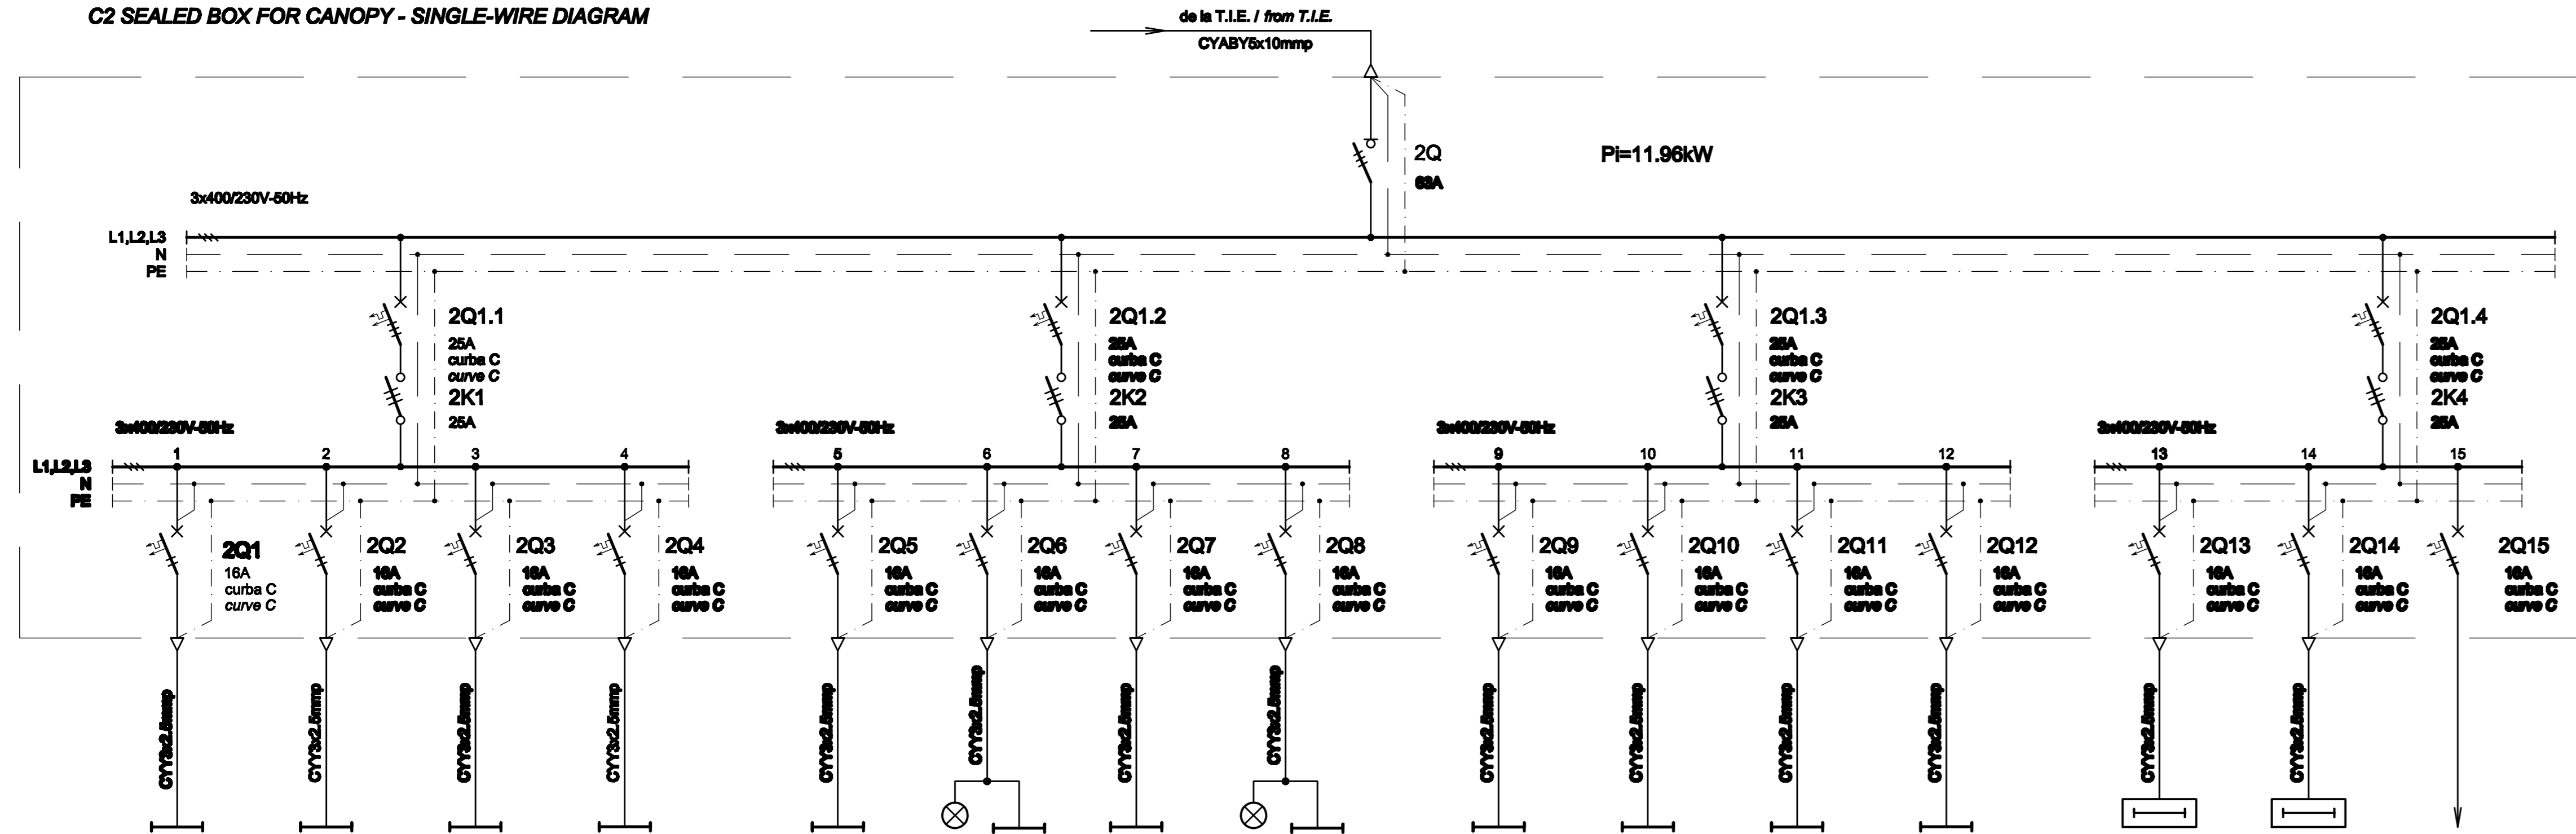

Nr. circuit Circuit number	1	2	3	4
PI [kW]	0.6	0.6	0.7	0.7
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps

Nr. circuit Circuit number	5	6	7	8
PI [kW]	0.6	0.88	0.7	0.98
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 16LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 18LL / Lamps

Nr. circuit Circuit number	9	10	11	12
PI [kW]	0.6	0.6	0.7	0.7
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 14LL / Lamps

Nr. circuit Circuit number	13	14	15
PI [kW]	0.7	0.9	2
Destinatia Destination	PICTOGRAME - PERON PICTOGRAMS - PLATFORM 5Buc. / Pieces	PICTOGRAME - PERON PICTOGRAMS - PLATFORM 7Buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

CUTIE ETANSA PENTRU COPERTINA C2 - SPECIFICATIE DE APARATAJ
C2 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Simbol Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pcs.	Observatii Remarks
0	1	2	3	4	5
1	2Q	Separator de sarcina tripolar Three-poles switch-disconnector	In=63A Un=400V Uimp=6kV f=50Hz Iom=2.2kA	1	
2	2Q1.1,...,2Q1.4	Intreupator automat tripolar, curba C Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	2Q1,...,2Q15	Intreupator automat bipolar, curba C Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	15	
4	2K1,...,2K4	Contacteur electromagnetic tripolar de curent alternativ / Three-pole electromagnetic a.c. contactor	In=25A Un=400A Uo=230V f=50Hz	4	
5	-	Cutie / Box	IP54, Class I / Class I	1	

Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR
D					
C					
B					
A					



GUVERNUL ROMANIEI
ROMANIAN GOVERNMENT

PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ
EUROPEAN UNION FINANCED PROJECT

CFR

C.N.C.F. "C.F.R." - S.A.



CONSULTANT / CONSULTANT			Data Date	Semnătură Signature
Aprobat Approved	Șef proiect Project manager	R. Liuzza	12.2011	
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	C. Gambelli	12.2011	
Verificat Checked	Expert Verificator Checking Expert	G. Fioravanti	12.2011	

SUBCONTRACTANT / SUBCONTRACTOR			Data Date	Semnătură Signature
Aprobat Approved	Responsabil Subcontractant Subcontractant Responsible	A.Stanciu - Dinulescu	12.2011	
Intocmit Elaborated	Proiectant Designer	D. Matei	12.2011	

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului
IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Brașov - Sighișoara
Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European
Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Brașov - Sighișoara

Project/Project
2004/RO/16/PPA/003
Faza / Phase:
D.E. / E.D.

Denumire desen / Drawing Title :

Cutie etanșă pentru copertină C2 - Stația Archița;
Archita station - C2 sealed box for canopy

Codificare / Codification System

Scara / Scale

LOT / LOT

Nr. / No
01 / 01

E A 5 1 0 1 E 1 5 B X I E 0 0 3 1 0 5 2 1