


CUTIE ETANSA PENTRU COPERTINA C3- SCHEMA MONOFILARA
C3 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

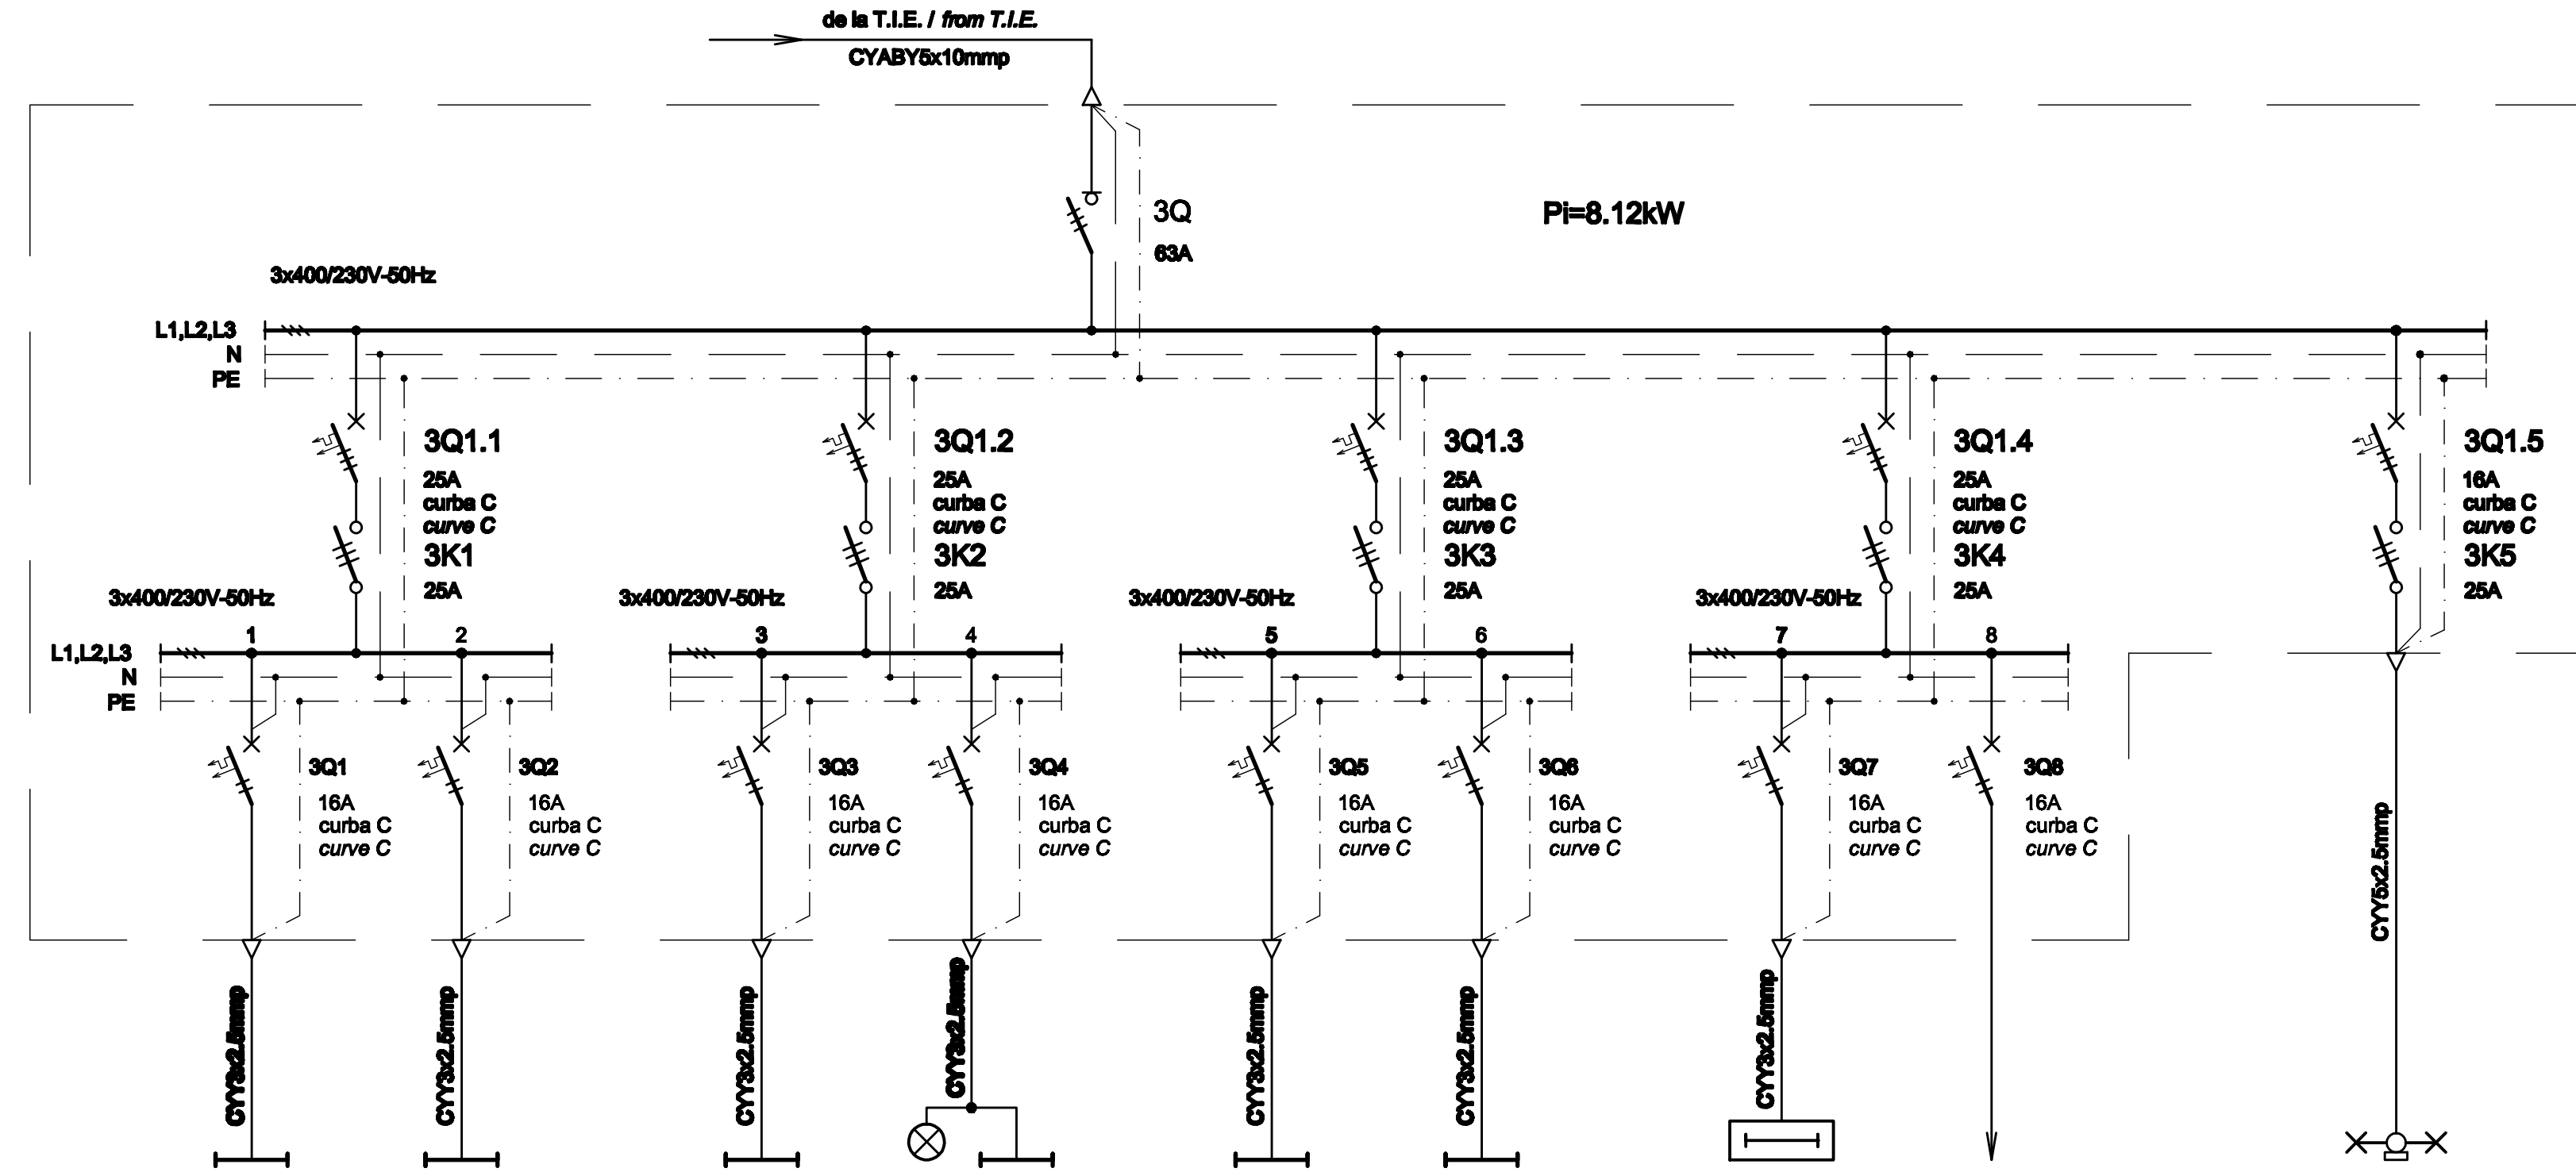

Nr. circuit Circuit number	1	2
Pi=8.12kW	0.6	0.6
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps

Nr. circuit Circuit number	3	4
Pi=8.12kW	0.6	1.02
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 18LL / Lamps

Nr. circuit Circuit number	5	6
Pi=8.12kW	0.6	0.6
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps

Nr. circuit Circuit number	7	8
Pi=8.12kW	1.1	2
Destinatia Destination	PICTOGRAME - PERON PICTOGRAMS - PLATFORM 10Buc. / Pieces	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

Nr. circuit Circuit number	9
Pi=8.12kW	1
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 4LL


CUTIE ETANSA PENTRU COPERTINA C3 - SPECIFICATIE DE APARATAJ
C3 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparaturii Equipment denomination	Caracteristici tehnice Technical data	Buc. Pcs.	Observatii Remarks
0	1				
1	3Q	Separator de sarcina tripolar Three-poles switch-disconnector	In=63A Un=400V Uimp=6kV f=50Hz Iom=2.2kA	1	
2	3Q1.1.....3Q1.4	Intrerupator automat tripolar, curba C Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	3Q1.5	Intrerupator automat tripolar, curba C Three-poles circuit breaker, curve C	In=16A Un=400V Icu=6kA f=50Hz	1	
4	3Q1.....3Q8	Intrerupator automat bipolar, curba C Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	8	
5	3K1.....3K5	Contacteur electromagnetic tripolar de curent alternativ / Three-poles electromagnetic a.c. contactor	In=25A Un=400V Uo=230V f=50Hz	5	
6	-	Cutie / Box	IP54, Class I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR



CLIENT / CLIENT

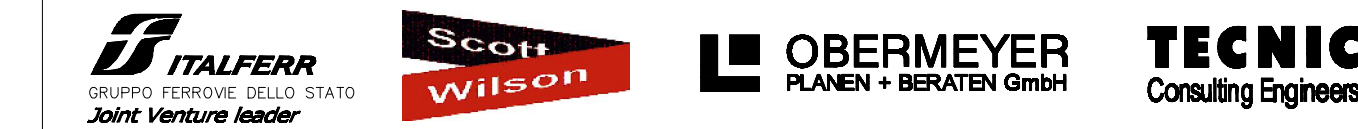

CONSULTANT / CONSULTANT

Aprobat Approved	Șef proiect Project manager	R. Liuzza	Data Date	Semnătură Signature
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	C. Gambelli	12.2011	<i>[Signature]</i>
Verificat Checked	Expert Verificator Checking Expert	G. Fioravanti	12.2011	<i>[Signature]</i>

SUBCONTRACTANT / SUBCONTRACTOR

Aprobat Approved	Responsabil Subconsultant Subconsultant Responsible	A.Stanciu - Dinulescu	12.2011	<i>[Signature]</i>
Întocmit Elaborat	Proiectant Designer	D. Matei	12.2011	<i>[Signature]</i>

Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,
Tronsonul : Braşov - Sighişoara
 Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,
Section : Braşov - Sighişoara

Project/Project
2004/RO/16/PPA/003
Faza / Phase:
D.E. / E.D.

Denumire desen / Drawing Title :

Cutie etanșă pentru copertină C3 - Stația Archita;
Archita station - C3 sealed box for canopy

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
----------------------------------	---------------	-----------	---------------------

E A 5 1 0 1 E 1 5 B X I E 0 0 3 1 0 5 3 1