


TABLOU ELECTRIC T.T.R. - SCHEMA MONOFILARA
T.T.R. ELECTRIC BOARD - SINGLE-WIRE DIAGRAM

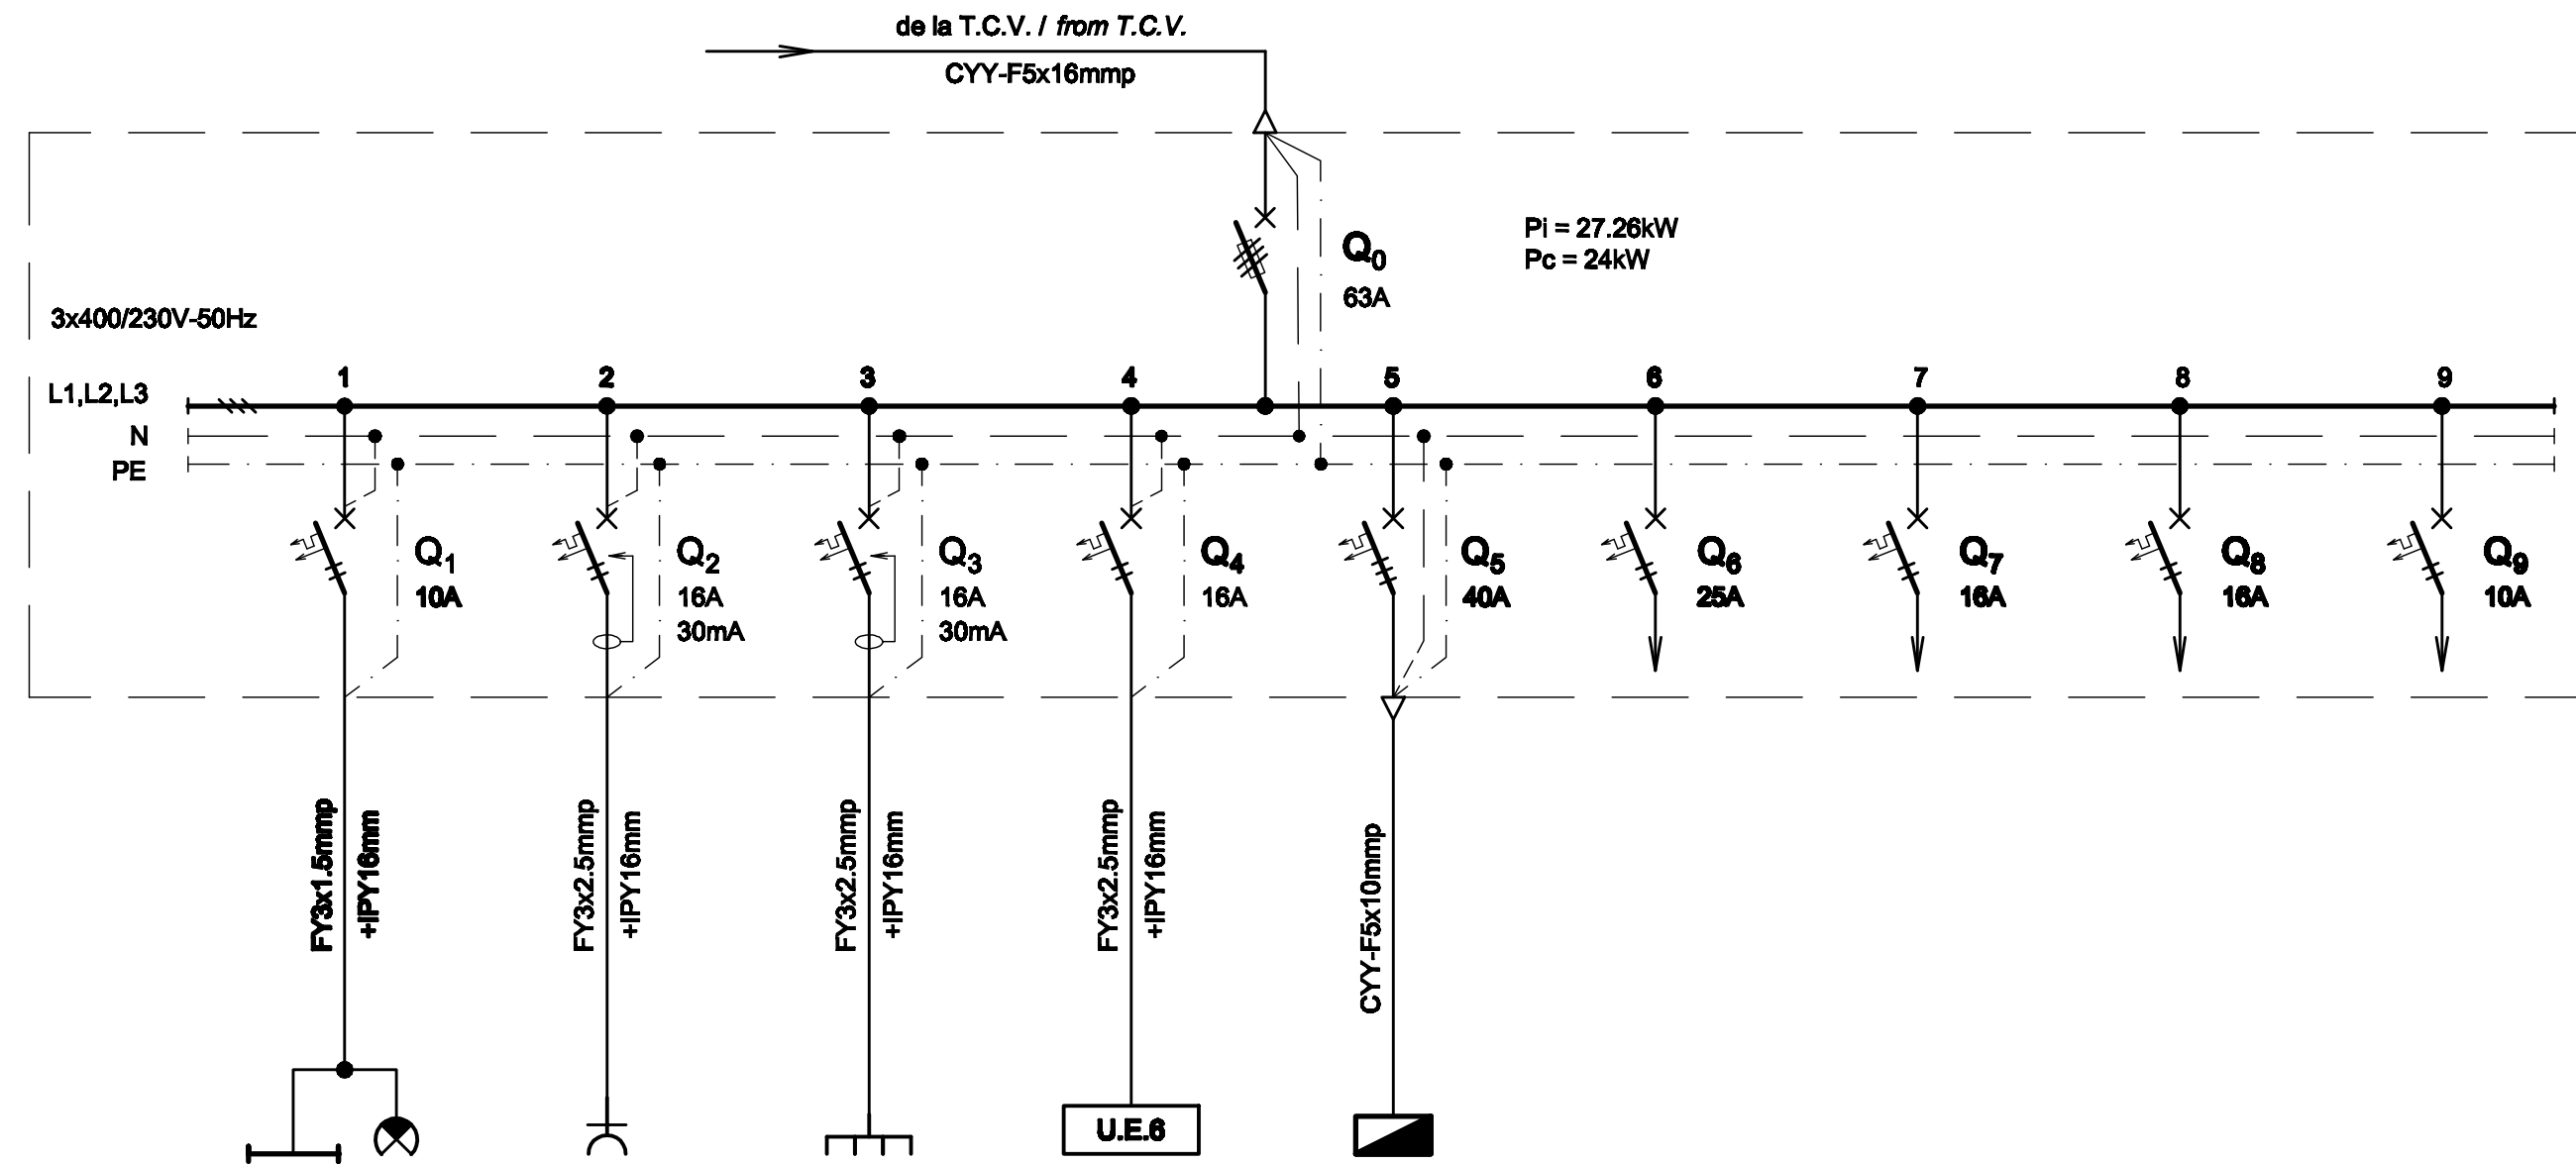

Nr. circuit Circuit number	1	2	3	4	5	6	7	8	8
Pi [kW]	0.56	2	2	1	13.7	3	2	2	1
Destinația Destination	T.T.R., VESTIBUL, MAG. ELECTROMEC. TTR ROOM, WINDFANG, STORE HOUSE ELL / Lamps	T.T.R., MAG. ELECTROMEC. TTR ROOM, STORE HOUSE 4LP / Sockets outlet	T.T.R., MAG. ELECTROMEC. TTR ROOM, STORE HOUSE 5LP / Sockets outlet	UNITATE EXTERNOARA DE CLIMATIZARE SISTEM MONOSPLIT OUTDOOR UNIT AIR CONDITIONING SYSTEM MONOSPLIT 1Buc. / Piece	TABLOU ECHIPAMENTE EQUIPMENTS BOARD	REZERVA MONOFAZATA SINGLE-PHASE RESERVE	REZERVA MONOFAZATA SINGLE-PHASE RESERVE	REZERVA MONOFAZATA SINGLE-PHASE RESERVE	REZERVA MONOFAZATA SINGLE-PHASE RESERVE

TABLOU ELECTRIC T.T.R. - SPECIFICATIA DE APARATAJ
T.T.R. ELECTRIC BOARD - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pcs.	Observatii Remarks
0	1				
1	Q0	Separator de sarcina tripolar cu fuzibil / Three-poles switch-disconnectors with fusible	In=63A Un=400V Uimp=8kV f=50Hz Icm=2,2kA	1	
2	Q1,Q9	Intrerupator automat bipolar, curba B / Two-poles circuit breaker, curve B	In=10A Un=230V Icu=6kA f=50Hz	2	
3	Q2,Q3	Intrerupator automat bipolar cu protectie la curent diferential rezidual, curba C / Two-poles circuit breaker with protection at residual differential current device, curve C	In=16A Un=230V Icu=6kA f=50Hz ΔIn=0,03A Tip A Nivel de imunitate 250A la forma de unda 8/20 μS Level of immunity 250A to wave form 8/20 μS	2	
4	Q5	Intrerupator automat tripolar, curba C / Three-poles circuit breaker, curve C	In=40A Un=400V Icu=6kA f=50Hz	1	
5	Q4,Q7,Q8	Intrerupator automat bipolar, curba C / Two-poles circuit breaker, curve C	In=16A Un=230V Icu=6kA f=50Hz	3	
6	Q6	Intrerupator automat bipolar, curba C / Two-poles circuit breaker, curve C	In=25A Un=230V Icu=6kA f=50Hz	1	
7	-	Cutie / Box	IP30, Clasa I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR
		GUVERNUL ROMANIEI ROMANIAN GOVERNMENT		PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ EUROPEAN UNION FINANCED PROJECT	
		C.N.C.F. "C.F.R." - S.A.			
CLIENT / CLIENT					
		TECNIC Consulting Engineers			
CONSULTANT / CONSULTANT					
Aprobat Approved	Șef proiect Project manager	R. Liuzza		Data Date	Semnătură Signature
Aprobat Approved	Coordonator Secțiune 1 Section 1 Coordinator	C. Gambelli		12.2011	
Verificat Checked	Expert Verificator Checking Expert	G. Fioravanti		12.2011	
SUBCONTRACTANT / SUBCONTRACTOR					
Aprobat Approved	Responsabil Subconsultant Subconsultant Responsible	A.Stanciu - Dinulescu		12.2011	
Întocmit Elaborated	Proiectant Designer	D. Matei		12.2011	
Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteza maximă de 160 km/h, Tronsonul : Braşov - Sighişoara Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section : Braşov - Sighişoara					
Denumire desen / Drawing Title :					
Tablou electric T.T.R. - Stația Albești Târnava; Albești Tarnava station - T.T.R. electric board					
Codificare / Codification System			Scara / Scale	LOT / LOT	Nr. / No 01 / 01
E A 5 1			0 1	E	1 9 B X I E 0 0 9 1 0 4 0 1