


CUTIE ETANSA PENTRU COPERTINA C3- SCHEMA MONOFILARA  
C3 SEALED BOX FOR CANOPY - SINGLE-WIRE DIAGRAM

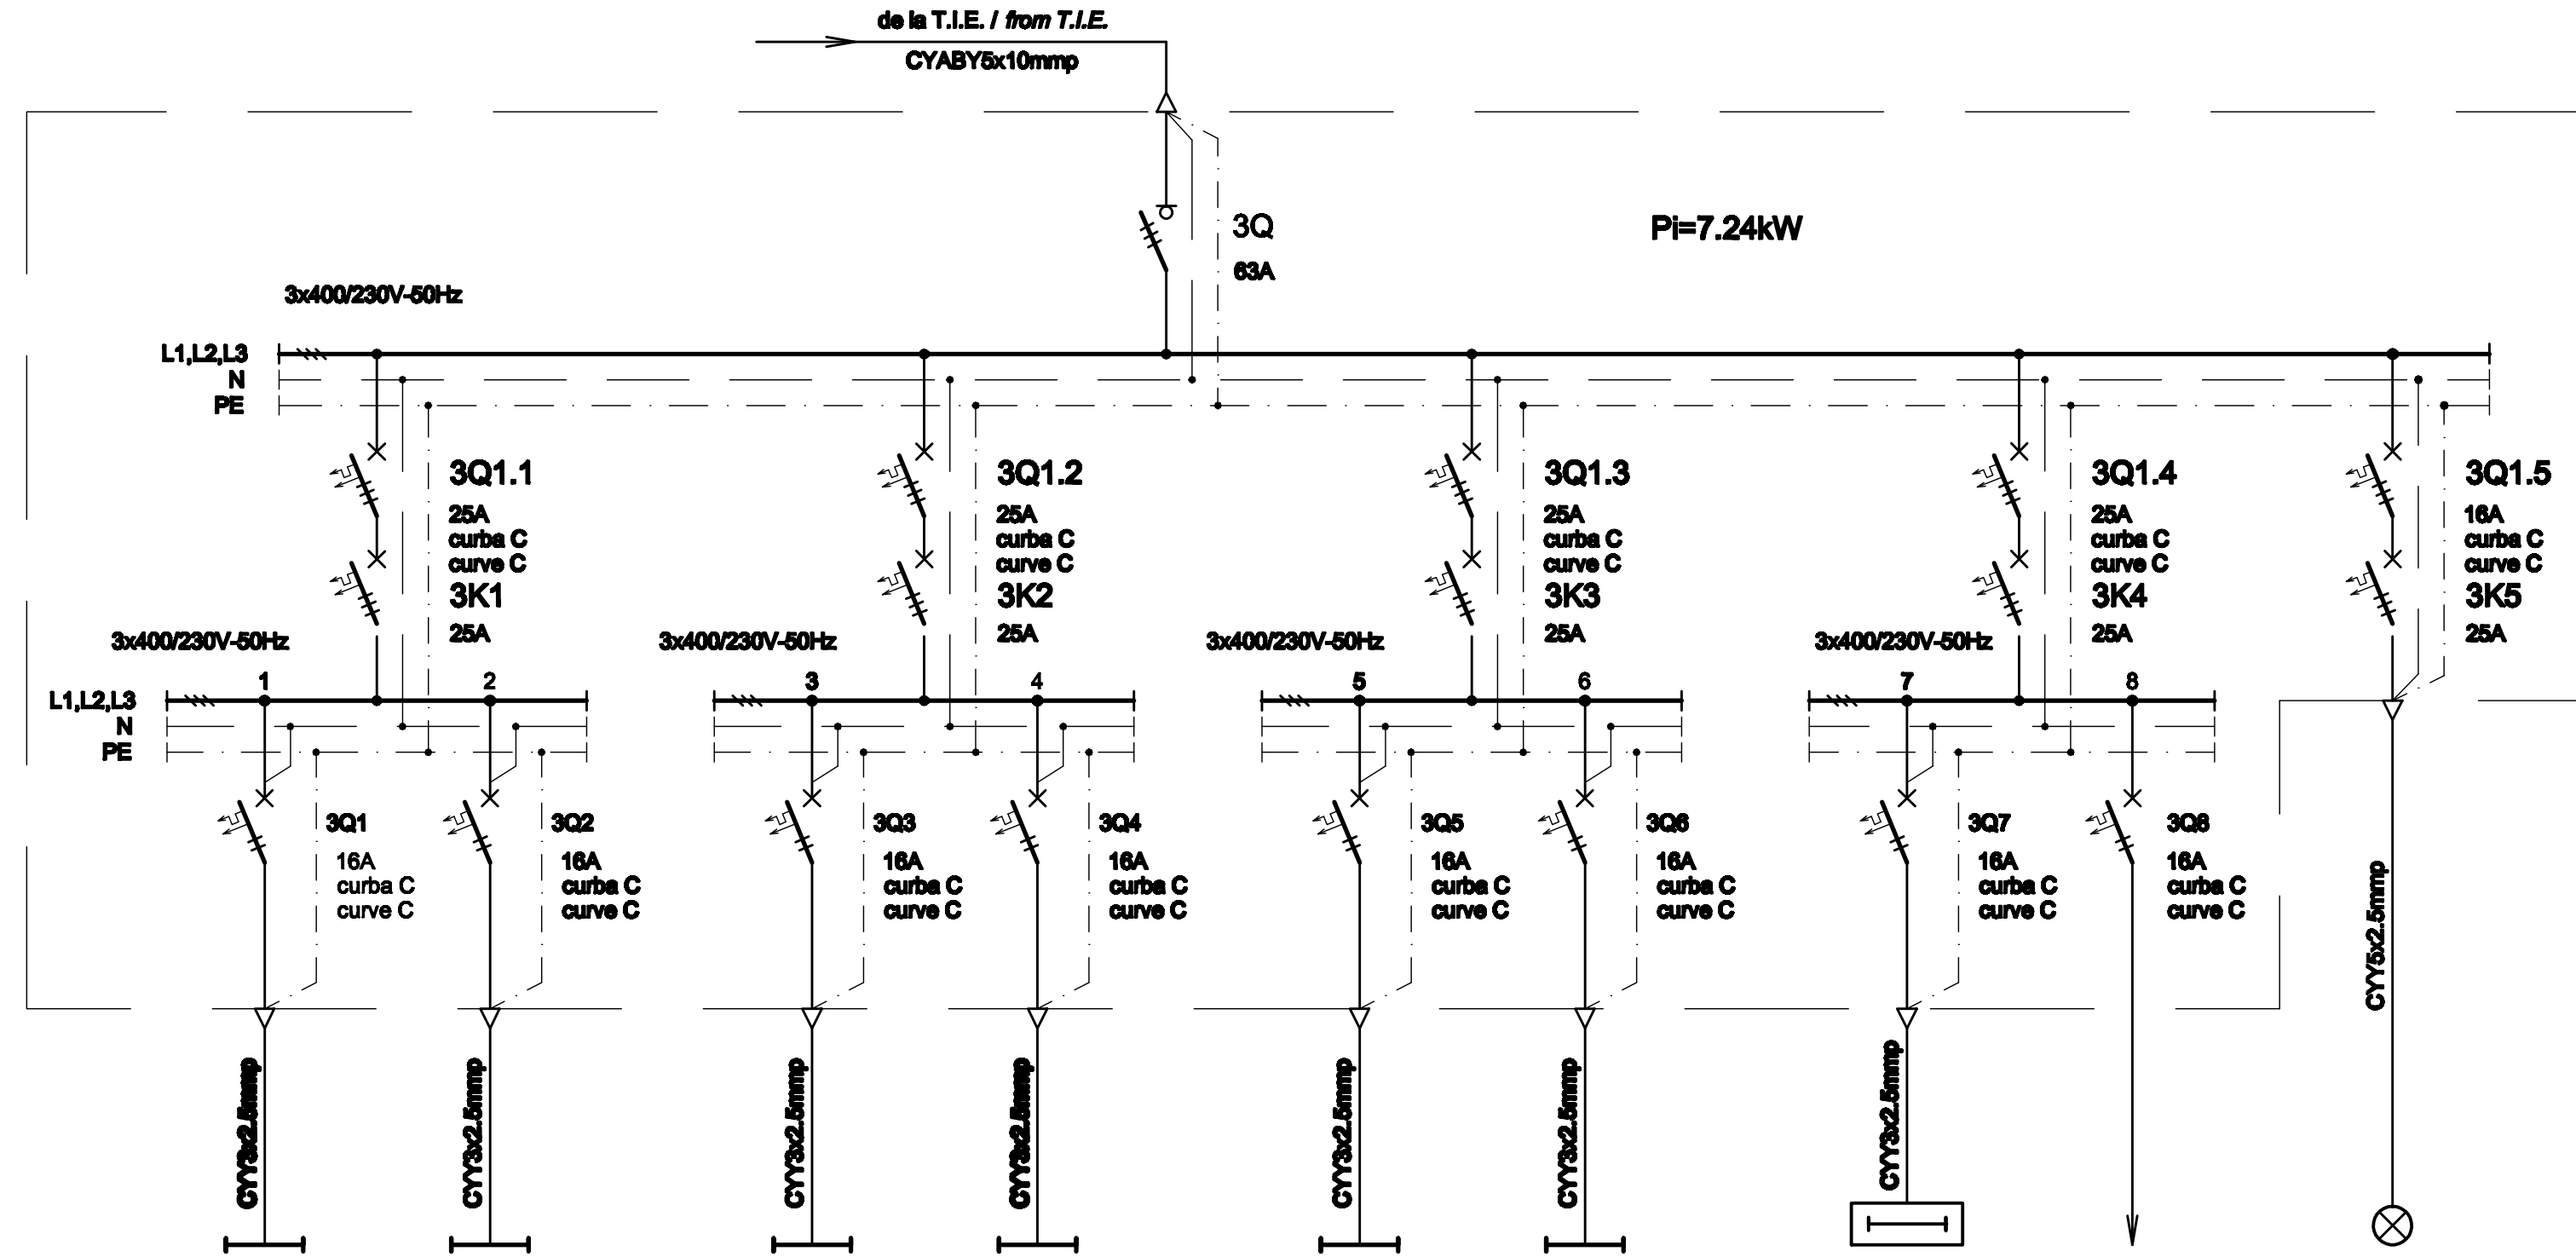


Nr. circuit Circuit number	1	2	3	4	5	6	7	8	9
P <sub>total</sub> [kW]	0.5	0.6	0.6	0.6	0.6	0.6	0.8	2	0.84
Destinatia Destination	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps	PICTOGRAMA - PERON PICTOGRAMS - PLATFORM 08ms / Places	REZERVA MONOFAZATA SINGLE-PHASE RESERVE	ILUMINAT PERON PLATFORM LIGHTING 12LL / Lamps

CUTIE ETANSA PENTRU COPERTINA C3 - SPECIFICATIE DE APARATAJ  
C3 SEALED BOX FOR CANOPY - EQUIPMENT SPECIFICATION

Nr. No.	Symbol	Denumirea aparatului Equipment denomination	Caracteristici tehnice Technical data	Buc. Pos.	Observatii Remarks
0	1	2	3	4	5
1	3Q	Separator de sarcina tripolar Three-poles switch-disconnector	In=63A Un=400V Uimp=6kV f=50Hz Icm=2.2kA	1	
2	3Q1.1,...,3Q1.4	Intreruptor automat tripolar, curba C Three-poles circuit breaker, curve C	In=25A Un=400V Icu=6kA f=50Hz	4	
3	3Q1.5	Intreruptor automat tripolar, curba C Three-poles circuit breaker, curve C	In=16A Un=400V Icu=6kA f=50Hz	1	
4	3Q1,...,3Q8	Intreruptor automat bipolar, curba C Two-poles circuit breaker, curve C	In=16A Un=250V Icu=6kA f=50Hz	8	
5	3K1,...,3K5	Contactator electromagnetic tripolar de curent alternativ / Three-poles electromagnetic a.c. contactor	In=25A Un=400A Uc=230V f=50Hz	5	
6	-	Cutie / Box	IP64, Class I / Class I	1	

D					
C					
B					
A					
Indice Index	Data Date	Modificare Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR

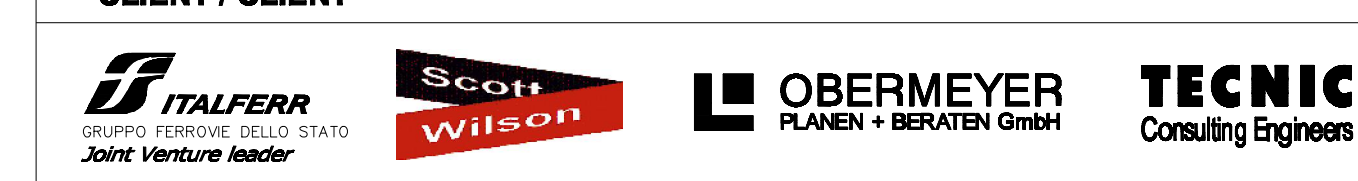

Aprobat Approved		Sef proiect Project manager		R. Liuzza		Data Date		Semnătură Signature	
Aprobat Approved		Coordonator Secțiune 1 Section 1 Coordinator		C. Gambelli		12.2011			
Verificat Checked		Expert Verificator Checking Expert		G. Fioravanti		12.2011			

Aprobat Approved		Responsabil Subconsultant Subconsultant Responsible		A.Stanciu - Dinulescu		12.2011			
Intocmit Elaborated		Proiectant Designer		D. Matei		12.2011			

Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h,  
Tronsonul : Braşov - Sighişoara  
Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h,  
Section : Braşov - Sighişoara

Denumire desen / Drawing Title :  
**Cutie etanșă pentru copertină C3 - Stația Albești Târnava;  
Albești Tarnava station - C3 sealed box for canopy**

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No 01 / 01
EA51 01 E 19 BX IE 00 3 1 053 1			