


EXECUTAREA LUCRARILOR DE MONTAJ A INSTALATIEI SANITARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTUI TIP DE LUCRARI

THE EXECUTION OF THE FIXING WORKS FOR SANITARY INSTALLATION WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPE OF WORKS.

Sectione "C - C"  
Section "C - C"

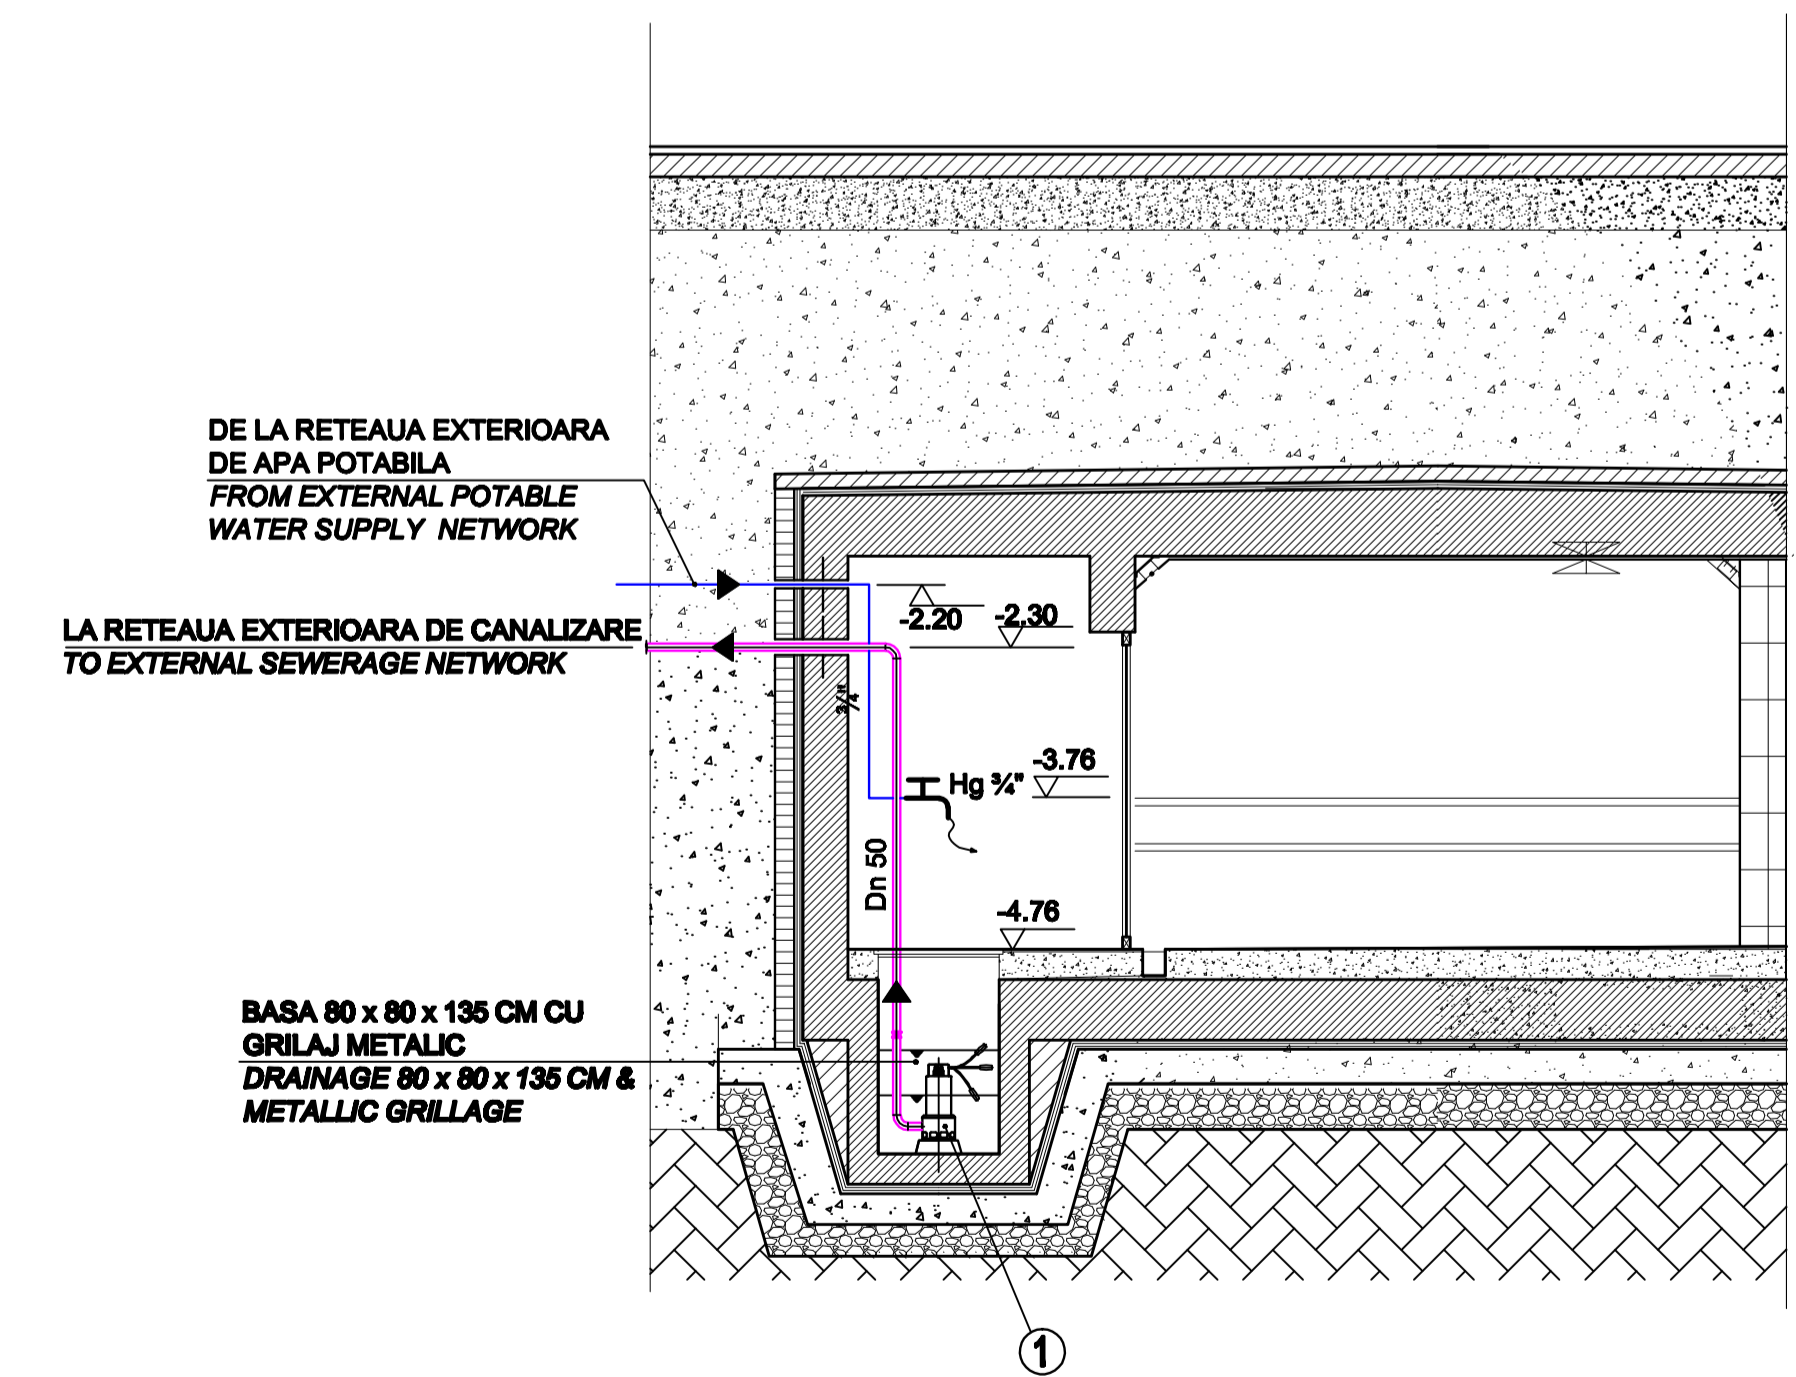

LEGENDA :

- TRASEU DE APA POTABILA, DIN TEAVA DE OTEL ZINCATA, 3/4"
- TRASEU APA DE SPALARE SUB PRESIUNE, DIN TEAVA DE OTEL, Dn 60
- Hg 3/4" ROBINET PENTRU HIDRANT DE GRADINA, 3/4".
- PTE 28 PIEASA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 28 mm
- PTE 60 PIEASA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 60 mm
- ① ELECTROPOMPA SUBMERSIBILA DE EPUISMENT, CU PLUTITOR, Q = 3 m<sup>3</sup>/h, h = 13 mCA, N = 1,38 kW.

LEGENDA :

- PATH OF DRINKING WATER, FROM GALVANIZED STEEL PIPE, 3/4"
- PATH OF THE WATER PRESSURE WASHING, FROM STEEL PIPE, DN 60
- Hg 3/4" TAP FOR GARDEN HYDRANT, 3/4" DIAMETER.
- PTE 28 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 28 mm
- PTE 60 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 60 mm
- ① OVERDRIVING IMMERSION ELECTRIC FLOATING PUMP, Q = 3 cm<sup>3</sup>/h, H = 13 mWC, N = 1.38 kW.

\* CATEGORIA DE IMPORTANTA "C" - NORMALA, CALITATEA LUCRARILOR ASIGURANDU-SE DUPA MODELUL 3.

\* CERINTA DE CALITATE A EXIGENTELOR ESENTIALE - DIN H.G. 925/96 - ESTE **Is**.

\* IMPORTANCE CATEGORY: "C" - NORMAL, THE WORKS QUALITY BEING ENSURED BASED ON MODEL 3.

\* THE QUALITY REQUIREMENT OF ESSENTIAL DEMANDS IN H.G. 925/96 IS **Is**.

D					
C					
B					
A					
Indice	Data	Modificari	Proiectant	Approbat	Approbat CFR
		Indice	Design	Consultant	Consultant
		Date			
		Modificari			
		Revisiuni			

GUVERNUL ROMANIEI  
ROMANIAN GOVERNMENT

PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ  
EUROPEAN UNION FINANCED PROJECT

CFR

C.N.C.F. "C.F.R." - S.A.

CLIENT / CLIENT

ITALFER  
GRUPUL FEROVICAR ILIEI STATO  
Joint Venture leader

OBERMEYER  
PLANEN + BERATEN GmbH

TECNIC  
Consulting Engineers

CONSULTANT / CONSULTANT		Date	Semnatura
Approbat	Șef proiect		
Approbat	Coordonator Secțiune 1	R. Lizuta	DEC. 2011
Verificat	Șef Secțiune 1	C. Gambell	DEC. 2011
Verificat	Expert Verificator	Giuseppe Fioravanti	DEC. 2011

SUBCONTRACTANT / SUBCONTRACTOR		Date	Semnatura
Approbat	Responsabil Subcontractant		
Elaborat	Proiectant	A. Stancu - Dinulescu	DEC. 2011
	Design	Florian Duta	DEC. 2011

Reabilitarea liniei de cale ferata Brasov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h, Tronsoanel: Brasov - Sighisoara

Rehabilitation of the railway line Brasov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section: Brasov - Sighisoara

Proiect/Project  
2004/RO16/PPA/003

Faza / Phase:  
D.E. / E.D.

Denumire desen / Drawing Title:  
STATIA CF BOD. TUNEL PIETONAL. INSTALATI HIDRAULICE. PLAN SI SECTIUNE "C - C".  
BOD RAILWAY STATION. PEDESTRIAN TUNNEL. HYDRAULIC INSTALLATION.  
BASEMENT PLAN AND "C - C SECTION".

Codificare / Codification System	Scara / Scale 1 : 50	LOT/LOT	Nr. / No 01 / 01
E A 5 1	0 1	C	0 5
P B	I S	0 0	2
4	0 1 0	1	