


EXECUTAREA LUCRARILOR DE MONTAJ A INSTALATIEI SANITARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTUI TIP DE LUCRARI

THE EXECUTION OF THE FIXING WORKS FOR SANITARY INSTALLATION WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPE OF WORKS.

Sectione "C - C"
Section "C - C"

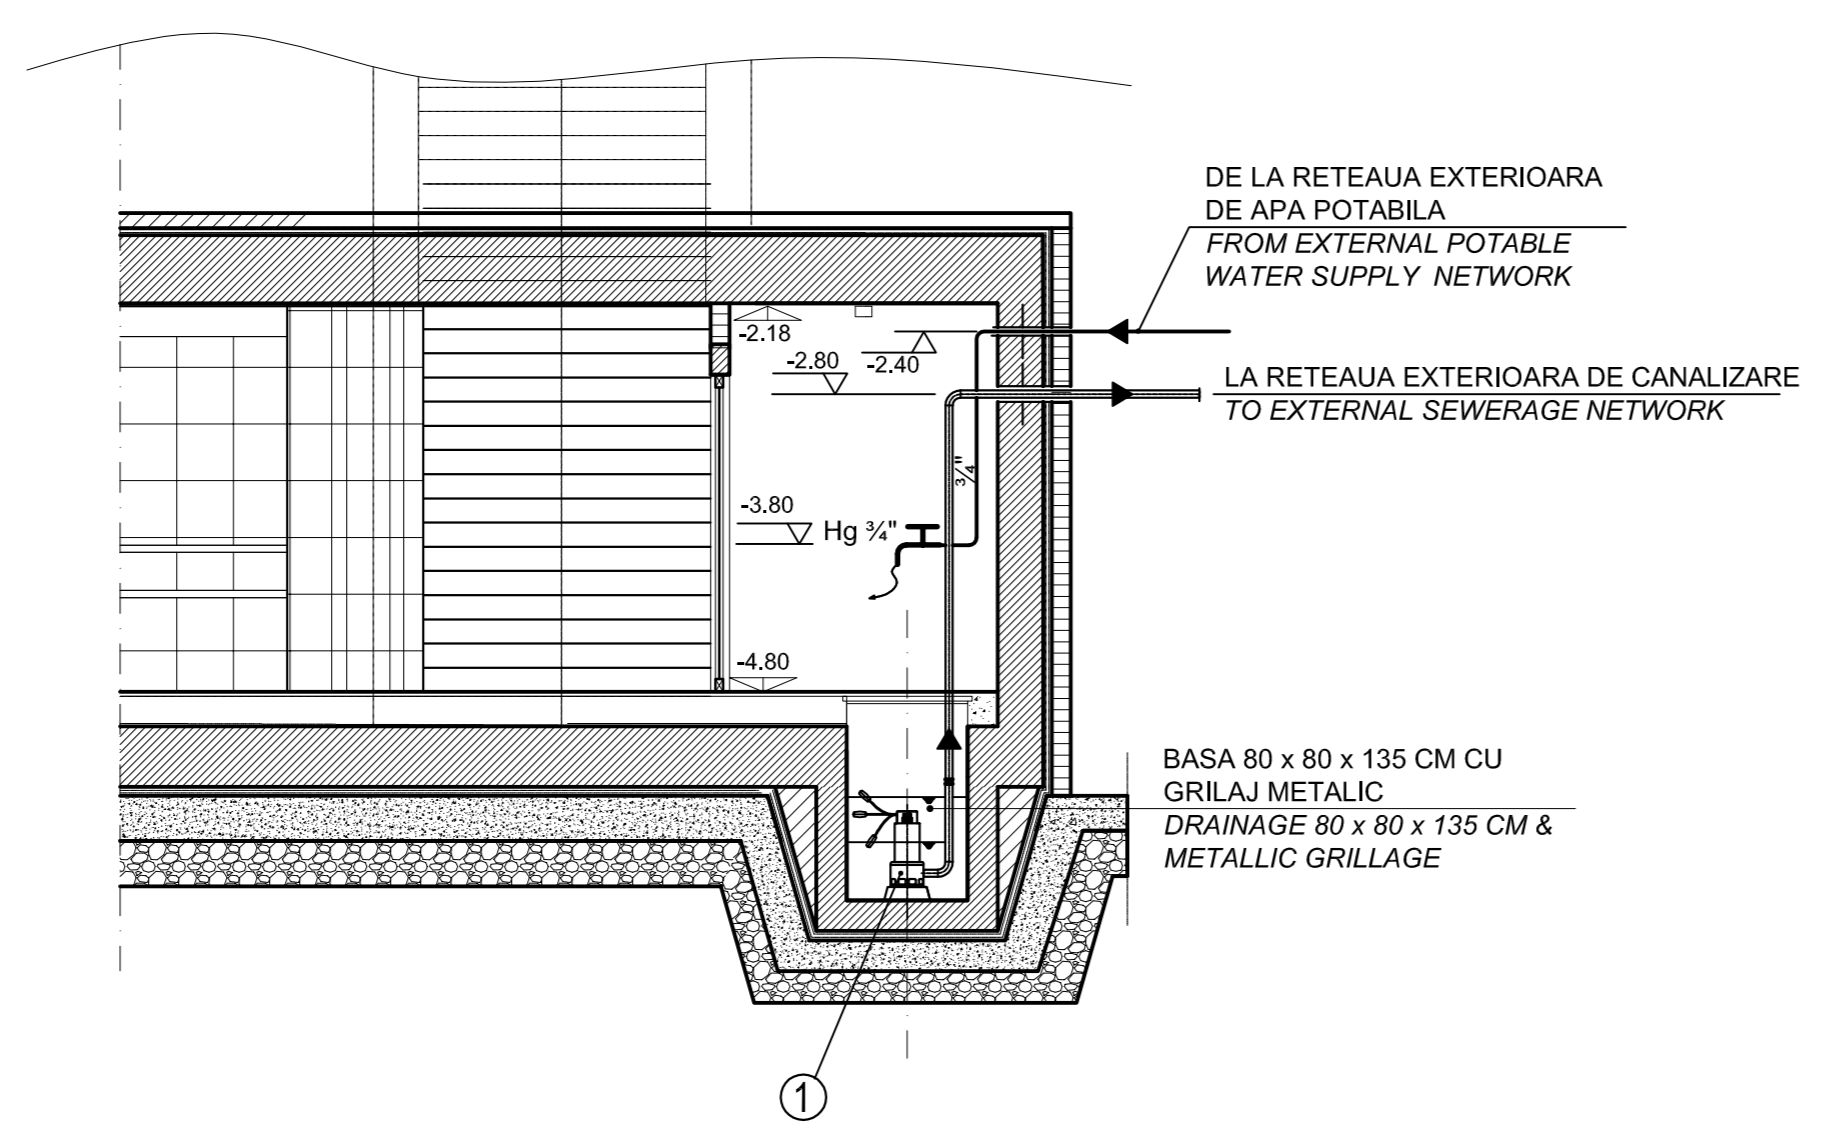

LEGENDA :

- TRASEU DE APA POTABILA, DIN TEAVA DE OTEL ZINCATA, 1/4"
- TRASEU APA DE SPALARE SUB PRESIUNE, DIN TEAVA DE OTEL, Dn 50
- Hg 1/4" ROBINET PENTRU HIDRANT DE GRADINA, 1/4".
- PTE 28 PIESA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 28 mm
- PTE 60 PIESA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 60 mm
- ① ELECTROPOMPA SUBMERSIBILA DE EPUISEMENT, CU PLUTITOR, Q = 3 m³/h, h = 13 mCA, N = 1,38 kW.

LEGEND :

- PATH OF DRINKING WATER, FROM GALVANIZED STEEL PIPE, 1/4"
- PATH OF THE WATER PRESSURE WASHING, FROM STEEL PIPE, DN 50
- Hg 1/4" TAP FOR GARDEN HYDRANT, 1/4" DIAMETER.
- PTE 28 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 28 mm
- PTE 60 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 60 mm
- ① OVERDRIVING IMMERSION ELECTRIC FLOATING PUMP, Q = 3 m³/h, H = 13 mWC, N = 1.38 kW.

* CATEGORIA DE IMPORTANTA "C" NORMALA, CALITATEA LUCRARILOR ASIGURANDU-SE DUPA MODELUL 3.

* CERINTA DE CALITATE A EXIGENTELOR ESENTIALE - DIN H.G. 925/95 - ESTE IS .

* IMPORTANCE CATEGORY: "C" - NORMAL, THE WORKS QUALITY BEING ENSURED BASED ON MODEL 3.

* THE QUALITY REQUIREMENT OF ESSENTIAL DEMANDS IN H.G. 925/95 IS IS .

D					
C					
B					
A					
Indice	Data	Modificare	Proiectant	Aprobat Consultant	Aprobat CFR

GUVERNUL ROMANIEI ROMANIAN GOVERNMENT
 PROIECT FINANAT DE UNIUNEA EUROPEANA EUROPEAN UNION FINANCED PROJECT

C.N.C.F. "C.F.R." - S.A.

GRUPPO FERROVIE DELLO STATO Joint Venture leader

 PLANEN + BERATSH GmbH
 Consulting Engineers

CONSULTANT / CONSULTANT			Data	Semnatura
Aprobat	Şef proiect	R. Liuzza		
Aprobat	Coordonator Sectiune 1	C. Gambelli		
Verificat	Expert Verificator	Giuseppe Fioravanti		

SUBCONTRACTANT / SUBCONTRACTOR				
Aprobat	Responsabil Subcontractant	A. Stanciu - Dinulescu		
Intocmit	Proiectant	Florian Duta		

Reabilitarea liniei de cale ferata Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulaţia trenurilor cu viteză maximă de 160 km/h, Tronsoanel: Braşov - Sighişoara

Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section : Braşov - Sighişoara

Project/Project 2004/RO/16/PPA/003

Faza / Phase: P.Th. / T.D.

Denumire desen / Drawing Title : STATA CF FELDIOARA. TUNEL PIETONAL. INSTALATII HIDRAULICE. PLAN SI SECTIUNE "C - C". FELDIOARA RAILWAY STATION. PEDESTRIAN TUNNEL. HYDRAULIC INSTALLATION. BASEMENT PLAN AND "C - C SECTION".

Codificare / Codification System	Scara / Scale 1 : 50	LOT / LOT	Nr. / No 01 / 01
E A 5 1 0 1 C 0 7 P B I S 0 0 3 4 0 1 0 0			