


EXECUTAREA LUCRARILOR DE MONTAJ A INSTALATIEI SANITARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTUI TIP DE LUCRARI

THE EXECUTION OF THE FIXING WORKS FOR SANITARY INSTALLATION WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPE OF WORKS.

Sectione "C - C"
Section "C - C"

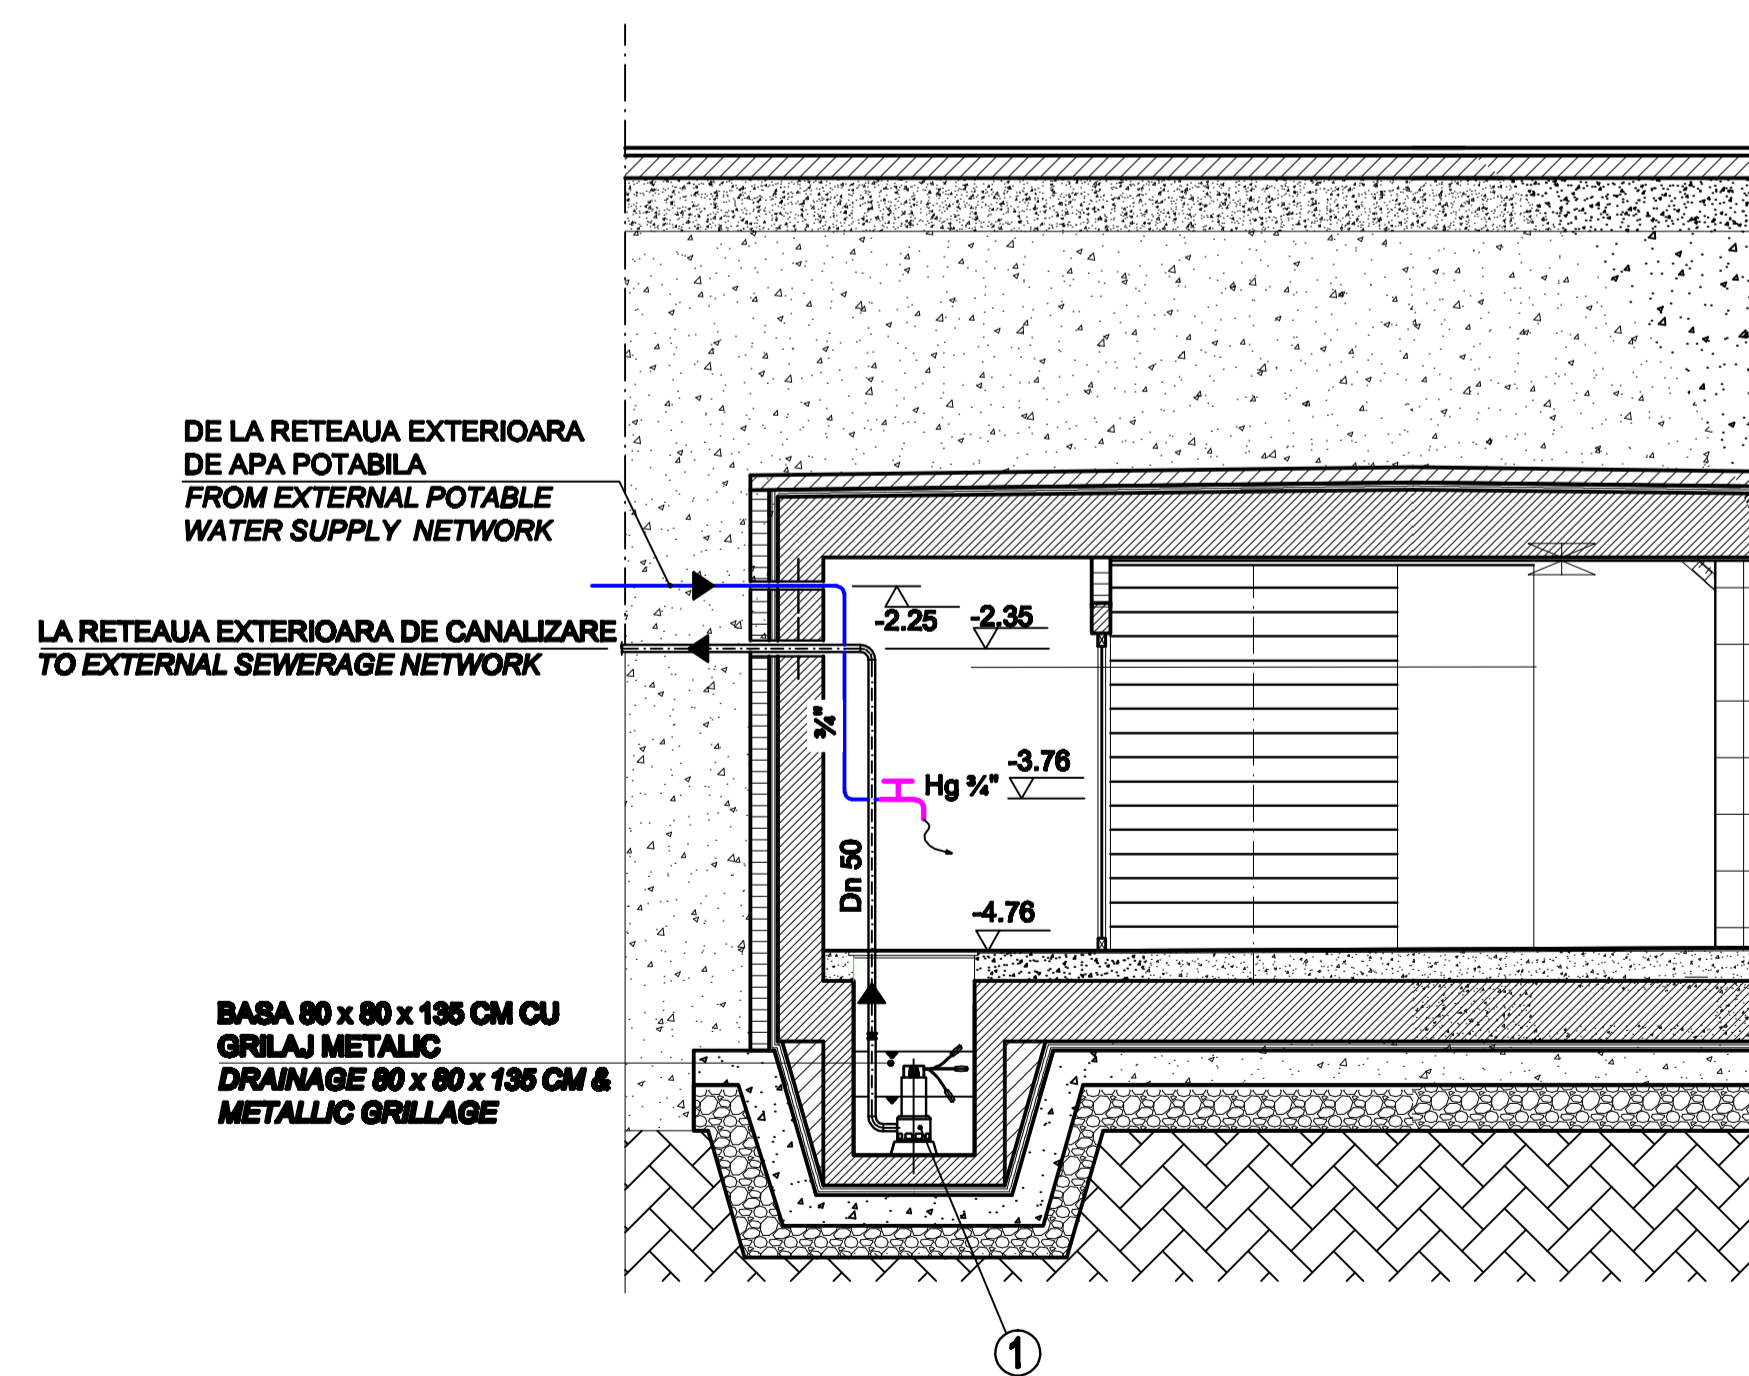

LEGENDA :

- TRASEU DE APA POTABILA, DIN TEAVA DE OTEL ZINCATA, 1/2"
- TRASEU APA DE SPALARE SUB PRESIUNE, DIN TEAVA DE OTEL, Dn 60
- Hg 1/2" ROBINET PENTRU HIDRANT DE GRADINA, 1/2".
- PTE 28 PIESA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 28 mm
- PTE 60 PIESA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 60 mm
- ① ELECTROPOMPA SUBMERSIBILA DE EPUIJMENT, CU PLUTITOR, Q = 3 m³/h, h = 13 mCA, N = 1,38 kW.

LEGEND :

- PATH OF DRINKING WATER, FROM GALVANIZED STEEL PIPE, 1/2"
- PATH OF THE WATER PRESSURE WASHING, FROM STEEL PIPE, DN 60
- Hg 1/2" TAP FOR GARDEN HYDRANT, 1/2" DIAMETER.
- PTE 28 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 28 mm
- PTE 60 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 60 mm
- ① OVERDRIVING IMMERSION ELECTRIC FLOATING PUMP, Q = 3 m³/h, H = 13 mWC, N = 1.38 kW.

* CATEGORIA DE IMPORTANTA "C" NORMALA, CALITATEA LUCRARILOR ASIGURANDU-SE DUPA MODELUL 3.
 * CERINTA DE CALITATE A EXIGENTELOR ESENTIALE - DIN H.G. 925/95 - ESTE **is** .
 * IMPORTANCE CATEGORY: "C" - NORMAL, THE WORKS QUALITY BEING ENSURED BASED ON MODEL 3.
 * THE QUALITY REQUIREMENT OF ESSENTIAL DEMANDS IN H.G. 925/95 IS **is** .

D					
C					
B					
A					
Indice	Data	Modificari	Proiectant	Aprobat Consultant	Aprobat CFR
		Modificator/Revizor	Designer	Approved Consultant	Approved CFR
GUVERNUL ROMANIEI ROMANIAN GOVERNMENT		PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ EUROPEAN UNION FINANCED PROJECT			

C.N.C.F. "C.F.R." - S.A.
 CLIENT / CLIENT

CONSULTANT / CONSULTANT			Data	Semnatura
Aprobat	Șef proiect	R. Luzzza		
Approved	Project manager			
Aprobat	Coordonator Secțiune 1	C. Gambelli		
Approved	Section 1 Coordinator			
Verificat	Expert Verificator	Giuseppe Fioravanti		
Checked	Verifier Expert			

SUBCONTRACTANT / SUBCONTRACTOR		
Aprobat	Responsabil Subcontractant	A. Stanclu - Dinulescu
Approved	Subcontractant Responsible	
Elaborat	Proiectant	Florian Duta
Elaborated	Designer	

Reabilitarea liniei de cale ferată Braşov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h, Tronsoanel: Braşov - Sighisoara
 Rehabilitation of the railway line Braşov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section: Braşov - Sighisoara
 Project/Project 2004/RO16/PPA/003
 Faşa / Phase: P.Th. / T.D.

Denumire desen / Drawing Title :
 STATION CF APATA. TUNEL PIETONAL. INSTALATII HIDRAULICE. PLAN SI SECTIUNE "C - C".
 APATA RAILWAY STATION. PEDESTRIAN TUNNEL. HYDRAULIC INSTALLATION.
 BASEMENT PLAN AND "C - C SECTION".

Codificare / Codification System	Scara / Scale 1 : 50	Lot / Lot	Nr. / No 01 / 01
E A 5 1 0 1 C 0 9 P B I S 0 0 4 4 0 1 0 0			