


EXECUTAREA LUCRARILOR DE MONTAJ A INSTALATIEI SANITARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTUI TIP DE LUCRARI

THE EXECUTION OF THE FIXING WORKS FOR SANITARY INSTALLATION WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPE OF WORKS.

Sectione "C - C"
Section "C - C"

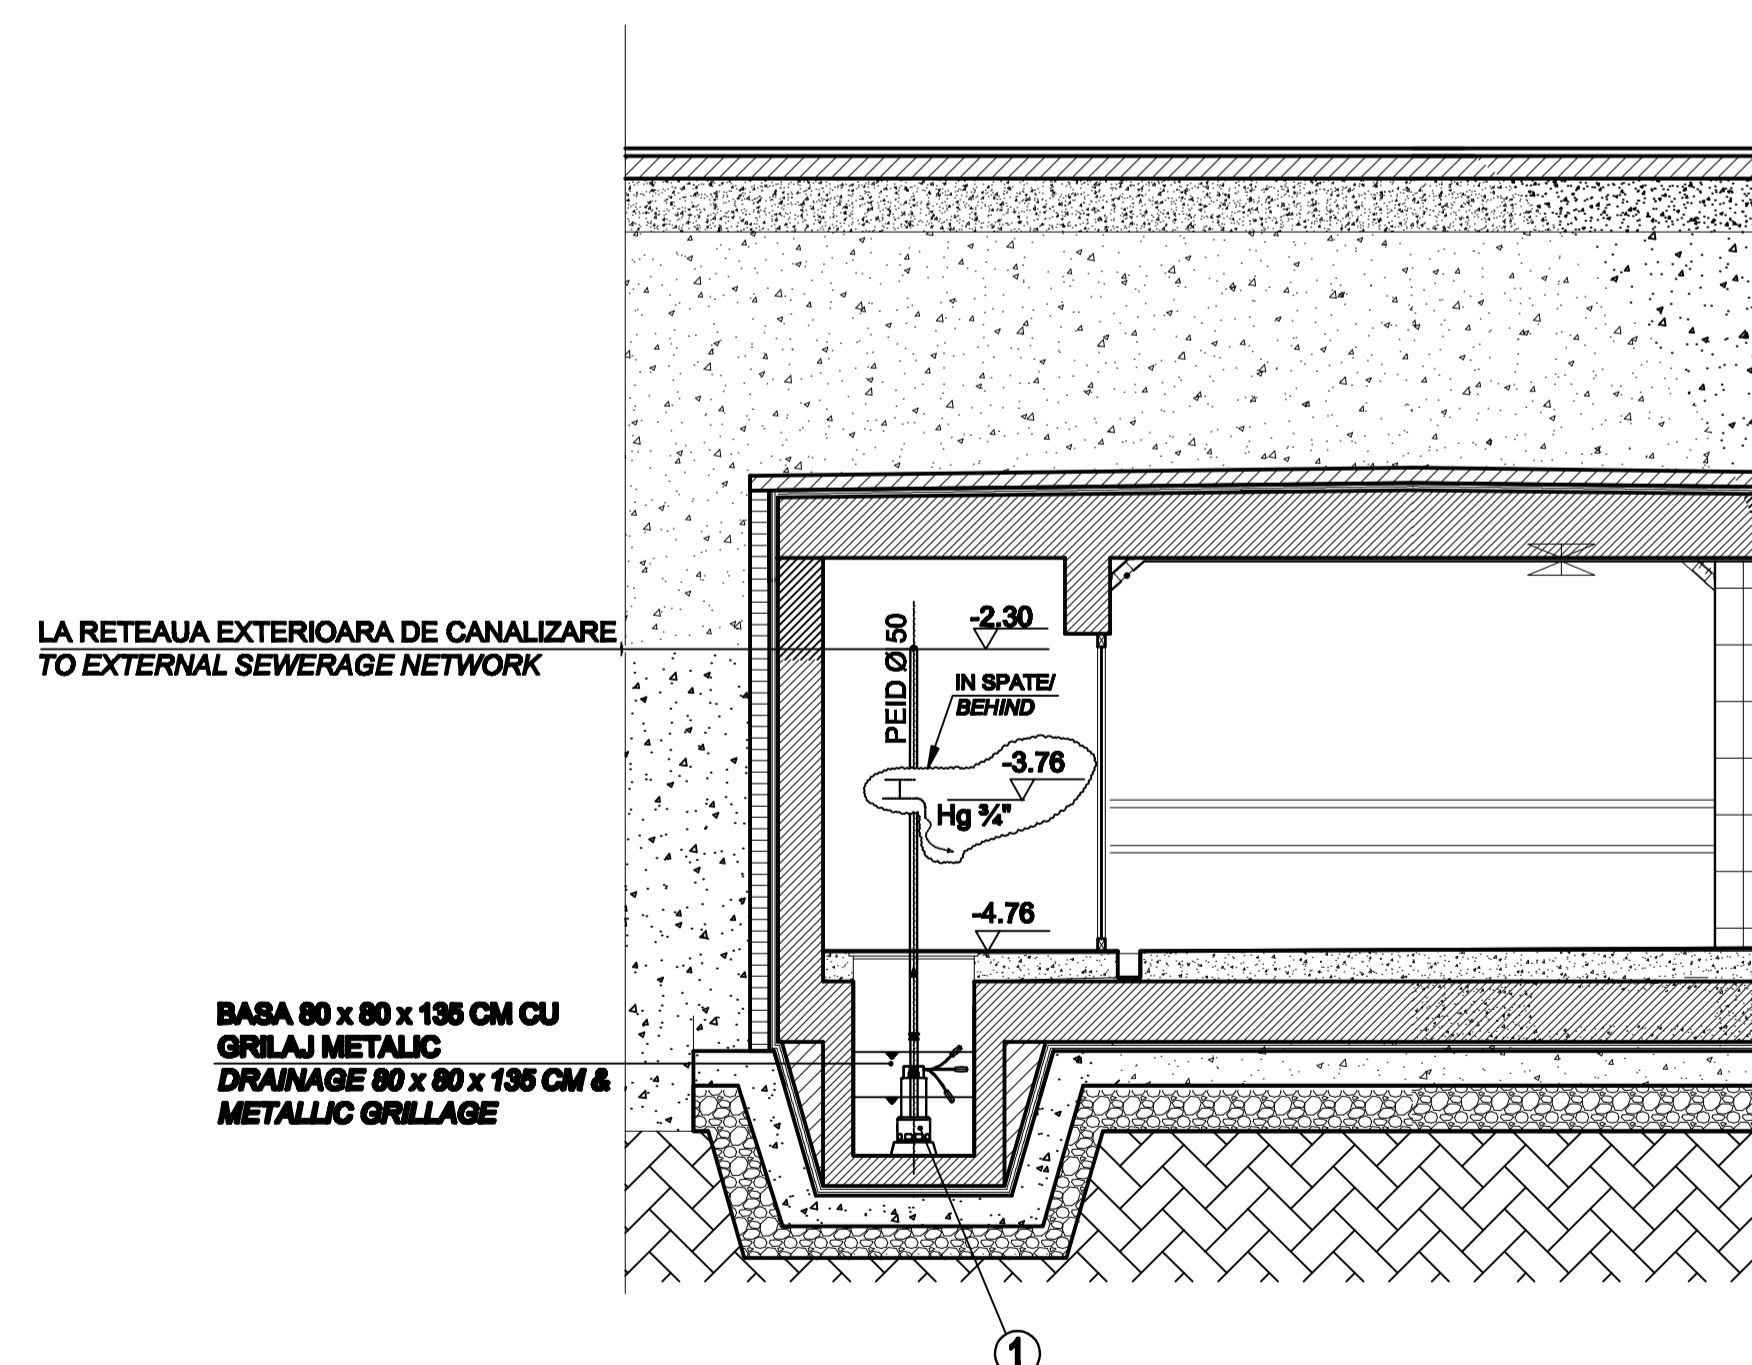

LEGENDA :

- TRASEU DE APA POTABILA, DIN TEAVA DE OTEL ZINCATA, 3/4"
- TRASEU APA DE SPALARE SUB PRESIUNE, DIN TEAVA DE OTEL, Dn 60
- Hg 3/4" ROBINET PENTRU HIDRANT DE GRADINA, 3/4".
- PTE 28 PIESA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 28 mm
- PTE 60 PIESA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 60 mm
- ① ELECTROPOMPA SUBMERSIBILA DE EPUIZMENT, CU PLUTITOR, Q = 3 m³/h, h = 13 mCA, N = 1,38 kW.

LEGEND :

- PATH OF DRINKING WATER, FROM GALVANIZED STEEL PIPE, 3/4"
- PATH OF THE WATER PRESSURE WASHING, FROM STEEL PIPE, DN 60
- Hg 3/4" TAP FOR GARDEN HYDRANT, 3/4" DIAMETER.
- PTE 28 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 28 mm
- PTE 60 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 60 mm
- ① OVERDRIVING IMMERSION ELECTRIC FLOATING PUMP, Q = 3 m³/h, H = 13 mWC, N = 1.38 kW.

* CATEGORIA DE IMPORTANTA "C" NORMALA, CALITATEA LUCRARILOR ASIGURANDU-SE DUPA MODELUL 3.
 * CERINTA DE CALITATE A EXIGENTELOR ESENTIALE - DIN H.G. 925/95 - ESTE IS.
 * IMPORTANCE CATEGORY: "C" - NORMAL, THE WORKS QUALITY BEING ENSURED BASED ON MODEL 3.
 * THE QUALITY REQUIREMENT OF ESSENTIAL DEMANDS IN H.G. 925/95 IS IS.

D					
C					
B					
A					
Indice	Data	Modificari	Proiectant	Aprobat Consultant	Aprobat CFR
		Modification/Revizii	Designer	Approved Consultant	Approved CFR

GUVERNUL ROMANIEI ROMANIAN GOVERNMENT
 PROIECT FINANȚAT DE UNIUNEA EUROPEANA ȚI EUROPEAN UNION FINANCED PROJECT

CFR C.N.C.F. "C.F.R." - S.A.

CLIENT / CLIENT
ITALFERR GRUPPO FERROVIE DELLO STATO Joint Venture leader
OBERMEYER PLANEN + BERATEN GmbH
TECNIC Consulting Engineers

CONSULTANT / CONSULTANT		Date	Semnatura
Aprobat	Responsabil	Date	Signature
Aprobat	Șef proiect	DEC. 2011	[Signature]
Aprobat	Coordonator Secțiune 1	DEC. 2011	[Signature]
Verificat	Expert Verificator	DEC. 2011	[Signature]

SUBCONTRACTANT / SUBCONTRACTOR		Date	Semnatura
Aprobat	Responsabil	Date	Signature
Aprobat	Responsabil Subcontractant	DEC. 2011	[Signature]
Intocmit	Proiectant	DEC. 2011	[Signature]

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h, Tronsoanel: Brașov - Sighisoara
 Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section: Brașov - Sighisoara

Denumire desen / Drawing Title :
 STATIA CF RACOS. TUNEL PIETONAL. INSTALATII HIDRAULICE. PLAN SI SECTIUNE "C - C".
 RACOS RAILWAY STATION. PEDESTRIAN TUNNEL. HYDRAULIC INSTALLATION. BASEMENT PLAN AND "C - C SECTION".

Codificare / Codification System	Scara / Scale	Lot/Lot	Nr./No
E A 5 1 0 1 C 1 1 P B 1 S 0 0 5 4 0 1 0 1	1 : 50		01 / 01