


EXECUTAREA LUCRARILOR DE MONTAJ A INSTALATIEI SANITARE SE VA FACE CU RESPECTAREA PRESCRIPTIILOR DIN CAIETELE DE SARCINI SPECIFICE ACESTUI TIP DE LUCRARI

THE EXECUTION OF THE FIXING WORKS FOR SANITARY INSTALLATION WILL BE CARRIED OUT ACCORDING TO THE PROVISIONS OF THE TECHNICAL SPECIFICATIONS THAT ARE INTENDED FOR THIS TYPE OF WORKS.

Sectione "C - C"
Section "C - C"

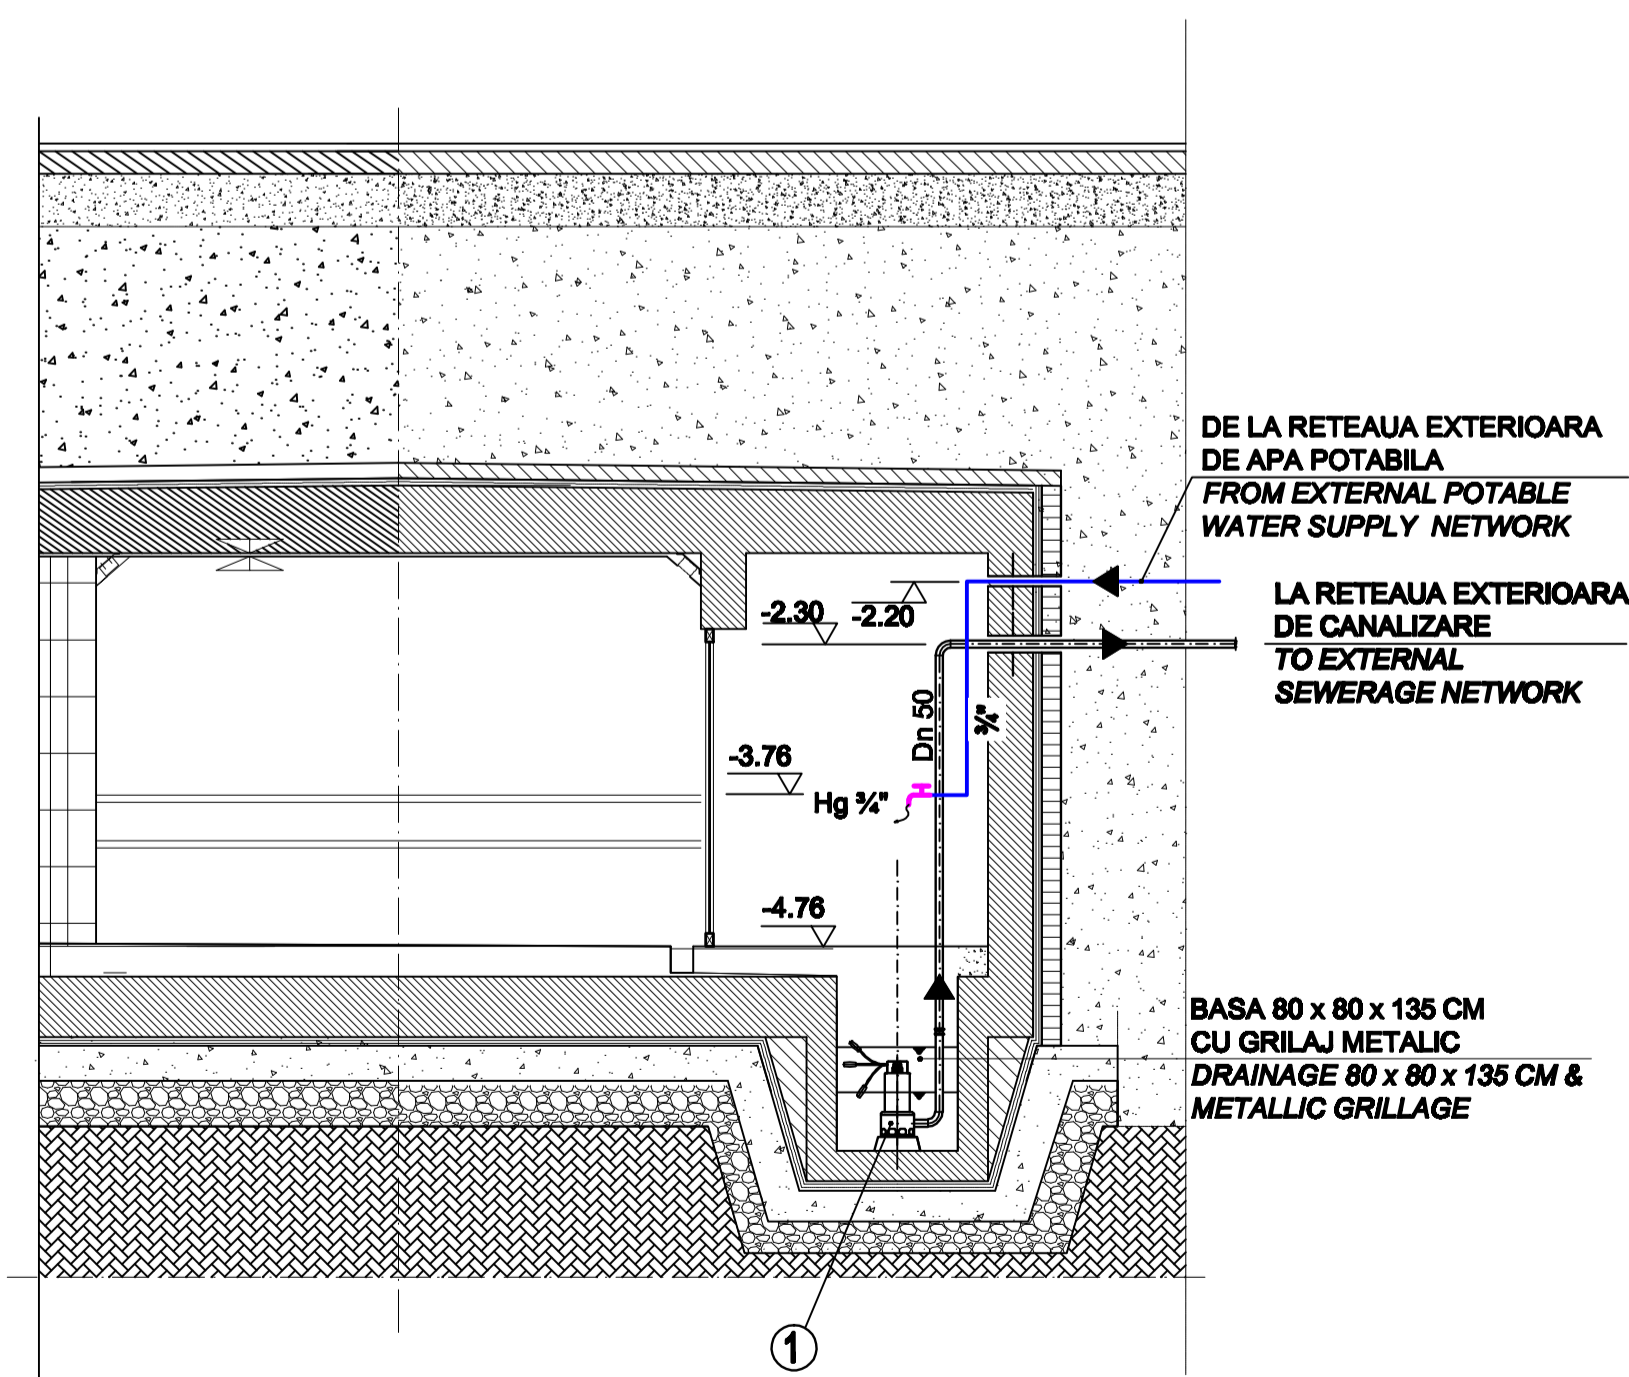

LEGENDA :

- TRASEU DE APA POTABILA, DIN TEAVA DE OTEL ZINCATA, 1/2"
- TRASEU APA DE SPALARE SUB PRESIUNE, DIN TEAVA DE OTEL, Dn 80
- Hg 1/2" ROBINET PENTRU HIDRANT DE GRADINA, 1/2".
- PTE 28 PIEASA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 28 mm
- PTE 60 PIEASA DE TRECERE ETANSA PRIN PERETI, IN SPATII UMEDE, Ø 60 mm
- ① ELECTROPOMPA SUBMERSIBILA DE EPUISEMENT, CU PLUTITOR, Q = 3 m³/h, h = 13 mCA, N = 1,38 kW.

LEGEND :

- PATH OF DRINKING WATER, FROM GALVANIZED STEEL PIPE, 1/2"
- PATH OF THE WATER PRESSURE WASHING, FROM STEEL PIPE, DN 80
- Hg 1/2" TAP FOR HYDRANT GARDEN, 1/2".
- PTE 28 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 28 mm
- PTE 60 THE SEALED ASSEMBLY BY CROSSING WALLS, IN WET SPACES, Ø 60 mm
- ① OVERDRIVING IMMERSION ELECTRIC FLOATING PUMP, Q = 3 cm³/h, H = 13 mWC, N = 1.38 kW.

- * CATEGORIA DE IMPORTANTA "C" NORMALA, CALITATEA LUCRARILOR ASIGURANDU-SE DUPA MODELUL 3.
- * CERINTA DE CALITATE A EXIGENTELOR ESENTIALE - DIN H.G. 925/95 - ESTE **Is**.
- * IMPORTANCE CATEGORY: "C" - NORMAL, THE WORKS QUALITY BEING ENSURED BASED ON MODEL 3.
- * THE QUALITY REQUIREMENT OF ESSENTIAL DEMANDS IN H.G. 925/95 IS **Is**.

D					
C					
B					
A					
Indice	Data	Modificari	Proiectant	Aprobat	Aprobat CFR
		Modificari	Designer	Approved	Approved CFR
		Modificari/Revision		Consultant	Approved

GUVERNUL ROMANIEI / ROMANIAN GOVERNMENT
 PROIECT FINANȚAT DE UNIUNEA EUROPEANĂ / EUROPEAN UNION FINANCED PROJECT

CFR
 C.N.C.F. "C.F.R." - S.A.

CLIENT / CLIENT

ITALFERR GRUPPO FERROVIE DELLO STATO
 OBERMEYER PLANEN + BERATEN GmbH
 TECNIC Consulting Engineers

CONSULTANT / CONSULTANT		Data	Semnatura
Aprobat	Șef proiect		R. Liuzza
Aprobat	Coordonator Secțiune 1		C. Gambelli
Verificat	Expert Verificator		Giuseppe Fioravanti

SUBCONTRACTANT / SUBCONTRACTOR		Data	Semnatura
Aprobat	Responsabil Subcontractant		A. Stanoku - Diruleacu
Elaborat	Proiectant		Florian Duta

Reabilitarea liniei de cale ferată Brașov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h, Tronsoanel: Brașov - Sighisoara
 Rehabilitation of the railway line Brașov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section: Brașov - Sighisoara

Denumire desen / Drawing Title:
 STATION CF ALBESTI. TUNEL PIETONAL. INSTALATII HIDRAULICE. PLAN SI SECTIUNE "C - C".
 ALBESTI RAILWAY STATION. PEDESTRIAN TUNNEL. HYDRAULIC INSTALLATION. BASEMENT PLAN AND "C - C SECTION".

Codificare / Codification System	Scara / Scale	LOT / LOT	Nr. / No
E A 5 1 0 1 C 1 9 P B I S 0 0 9 4 0 1 0 0	1 : 60		01 / 01