


LEGENDA:

- V Ventilator de introducere aer Q= 35500mc/h, H =10mmCA.
- RE Racord elastic.
- RJM Rama cu jaluzele mobile.
- RPS Rama cu plasa de sarma.
- hp Inaltime de montare.

LEGEND:

- V Air inlet fan Q= 35500mc/h, H = 10mmCA.
- RE Flexible joint.
- RJM Air opening frame with mobile blinds.
- RPS Air opening frame with wire net.
- hp Mounting height

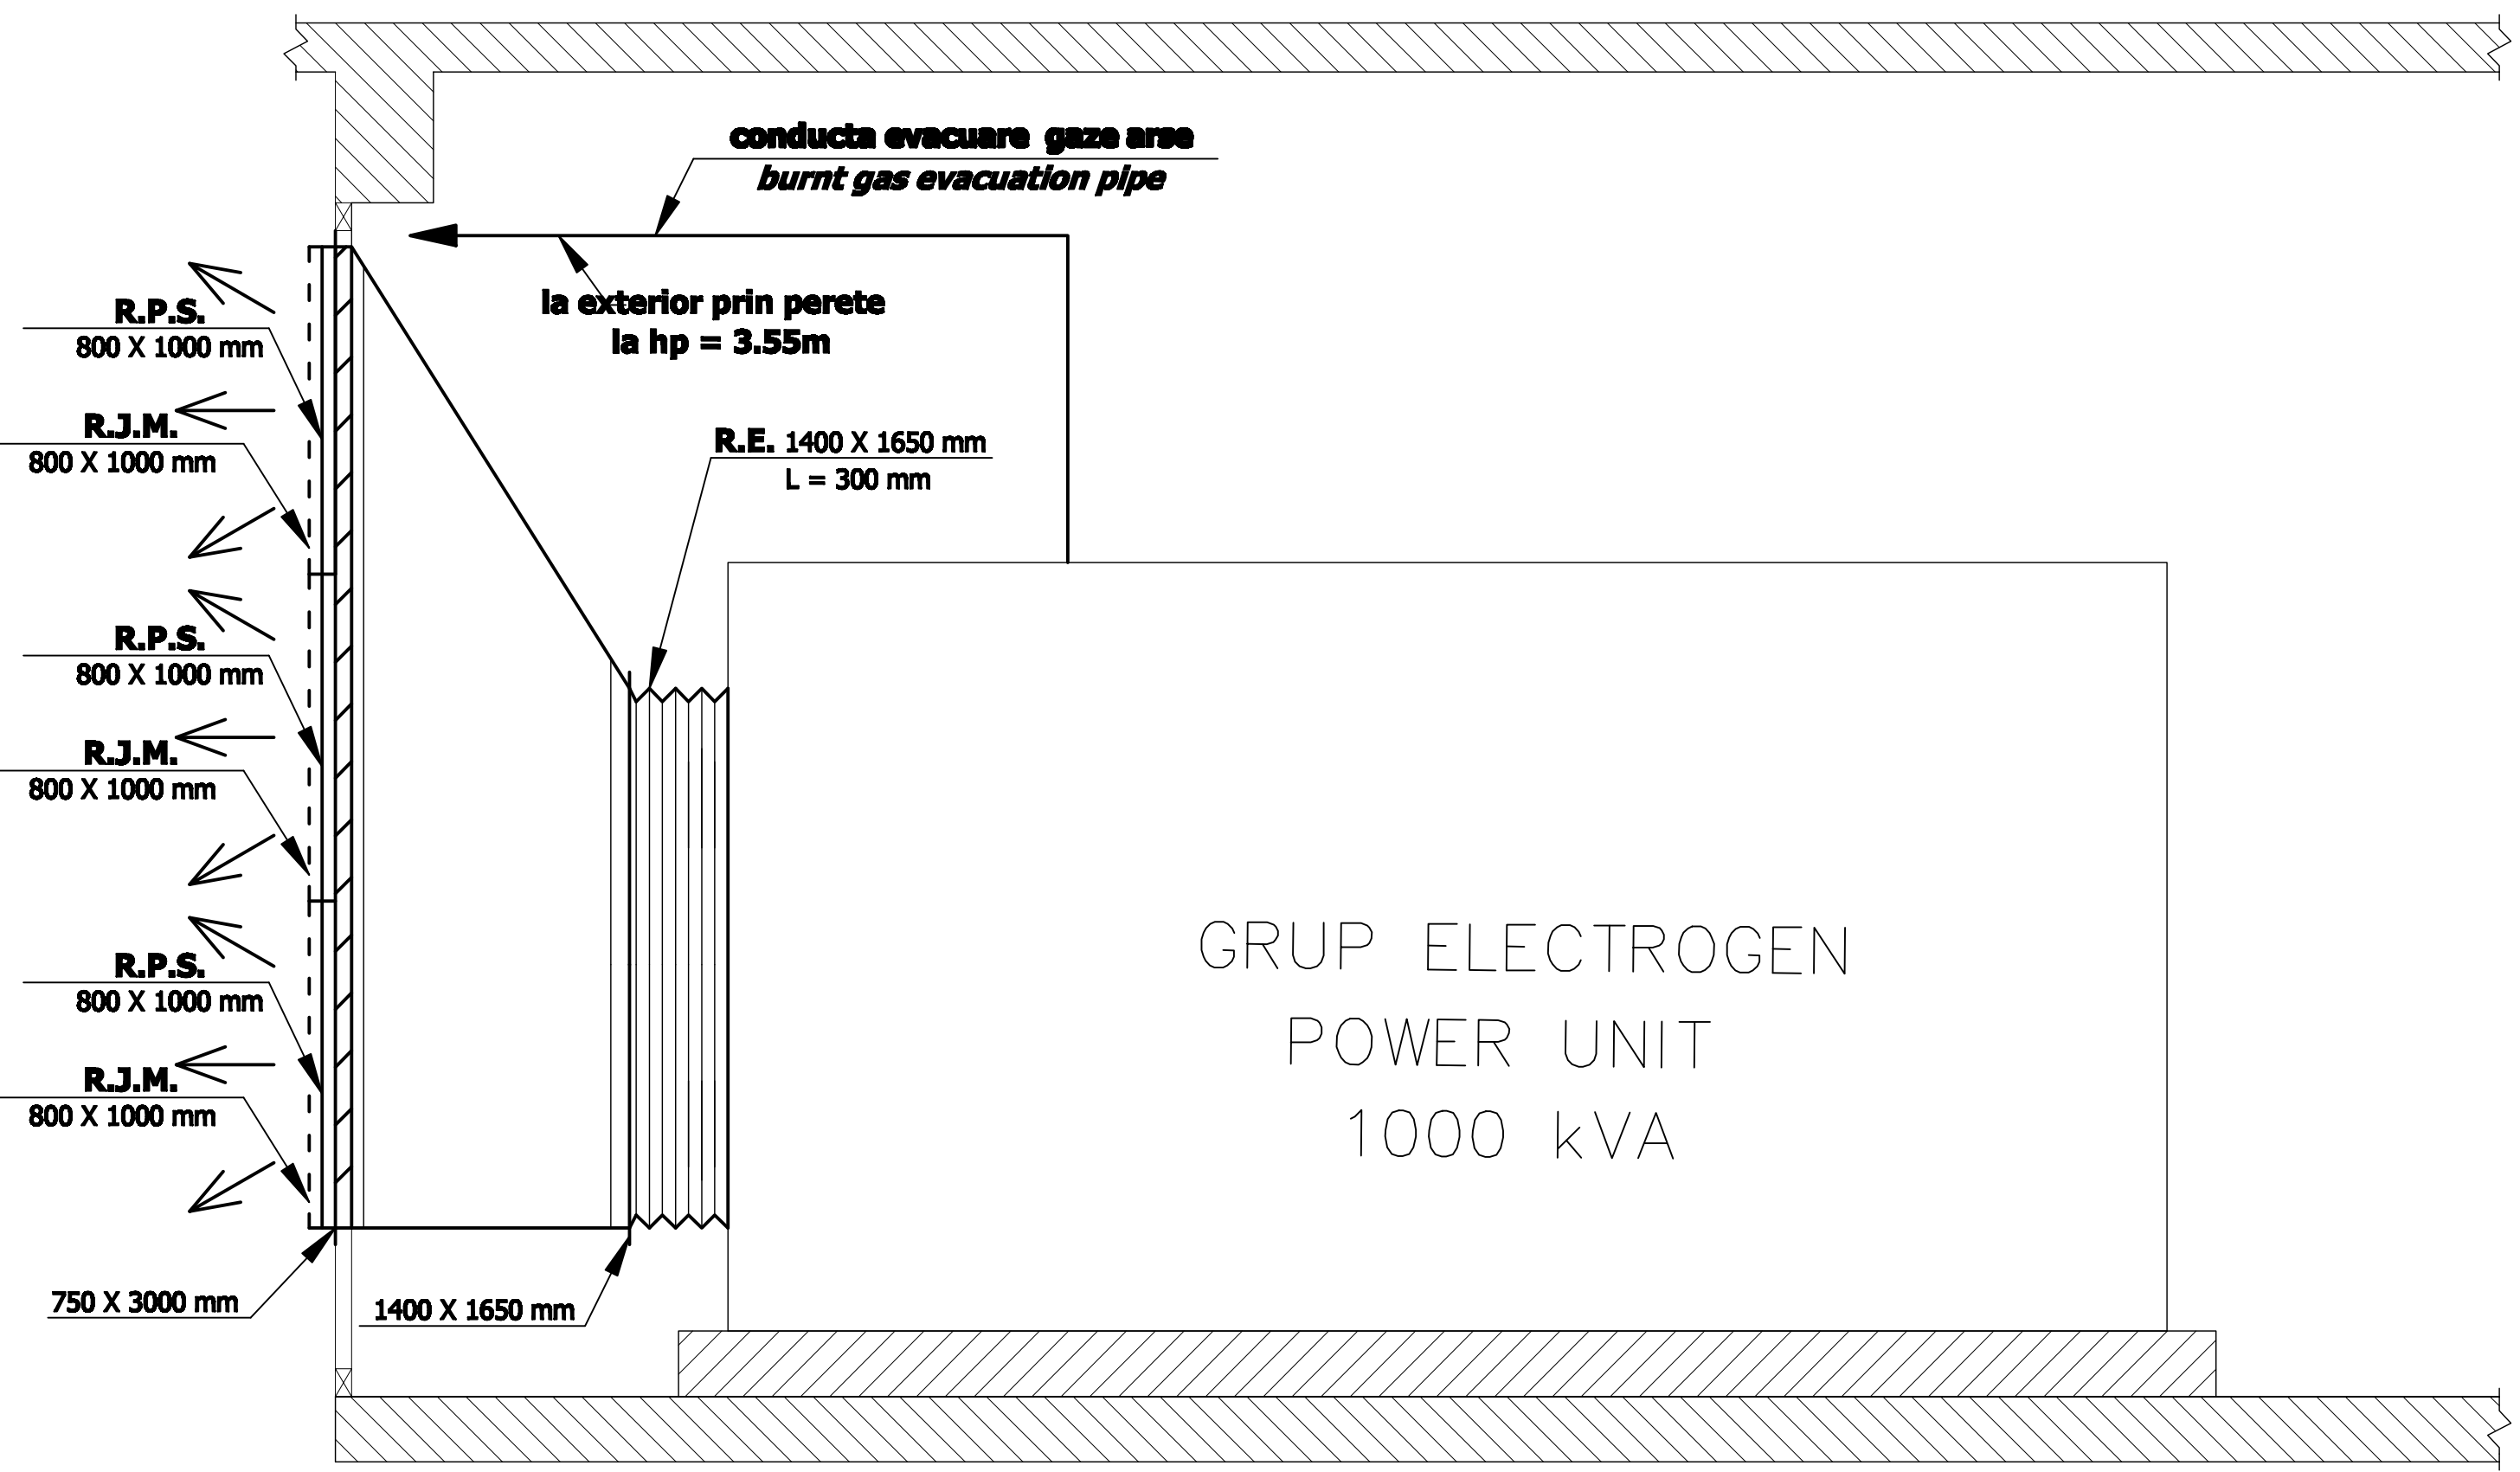

D					
C					
B					
A					
Index	Date	Modificari Modification/Revision	Proiectant Designer	Aprobat Consultant Approved Consultant	Aprobat CFR Approved CFR
		GUVERNUL ROMANIEI ROMANIAN GOVERNMENT		PROIECT FINANATAT DE UNIUNEA EUROPEANA EUROPEAN UNION FINANCED PROJECT	
CLIENT / CLIENT		C.N.C.F. "C.F.R." - S.A.			
GRUPPO FERROVIE DELLO STATO Joint Venture leader				PLANEN + BERATEN GmbH	
CONSULTANT / CONSULTANT				Data Date Semnatura Signature	
Aprobat Approved	Şef proiect Project manager	R. Lizza		DEC. 2011	
Aprobat Approved	Coordonator Secţiune 1 Section 1 Coordinator	C. Gambelli		DEC. 2011	
Verificat Checked	Expert Cheie Key Expert	Giuseppe Fioravanti		DEC. 2011	
SUBCONTRACTANT / SUBCONTRACTOR					
Aprobat Approved	Responsabil Subcontractant Subcontractant Responsible	A.Stancu - Dinulescu		DEC. 2011	
Intocmit Elaborated	Proiectant Designer	Valentin Radu		DEC. 2011	
Reabilitarea liniei de cale ferata Brasov - Simeria, parte componentă a coridorului IV Pan European, pentru circulația trenurilor cu viteză maximă de 160 km/h, Tronsoanel: Brasov - Sighişoara Rehabilitation of the railway line Brasov - Simeria, component Part of the IV Pan-European Corridor, for the trains circulation with maximum speed of 160 km/h, Section : Brasov - Sighişoara					Proiect/Project 2004/RO18/PPA003 Faza / Phase: P.Th. / T.D.
Denumire desen / Drawing Title : CLADIRE OCC BRASOV / OCC BRASOV BUILDING INSTALATII DE VENTILATIE LA GRUPUL ELECTROGEN / GENERATOR VENTILATION SYSTEMS.					
Codificare / Codification System		Scara / Scale 1:20		LOT / LOT	Nr. / No 01 / 01
E A 5 1		0 1 C		0 1 D B I V 0 0 2 9 0 1 1 0	