



SAFE AREA/ZONA SIGURA

EXTERNAL ELECTRICAL SUBSTATION W/I/V -  
STAIJA EXTREME ELECTRICITY W/ / JT

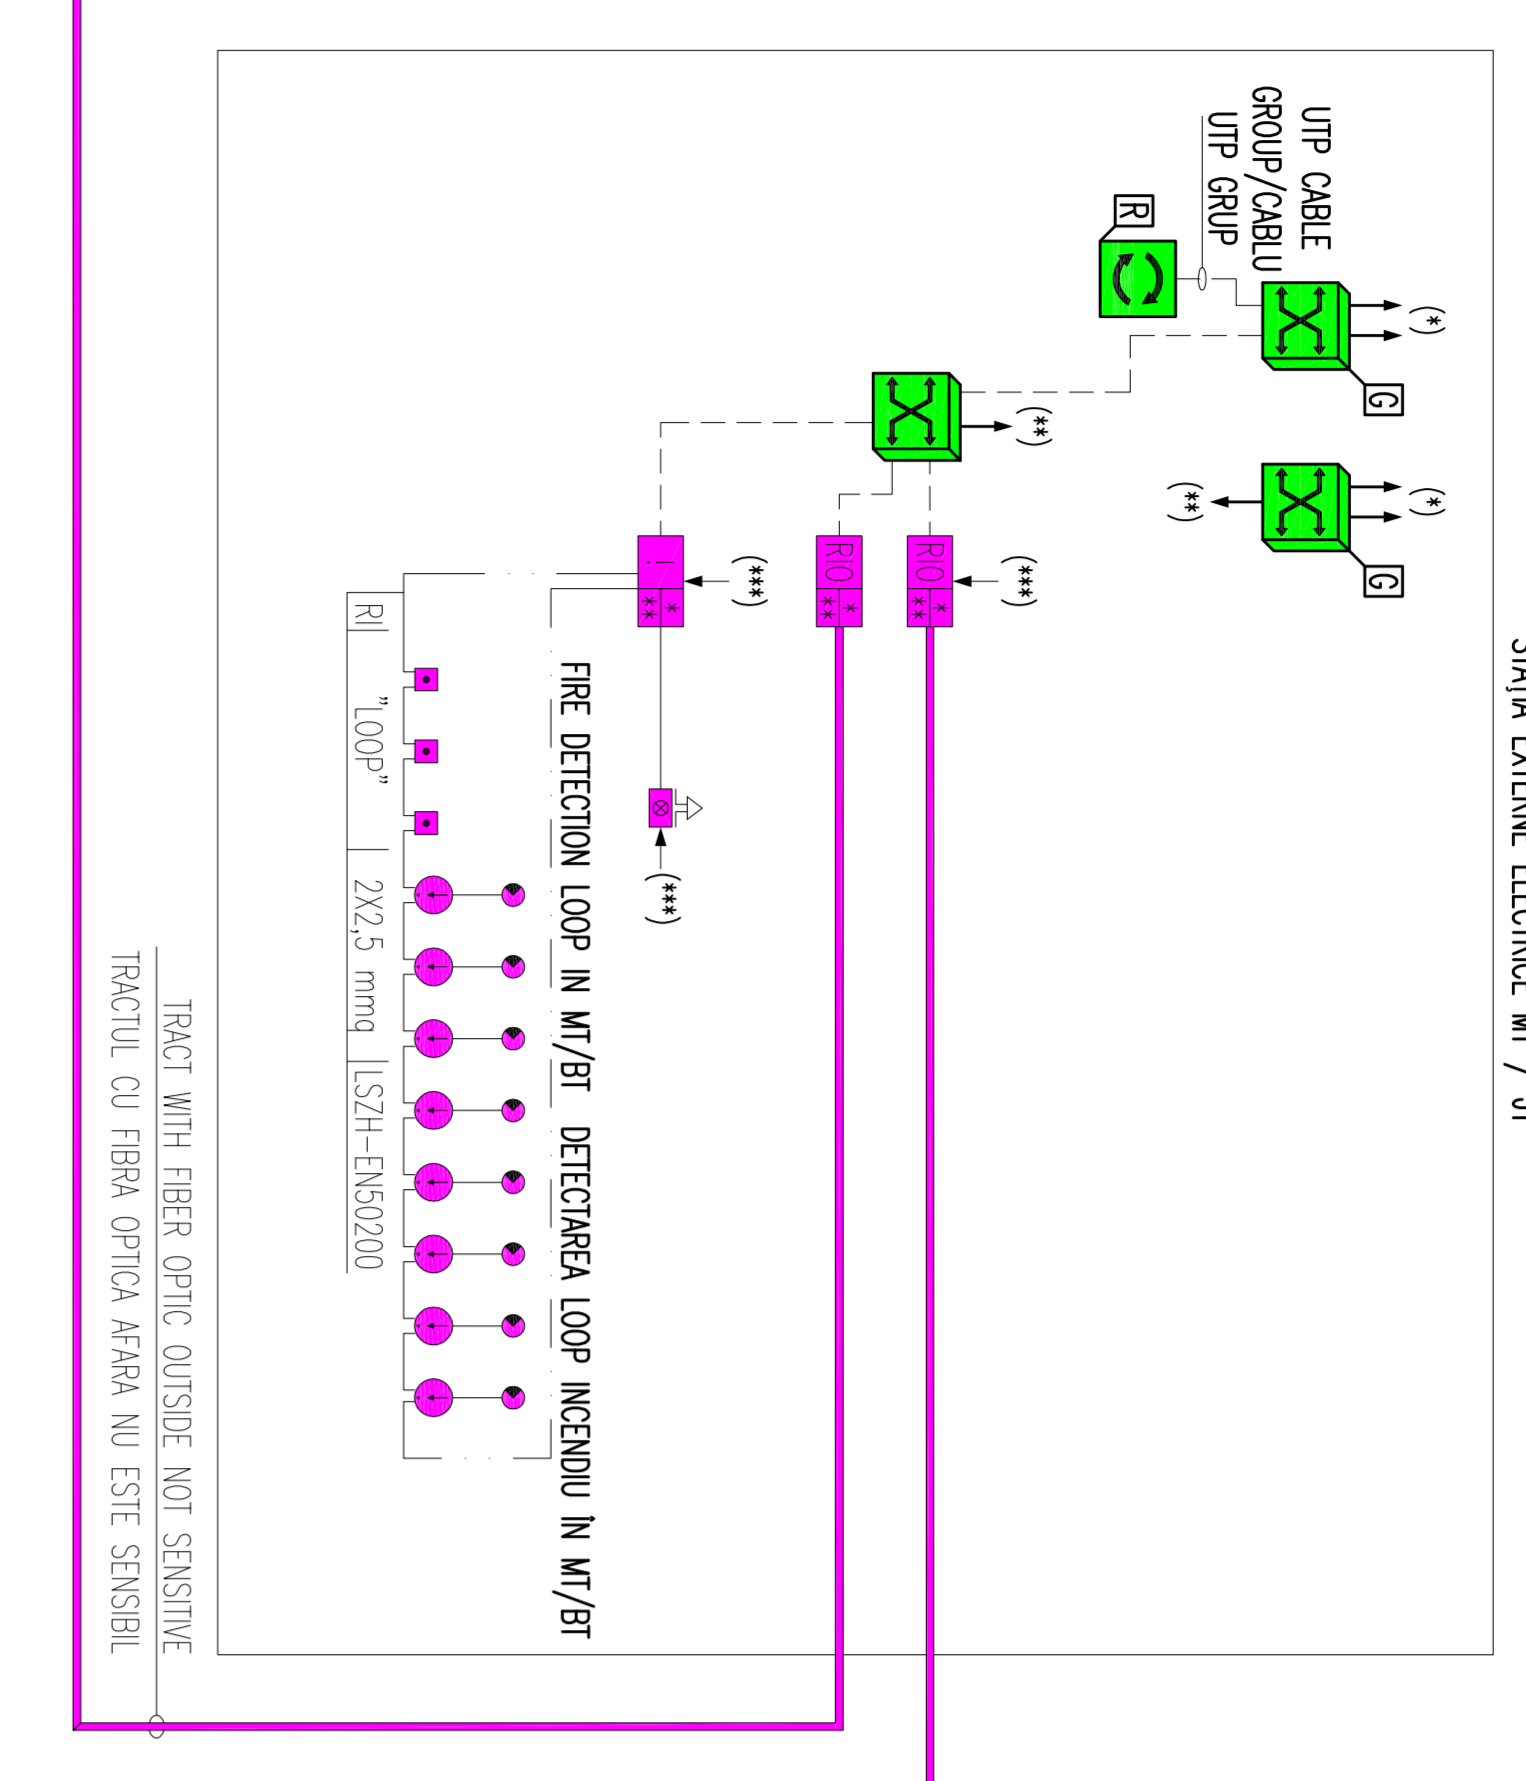

SAFE AREA/ZONA SIGURA

EXTERNAL ELECTRICAL SUBSTATION W/I/V -  
STAIJA EXTREME ELECTRICITY W/ / JT

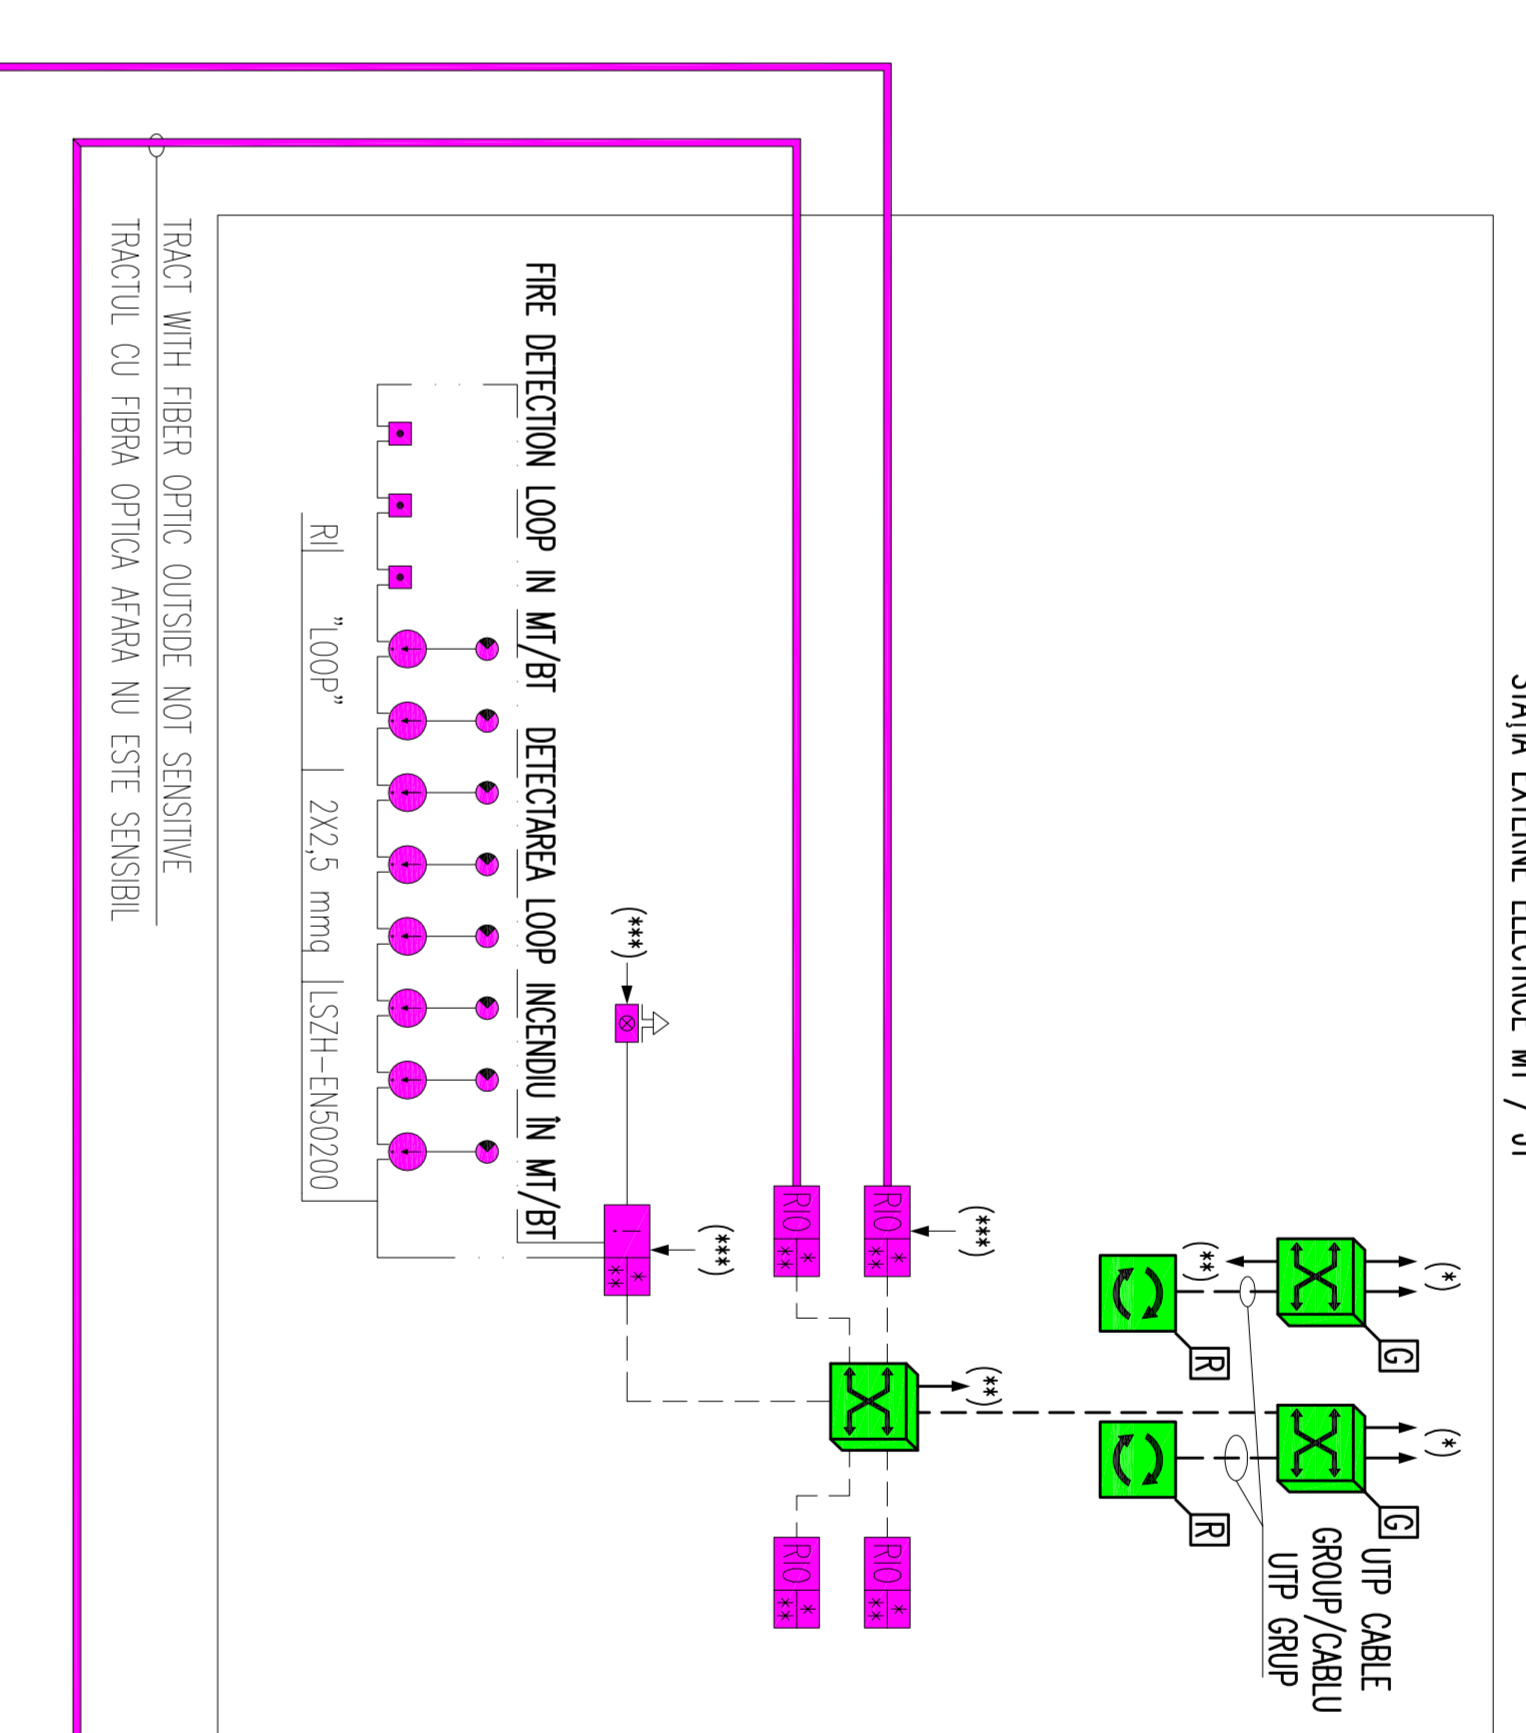

NETWORKS LEGEND / LEGENDA OBJECTIVE


- CABLE FIBER OPTIC SENSOR/CABLE FIBRA OPTICA SENZOR
- FIRE DETECTION LOOP/DE DETECTORA A INCENDIU LOOP
- ON ETHERNET CABLE CAT 6 UTP/ON CABLU ETHERNET CAT 6 UTP

SYMBOL LEGEND/LEGENDA SIMBOLURI

- ACTIVE EQUIPMENT/ACTIVE UTILAJE
- SWITCH MODE /SWITCH MOD
- GENERAL SWITCH TUNNEL NETWORK /SWITCH GENERAL TEDA DE TUNELURI
- POWER SUPPLY /ALIMENTARE
- CABLE UTP CAT 6/CABLE UTP cat 6
- FIBER OPTIC CABLE (MULTIMODE OM-3) / CABLU DE FIBRA (MULTIMODE OM-3)
- SMOKE DETECTION SENSOR/DETECTOR FUM SENSOR
- DOOR DETECTOR FOR LOCAL/REPAIRER OPTICAL OUT
- DOOR DETECTOR DE LOCALE
- CENTRAL FIRE DETECTOR A MAINTENANCE-BRSS-DE NEA
- LOCAL DE DETECTORA A MAINTENANCE-BRSS-DE NEA
- HANDRAIL FIRE ALARM BUTTON/MANINA DE ALARMARE INCENDIU BUTON
- FIRE ALARM WITH FLAMING FOR EXTERNAL/SENZA CU INTERNE DE EXTINGUERE
- OPTICAL SENSOR CABLE NUMBERING/NUMARAREA SENZOR CABLE

NOTE/NOTE:

- (1) CONNECTED TO THE EMERGENCY DATA NETWORK/CONECTAT LA REZEAUA DE DATE DE URGENJA
- (M) CONNECTED TO THE SAFE AREA EMERGENCY DATA NETWORK/CONECTAT LA REZEAUA DE DATE DE URGENJA DE SIGURA
- (\*\*\*) POWER SUPPLY Q.B7/008 / SURSA DE ALIMENTARE Q.B7/008

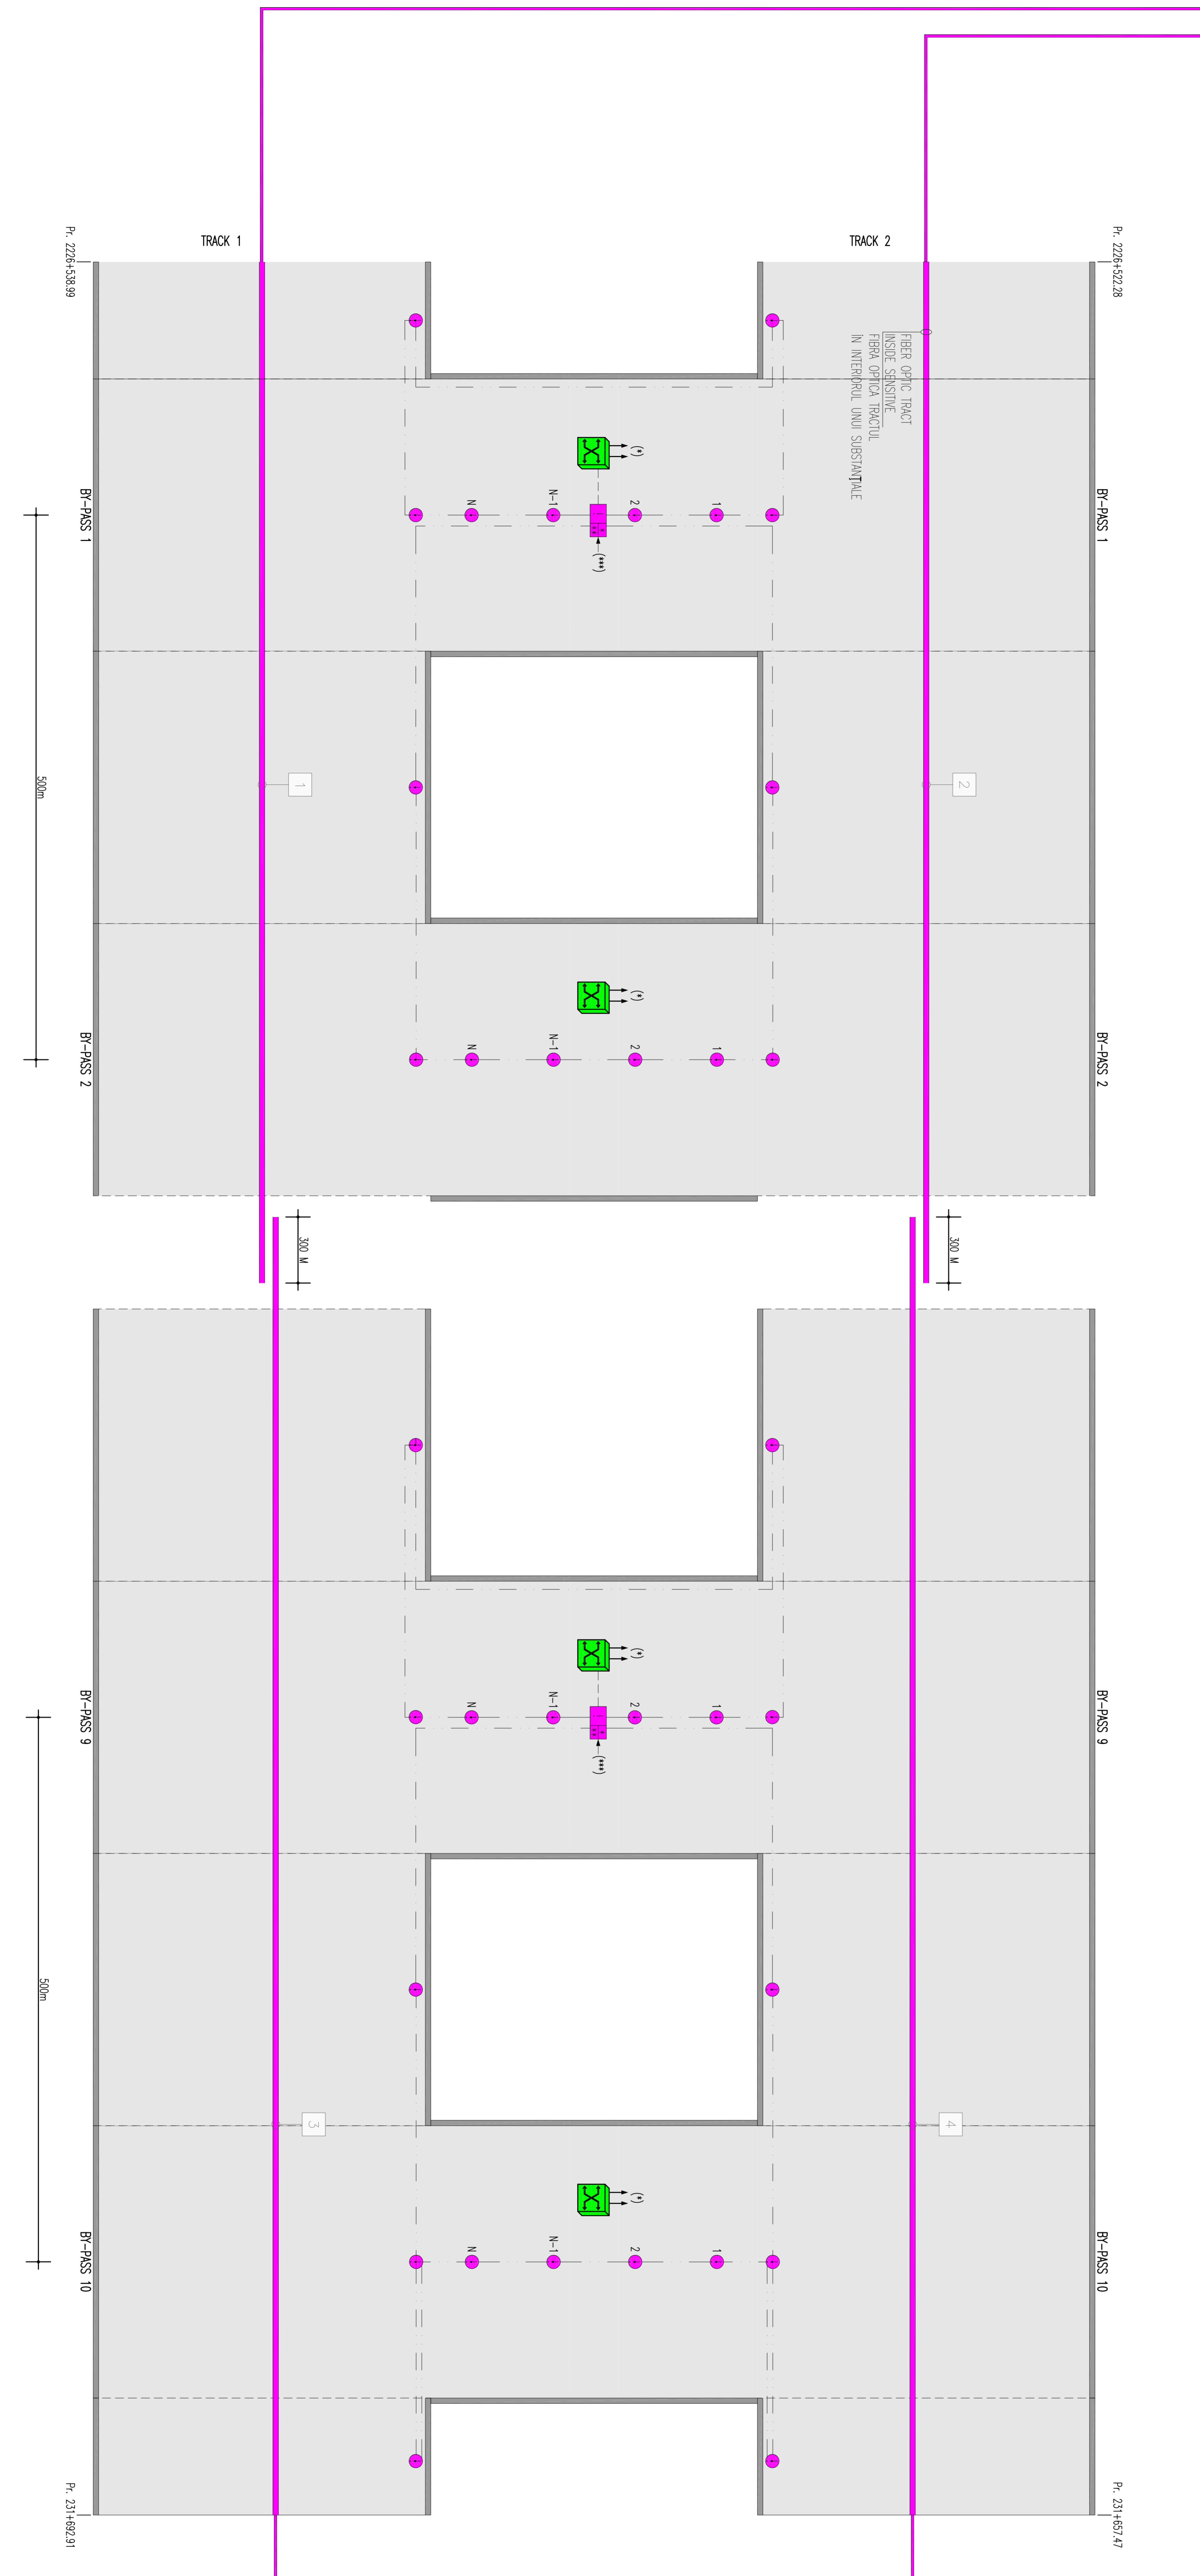

CLIENT / CLIENT: CN.C.F.R. - S.A.

CONSULTANT / CONSULTANT: OBERMEYER CONSULTING ENGINEERS

PROJECT MANAGER / MANAGER DE PROIECT: R. LUZZI

DESIGNER / DESIGNER: C. GENIBELLI

DATE: 2023.03.28

Scale: 1:100

Lot: 1

N. / Nr.: 0

Project/Proiect: P.171 / T.15

Scale: 1:100

Lot: 1

N. / Nr.: 0