


SAFETY AREA / ZONA DE SIGURANȚĂ

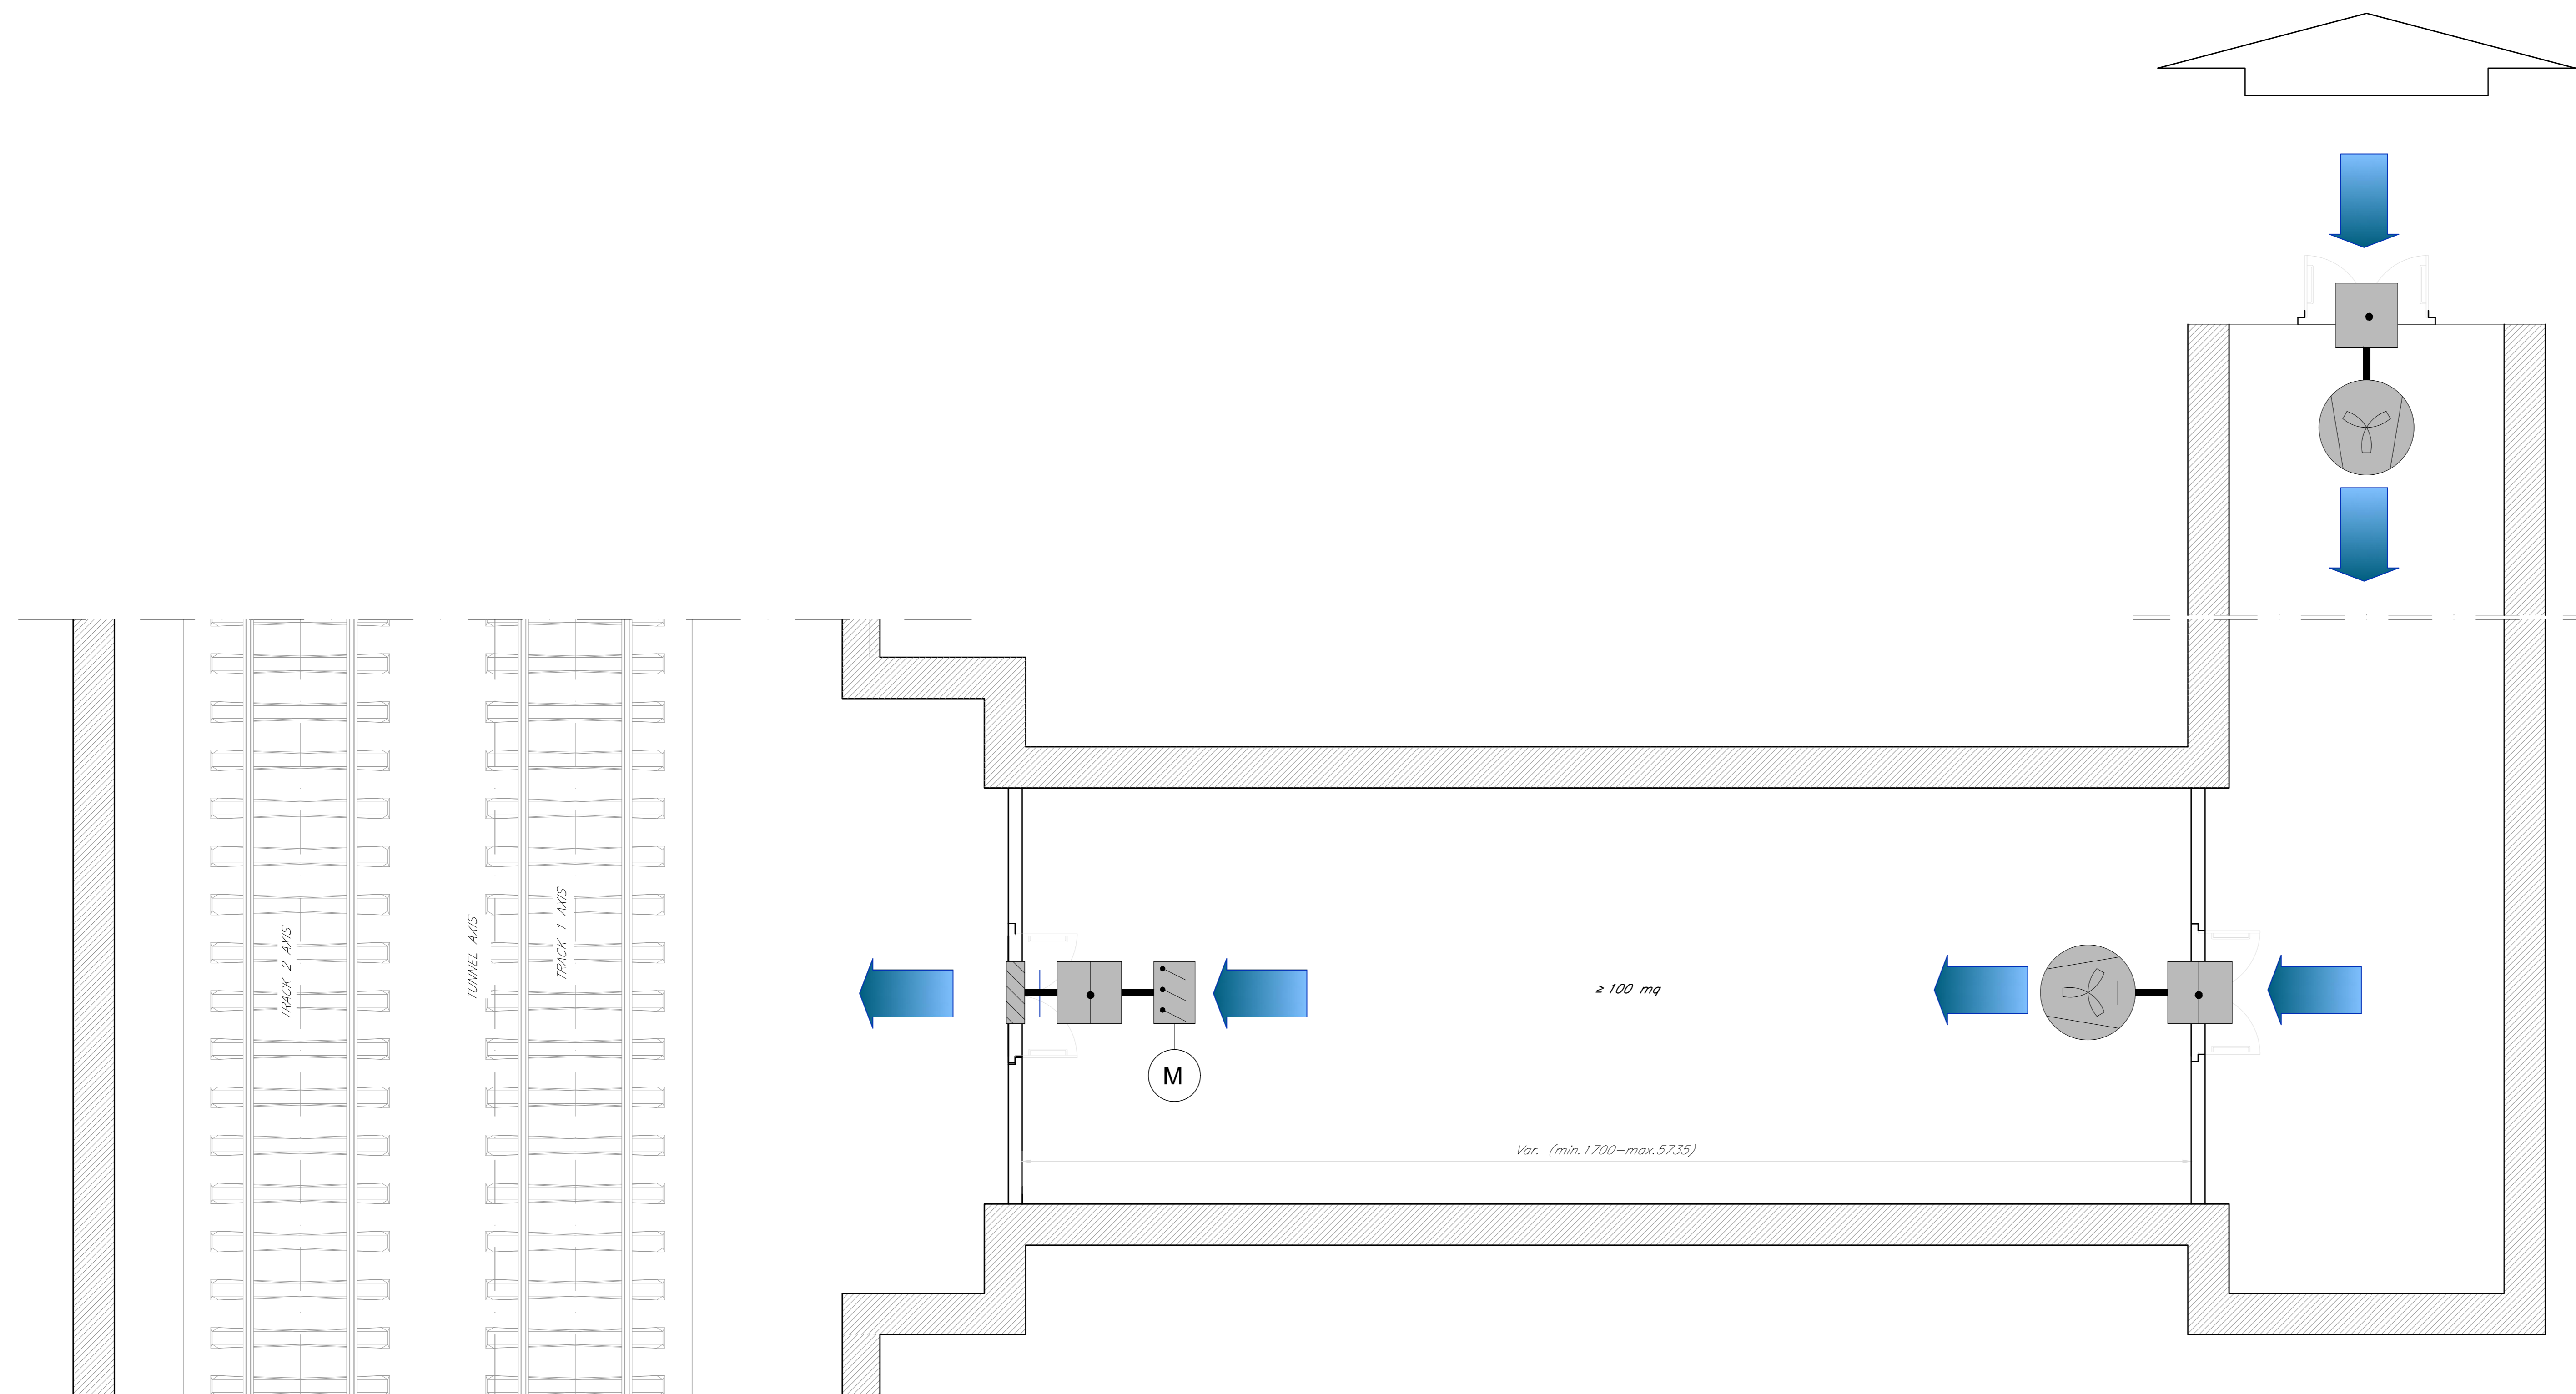

LEGEND/LEGENDA	
	JET FAN/VENTILATOARE Q=10,6 mc/s - P.M.=7,5 kW
	FIRE DAMPER IN GALVANIZED STEEL Dim.1000x700mm FOC AMORTIZOR IN OTEL GALVANIZAT Dim.1000x700mm
	MOTORIZED CONTROL DAMPER IN GALVANIZED STEEL AMORTIZOR DE CONTROL MOTORIZAT Dim.1000x700mm
	GRID IN STEEL GALVANIZED GRID IN OTEL GALVANIZAT Dim.1000x700mm

NOTE / NOTĂ:
PRESENT DRAWING IS SCHEMATIC AND HAS A PURPOSE OF PRESENTING THE ADOPTED SOLUTION ONLY/
ACEST DESENE ESTE SCHEMATICĂ ȘI ARE CA SCOP DOAR PREZENTARE SOLUȚIILE ADOPTATE

CLIENT / CLIENT		C.N.C.F. "C.F.R." - S.A.	
CONSULTANT / CONSULTANT			
Faza	Posiția	Nume	Data
Phase	Position	Name	Date
Approved	Manager de Proiect	Sergio MENCHINI	04.2020
Approved	Project Manager		
Verified	Expert Chief	Fino AMODIO	04.2020
Checked	Key Expert		
Incompi	Principal	Slobodan UROSEVIC	04.2020
Elaborated	Designer		
SUBCONSULTANT / SUBCONSULTANT			
Approved	Responsabil Subconsultant		
Approved	Subconsultant Responsible		
Incompi	Principal		
Elaborated	Designer		
Studiu de Fezabilitate pentru Reabilitarea liniei feroviare Craiova - Drăbeta Turmu Severin - Cărmănești. partea a Coridorului Orient-Est Mediterranean - Feasibility Study For The Rehabilitation Of The Railway Line Craiova - Cărmănești			Proiect/Project 74 / 2018 Faza/Phase S.F.
Denumire / Title : TUNNEL/TUNELUL POARTA I Pressurization system-General layout plan / Sistemul de presurizare-Plan general			
Codificare / Codification System E 2 1 8 0 S F 0 0 D X T S 2 0 2 0 0 1 0			
Istoricul revizibil / Revision History			
Rev.	Data/Date	Descriere Modificare / Modification description	
1			
2			
3			
4			
Responsabilitatea privind această publicație revine integral autorului. Uniunea Europeană nu este responsabilă pentru modul în care sunt utilizate informațiile publicate. The contents of this publication are the sole responsibility of (name of the implementing partner) and do not necessarily reflect the opinion of the European Union.			